

ABOVE GROUND POOLS WARREN COUNTY, OHIO

BUILDING DEPARTMENT, 406 JUSTICE DRIVE, LEBANON OH 45036


INSPECTION:

1. ELECTRIC TRENCH & BONDING BEFORE BACKFILLING
 2. FINAL ELECTRIC INSPECTION.
- CALL 5136951290 THE DAY BEFORE BACKFILLING

IF YOU PLAN ANY LIGHTING WITHIN 16' OF THE POOL YOU WILL NEED TO TALK TO THE PLANS EXAMINER. 513-695-1290

NO OUTLETS WITHIN 6' OF THE POOL

CONTACT YOUR ZONING DEPARTMENT FOR FENCE REQUIREMENTS

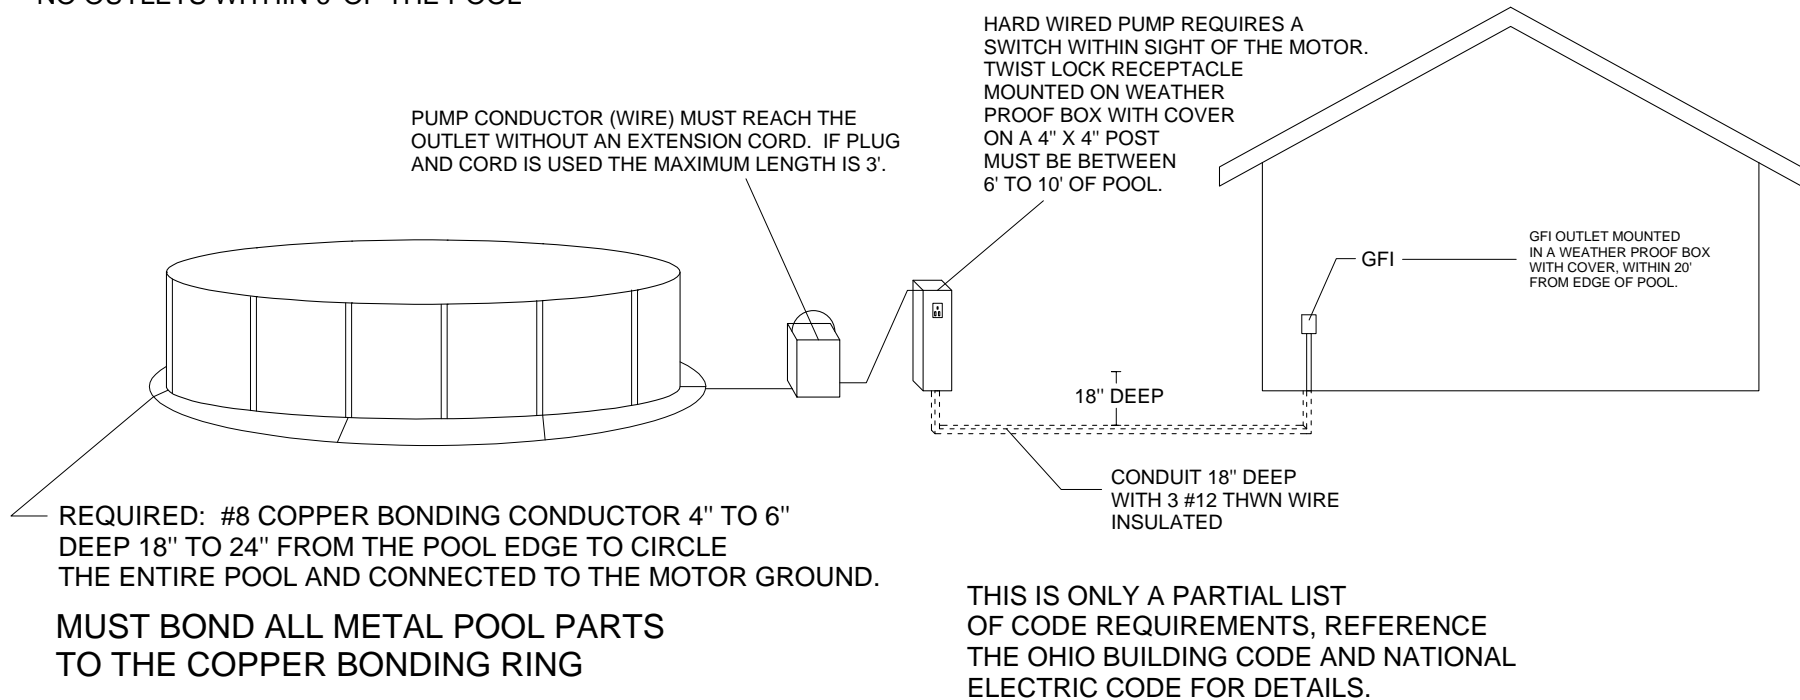

ABOVE GROUND POOLS

INSPECTIONS:

1. ELECTRIC TRENCH & BONDING BEFORE BACKFILLING
 2. FINAL ELECTRIC INSPECTION
- CALL 513-695-1290 THE DAY BEFORE THE INSPECTION

IF YOU PLAN ANY LIGHTING IN OR WITHIN 16' OF THE POOL YOU WILL NEED TO TALK TO THE PLANS EXAMINER @ 513-695-1290

NO OUTLETS WITHIN 6' OF THE POOL

ABOVE-GROUND POOL

PUMP CONDUCTOR (WIRE) MUST REACH THE OUTLET WITHOUT AN EXTENSION CORD. IF PLUG IN WIRE IS USED THE MAX LENGTH IS 3'

PUMP

1/2" CONDUIT 18" DEEP WITH 3 #12 THWN WIRE INSULATED

HARD WIRED PUMP REQUIRES A SWITCH WITHIN SIGHT OF THE MOTOR. TWIST LOCK RECEPTACLE MOUNTED ON WEATHER PROOF BOX WITH COVER ON A 4" x 4" POST

GFI OUTLET MOUNTED IN A WEATHER PROOF BOX WITH COVER (IF LESS THAN 20' FROM POOL)

REQUIRED: #8 COPPER BONDING CONDUCTOR 4" TO 6" DEEP 18" TO 24" FROM THE POOL EDGE TO CIRCLE THE ENTIRE POOL AND CONNECTED TO THE MOTOR GROUND AND THE METAL PARTS OF THE POOL.

HOUSE