
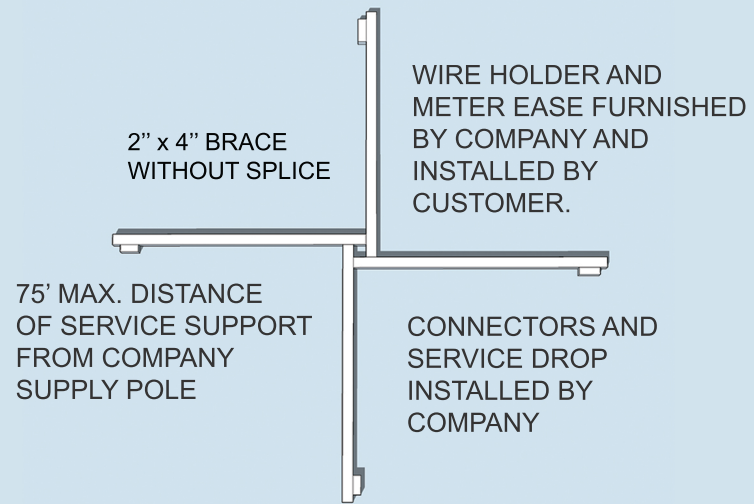


WARREN COUNTY BUILDING INSPECTION
 406 JUSTICE DRIVE, LEBANON, OHIO 45036
 PHONE: (513)695-1290

RECOMENDED STRUCTURE AND ARRANGEMENT
 OF SERVICE EQUIPMENT

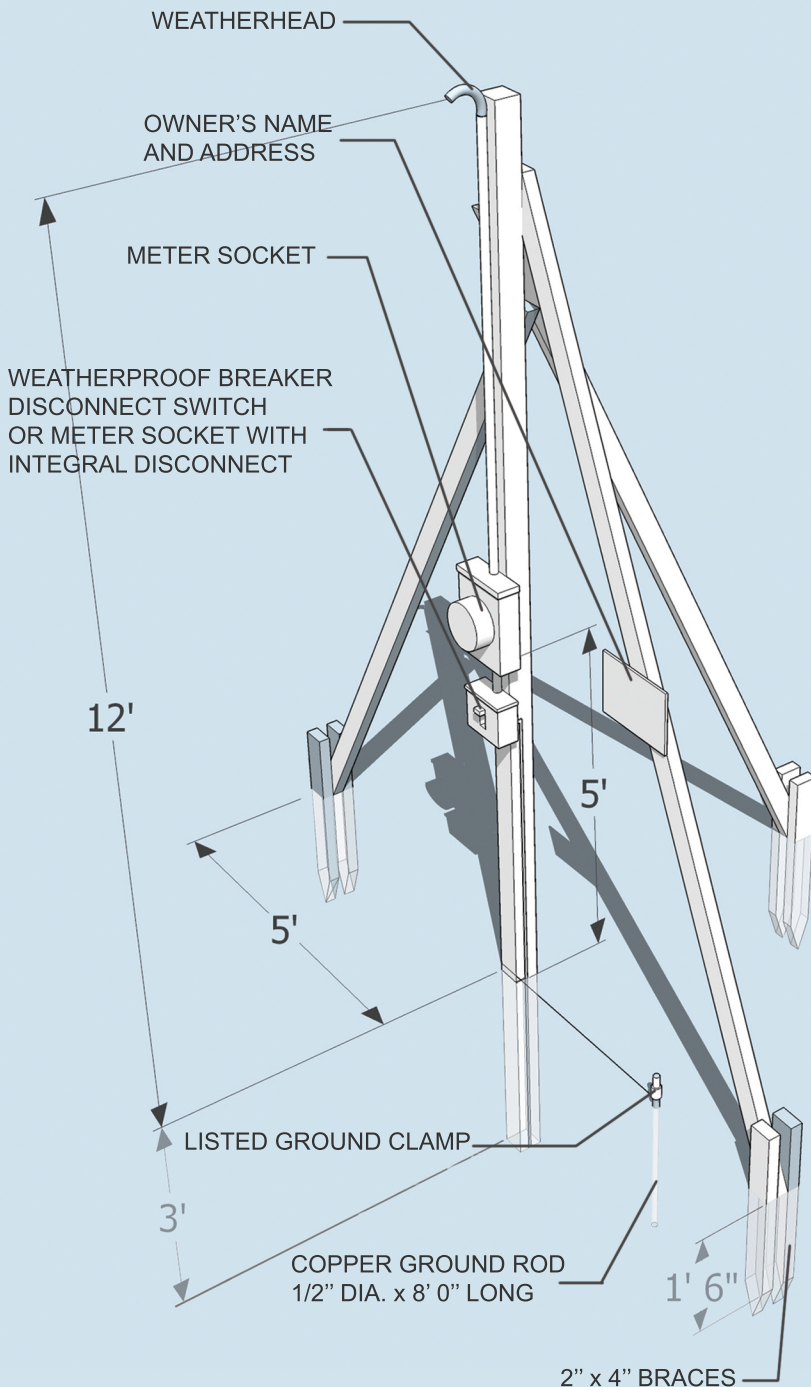

GENERAL NOTES:

SERVICE DROPS UP TO 40': (1) 4" x 4" OR (2) 2" x 4" TIMBERS SPIKED TOGETHER.

SERVICE DROPS GREATER THAN 40' UP TO 75': (2) 2" x 6" TIMBERS SPIKED TOGETHER.

THIS INSTALLATION IS RECOMMENDED FOR ALL TEMPORARY 120/240V - 1 SERVICES, 200 AMPS OR SMALLER.

TIMBER SIZES SHOWN FOR SERVICE SUPPORT ARE MINIMUM FOR STRENGTH REQUIRED. CUSTOMER TO INSTALL ALL MATERIALS INCLUDING SERVICE SUPPORT, SERVICE DISCONNECT(S), SERVICE GROUND (590) CONSTRUCTION SITES.

ALL 120 VOLT SINGLE PHASE 15 AND 20 AMPERE RECEPTACLE OUTLETS WHICH ARE NOT A PART OF THE PERMANENT WIRING OF THE BUILDING OR STRUCTURE, SHALL HAVE GROUND FAULT CIRCUIT INTERRUPTERS FOR PERSONNEL PROTECTION.

WARREN COUNTY

RECOMMENDED TEMPORARY CONSTRUCTION POLE (UNDERGROUND)

