

# Resolution

Number 23-0572

Adopted Date May 09, 2023

AMEND STANDARD DETAILS FOR THE WARREN COUNTY WATER AND SEWER DEPARTMENT

WHEREAS, by Resolution #87-1103, the Board established Standard Details for water and sanitary sewer improvements to be constructed within Warren County; and

WHEREAS, by Resolution #12-0787, the Board amended said Standard Details; and

WHEREAS, by Resolution #18-0585, the Board amended said Standard Details; and

WHEREAS, it is necessary, at this time, to amend said Standard Details; and

NOW THEREFORE BE IT RESOLVED:

1. That the Standard Details for the Warren County Water and Sewer Department are hereby amended by the revisions to the following:

## STANDARD DRAWING INDEX

WATER DETAIL W-1	(WATERMAIN LAYOUT AT CUL-DE-SAC)
WATER DETAIL W-5	(WATERMAIN ENCASEMENT AT CREEK CROSSING)
WATER DETAIL W-6	(WATERMAIN ENCASEMENT AT SEWER CROSSING)
WATER DETAIL W-7	(WATERMAIN IN CASING)
WATER DETAIL W-8	(HYDRANT SETTING)
WATER DETAIL W-10A	(METER BOX DETAIL FOR ¾" AND 1" METERS)
WATER DETAIL W-11	(MULTIPLE WATER SERVICE CONNECTIONS)
WATER DETAIL W-14	(LARGE DOMESTIC WATER METER PIT)
WATER DETAIL W-15A	(LARGE WATER METER PIT W/FDC & DOMESTIC LINE)
WATER DETAIL W-15B	(LARGE WATER METER PIT W/FIRE LINE, DOMESTIC LINE & IRRIGATION LINE)
WATER DETAIL W-18	(REQUIRED RESTRAINED JOINTS FOR BENDS)
WATER DETAIL W-19	(REQUIRED RESTRAINED JOINTS – DEAD END VALVES, PLUGS, CAPS, & TEES)
WATER DETAIL WG-1A	(GENERAL NOTES – WATER)
WATER DETAIL WG-1B	(GENERAL NOTES – WATER (CONTINUED))
SANITARY DETAIL S-1	(PRECAST MANHOLE)
SANITARY DETAIL S-2	(PRECAST MANHOLE WITH INSIDE DROP CONNECTION)
SANITARY DETAIL S-3	(VENTED MANHOLE)
SANITARY DETAIL S-4	(MANHOLE CHANNELS)
SANITARY DETAIL S-14A	(HOUSE CONNECTIONS)
SANITARY DETAIL S-14B	(HOUSE CONNECTIONS)
SANITARY DETAIL S-14C	(HOUSE CONNECTIONS)
SANITARY DETAIL S-15	(FORCEMAIN CLEANOUT)
SANITARY DETAIL S-18	(REQUIRED RESTRAINED JOINTS FOR BENDS)
SANITARY DETAIL S-19	(FORCEMAIN TRENCH DETAIL)
SANITARY DETAIL S-20	(IMPERVIOUS DAM DETAIL)
SANITARY DETAIL S-21	(LATERAL SADDLE INSTALLATION DETAIL FOR PVC PIPE)

SANITARY DETAIL S-22	(LATERAL SADDLE INSTALLATION FOR VCP & DUCTILE IRON PIPE)
SANITARY DETAIL SG-1	(DETAILED PROCEDURES FOR SANITARY SEWER)
SANITARY DETAIL SG-2A	(GENERAL NOTES – SEWER)
SANITARY DETAIL SG-2B	(GENERAL NOTES – SEWER (CONTINUED))
SANITARY DETAIL SG-4	(SEWER TESTING)

2. That the Standard Details for the Warren County water and Sewer Department are hereby amended by adding the following:

WATER DETAIL W-15C	(COMBINATION FIRE/DOMESTIC METER PIT)
WATER DETAIL W-15D	(LARGE WATER METER PIT EQUIPMENT SCHEDULE)
WATER DETAIL W-17	(VERTICAL BEND RESTRAINT – BLOCK DETAIL)
WATER DETAIL W-22	(SAMPLING STATION)
WATER DETAIL W-23	(TRACER WIRE – PLAN)
WATER DETAIL W-24	(TRACER WIRE – WATER SERVICE PLAN)
WATER DETAIL W-25	(TRACER WIRE – FIRE HYDRANT PLAN)
WATER DETAIL W-26A	(POLYETHYLENE ENCASEMENT – DUCTILE IRON PIPE)
WATER DETAIL W-26B	(POLYETHYLENE ENCASEMENT – DUCTILE IRON PIPE CONTINUED)
WATER DETAILS W-27	(TAPPING POLYETHYLENE ENCASED PIPE)

3. That the Standard Details for the Warren County Water and Sewer Department are hereby amended by deleting the following:

WATER DETAIL W-15C	(LARGE WATER METER PIT EQUIPMENT SCHEDULE)
WATER DETAIL W-17	(ANCHORS & BUTTRESSES FOR VERTICAL BENDS)
SANITARY DETAIL S-19	(REQUIRED RESTRAINED JOINTS – DEAD END VALVES, PLUGS, CAPS, & TEES)

4. That these modifications shall be effective immediately and a copy of the amended details are attached hereto and made a part hereof.
5. That all other provisions and requirements of the Standard Details shall remain unchanged.

Mr. Young moved for adoption of the foregoing resolution being seconded by Mrs. Jones. Upon call of the roll, the following vote resulted:


Mr. Grossmann – absent

Mrs. Jones – yea

Mr. Young – yea

Resolution adopted this 9<sup>th</sup> day of May 2023.

BOARD OF COUNTY COMMISSIONERS

  
Tina Osborne, Clerk

cc: Water/Sewer ( File)

## **WATER DETAILS**

W-1	WATERMAIN LAYOUT AT CUL-DE-SAC
W-2	WATERMAIN TRENCH DETAIL
W-3	THRUST BLOCK DETAILS
W-4	FULL CONCRETE ENCASEMENT
W-5	WATERMAIN ENCASEMENT AT CREEK CROSSING
W-6	WATERMAIN ENCASEMENT AT SEWER CROSSING
W-7	WATERMAIN IN CASING
W-8	HYDRANT SETTING
W-9	FIRE HYDRANT ARRANGEMENT
W-10A	METER BOX DETAIL FOR 3/4" AND 1" METERS
W-10B	METER BOX DETAIL FOR 1-1/2" AND 2' METERS
W-11	MULTIPLE WATER SERVICE CONNECTIONS
W-12	TYPICAL WATER SYSTEM DETAIL
W-13	DITCH AND METER LOCATION
W-14	LARGE DOMESTIC WATER METER PIT
W-15A	LARGE WATER METER PIT W/ FIRE LINE W/ FDC & DOMESTIC LINE
W-15B	LARGE WATER METER PIT W/ FIRE LINE, DOMESTIC LINE, & IRRIGATION LINE
W-15C	COMBINATION FIRE/DOMESTIC METER PIT
W-15D	LARGE WATER METER PIT EQUIPMENT SCHEDULE
W-16	VALVE PIT
W-17	ANCHORS & BUTTRESSES FOR VERTICAL BENDS
W-18	REQUIRED RESTRAINED JOINTS FOR BENDS
W-19	REQUIRED RESTRAINED JOINTS - DEAD ENDS, PLUGS, CAPS, & TAPS
W-20	ROAD PAVEMENT CUT AND RESTORATION AT ROADWAY CROSSING
W-21	METER TEST PIT AT CREEK CROSSING
W-22	SAMPLING STATION
W-23	TRACER WIRE - PLAN
W-24	TRACER WIRE - WATER SERVICE PLAN
W-25	TRACER WIRE - FIRE HYDRANT PLAN
W-26A	POLYETHYLENE ENCASEMENT - DUCTILE IRON PIPE
W-26B	POLYETHYLENE ENCASEMENT - DUCTILE IRON PIPE CONTINUED
W-27	TAPPING POLYETHYLENE ENCASED PIPE
WG-1A	GENERAL NOTES - WATER
WG-1B	GENERAL NOTES - WATER (CONTINUED)
WG-2	PROCEDURE FOR CONNECTION TO EXISTING WATER SYSTEM
WG-3	PROCEDURE FOR RELOCATING OR LOWERING SERVICE LATERALS AND RELOCATING OR BRINGING TO GRADE METER PITS

## **TABLE OF CONTENTS - WATER DETAILS**


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**TOC**

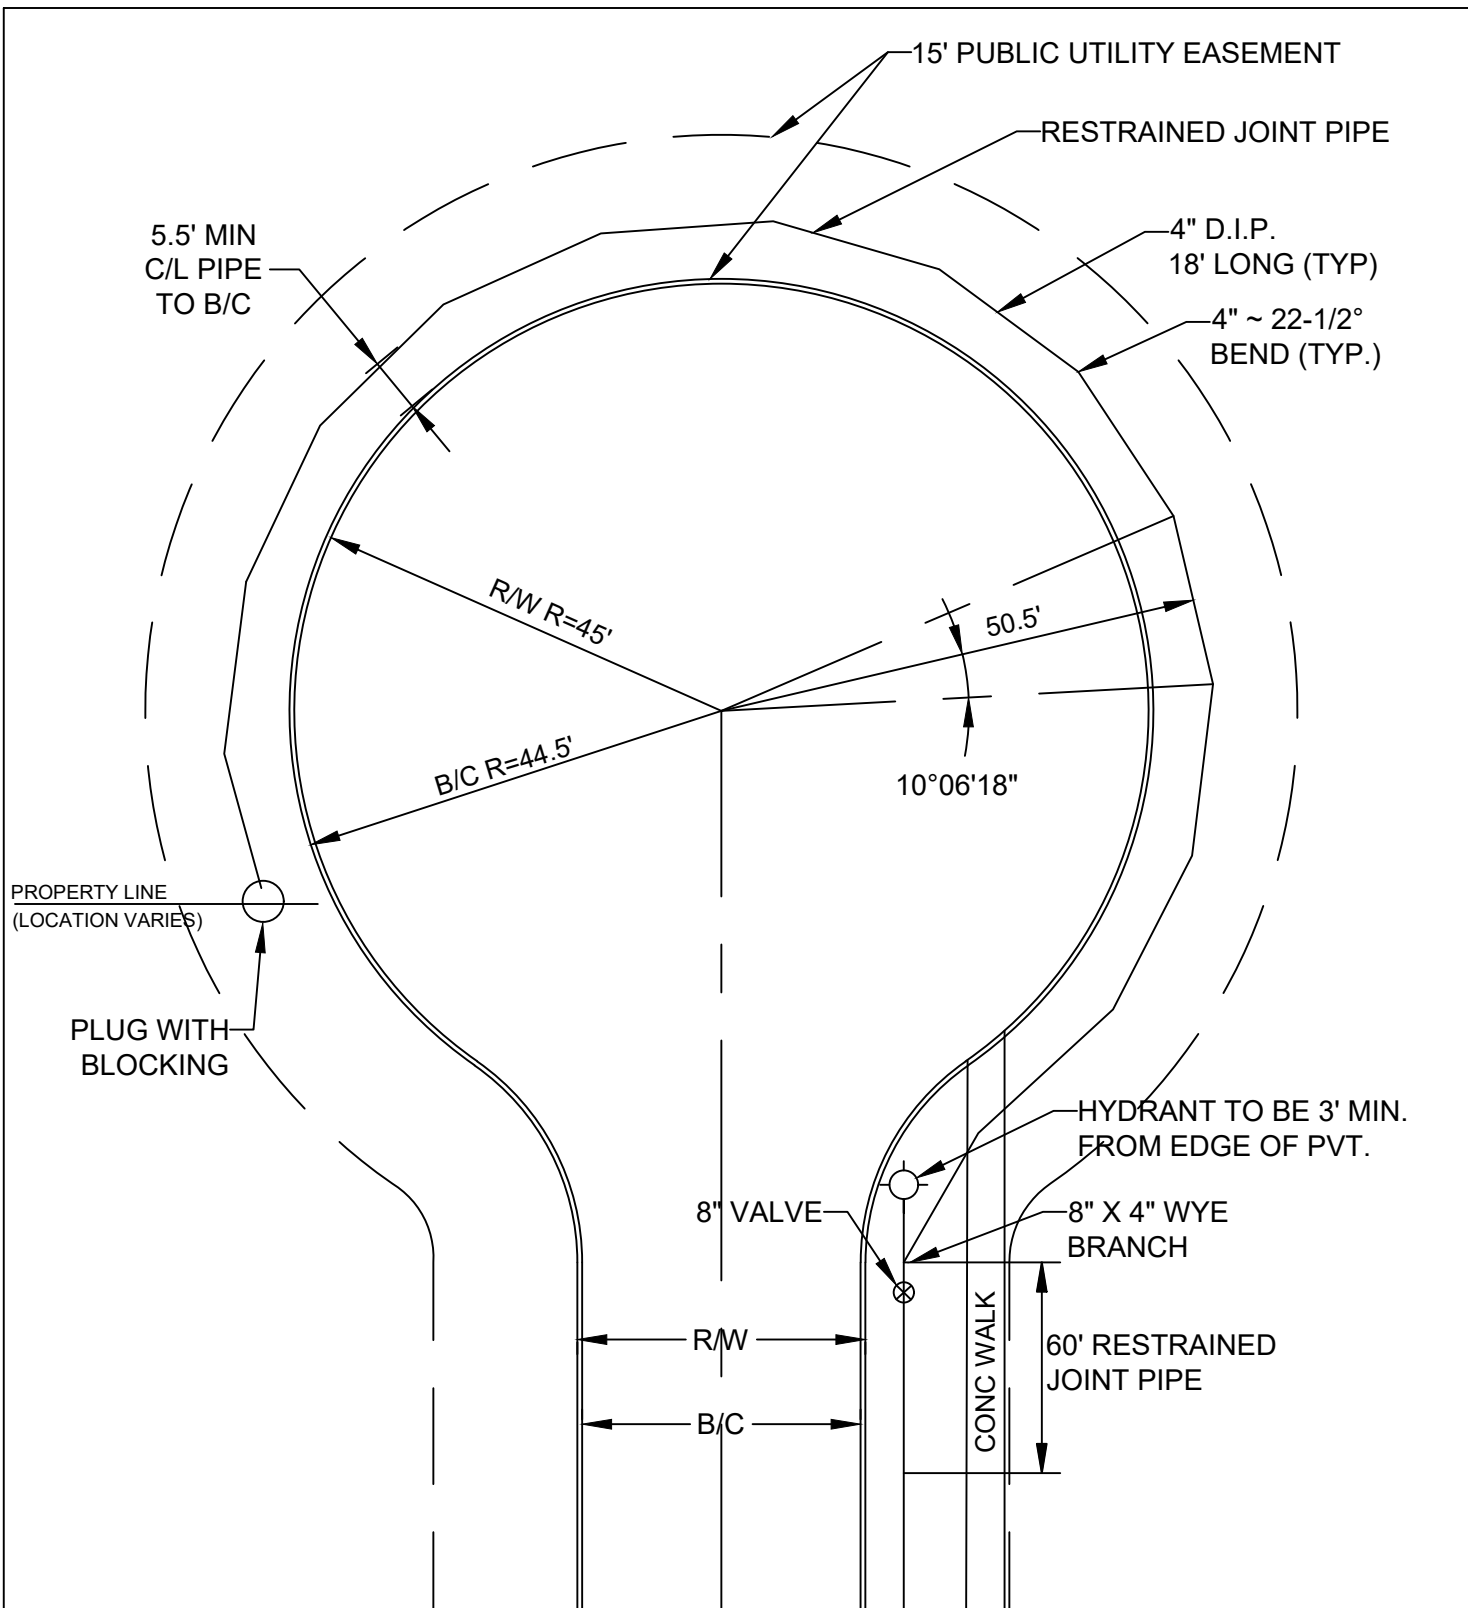

ALL BENDS SHALL BE LABELED WITH STATIONING.

## WATERMAIN LAYOUT AT CUL-DE-SAC

APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-1**

WATERMAIN SHALL BE INSTALLED IN A SEPARATE TRENCH FROM THE SANITARY SEWER AND SHALL BE A MINIMUM DISTANCE OF 10' MEASURED HORIZONTALLY FROM THE SANITARY SEWER.

BACKFILL AND RESTORATION OF PAVEMENT MUST CONFORM TO THE APPLICABLE WARREN COUNTY ENGINEER OR ODOT SPECIFICATION(S).

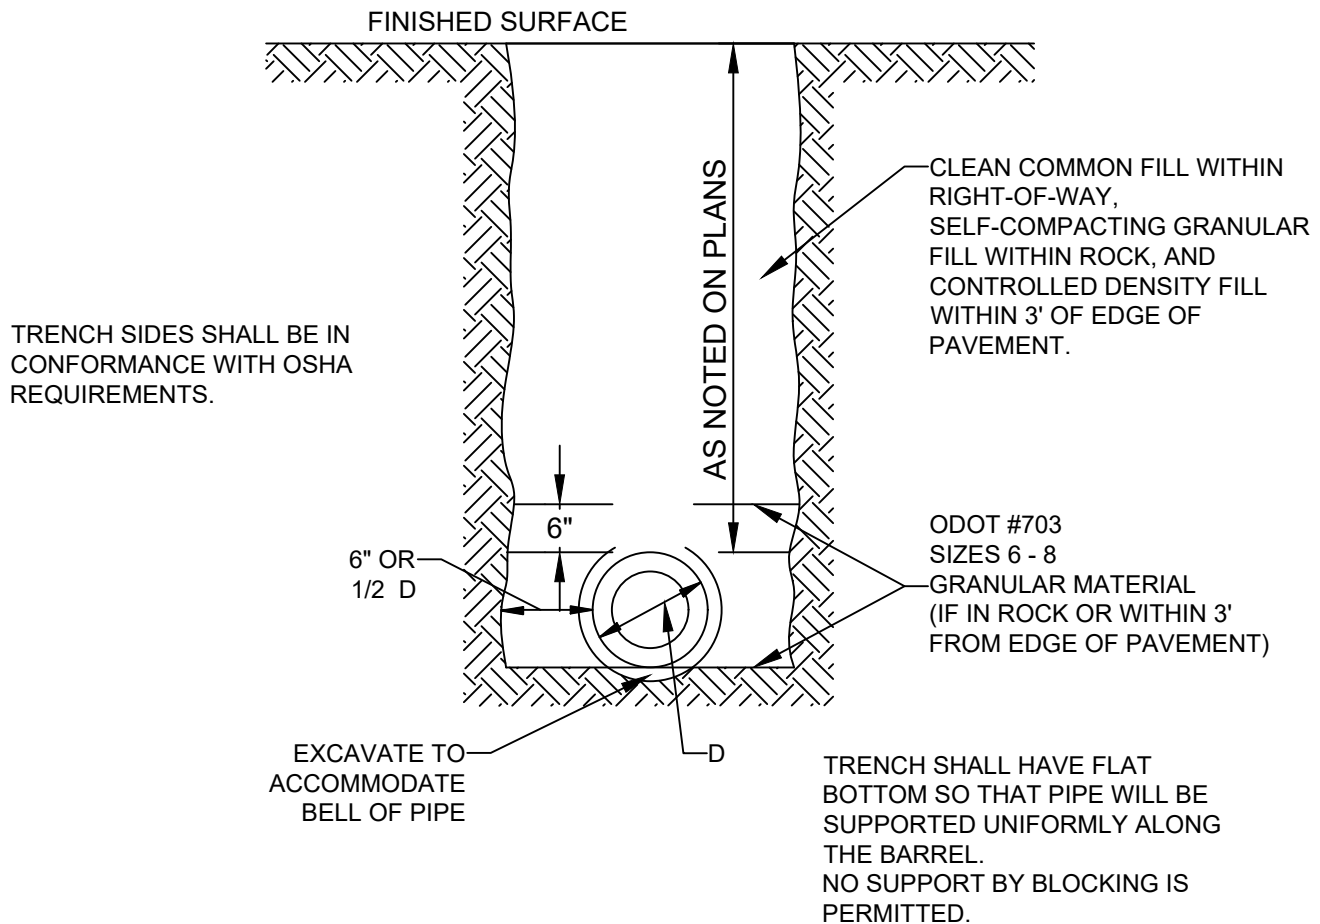

## WATERMAIN TRENCH DETAIL


APPROVED/REVISED

JUNE, 2012


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-2**

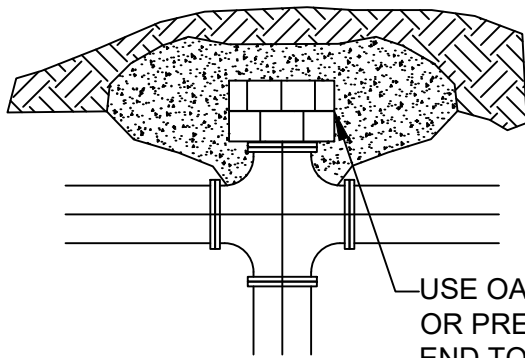


CROSS

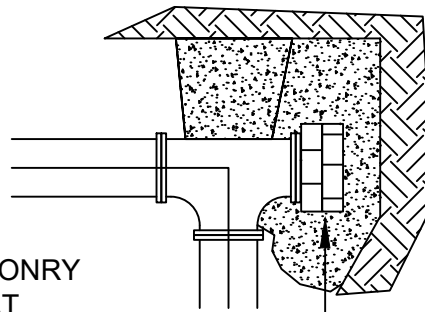

TEE


USE OAK, CEMENT MASONRY OR PRECAST BLOCKS AT END TO BE PLUGGED (TYP.)

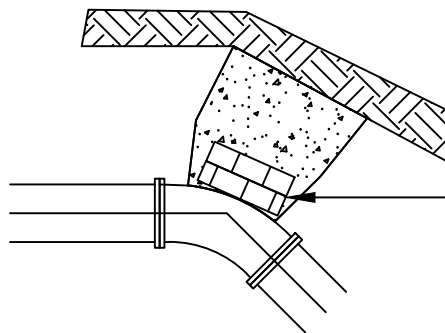


45° BEND

USE OAK, CEMENT MASONRY OR PRECAST BLOCKS AT BACK OF BEND (TYP.)

USE OAK, CEMENT MASONRY OR PRECAST BLOCKS AT BACK OF BEND (TYP.)

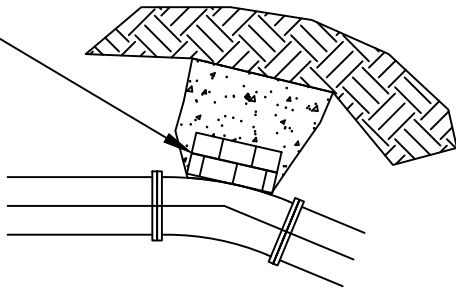

22.5° BEND

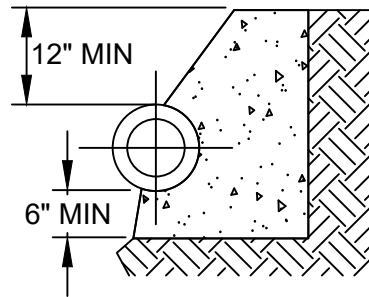

SECTIONAL VIEW

NOTE:

BEARING AREA TO BE DETERMINED BASED ON SOIL TYPE & WORKING PRESSURE.  
THRUST BLOCKS TO BE USED AT ALL BENDS 22.5° OR GREATER.  
THRUST BLOCKS TO BE POURED AGAINST FIRM UNDISTURBED SOIL.  
USE CLASS "C" CONCRETE.  
90° BENDS SHALL NOT BE PERMITTED.

## THRUST BLOCK DETAILS


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-3**

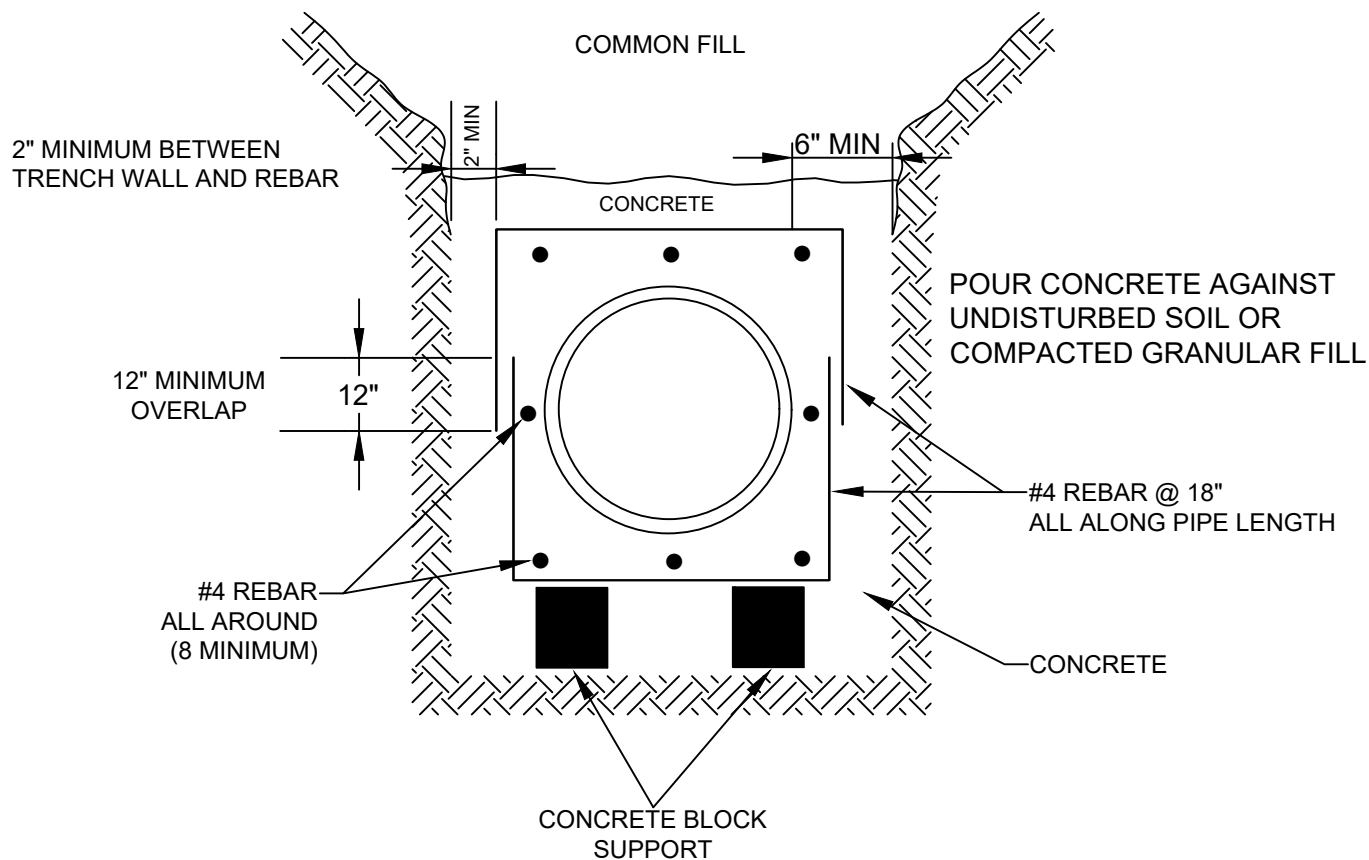

NOTES:

- 1) CONCRETE SHALL BE 3000 P.S.I. MINIMUM 28 DAYS STRENGTH (4" SLUMP).
- 2) SUPPORT PIPE AND REBAR CAGE ON CONCRETE BRICKS DURING CONCRETE PLACEMENT.
- 3) CONCRETE ENCASUREMENT SHALL BE TERMINATED AT PIPE JOINTS ONLY.

## FULL CONCRETE ENCASEMENT


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-4**

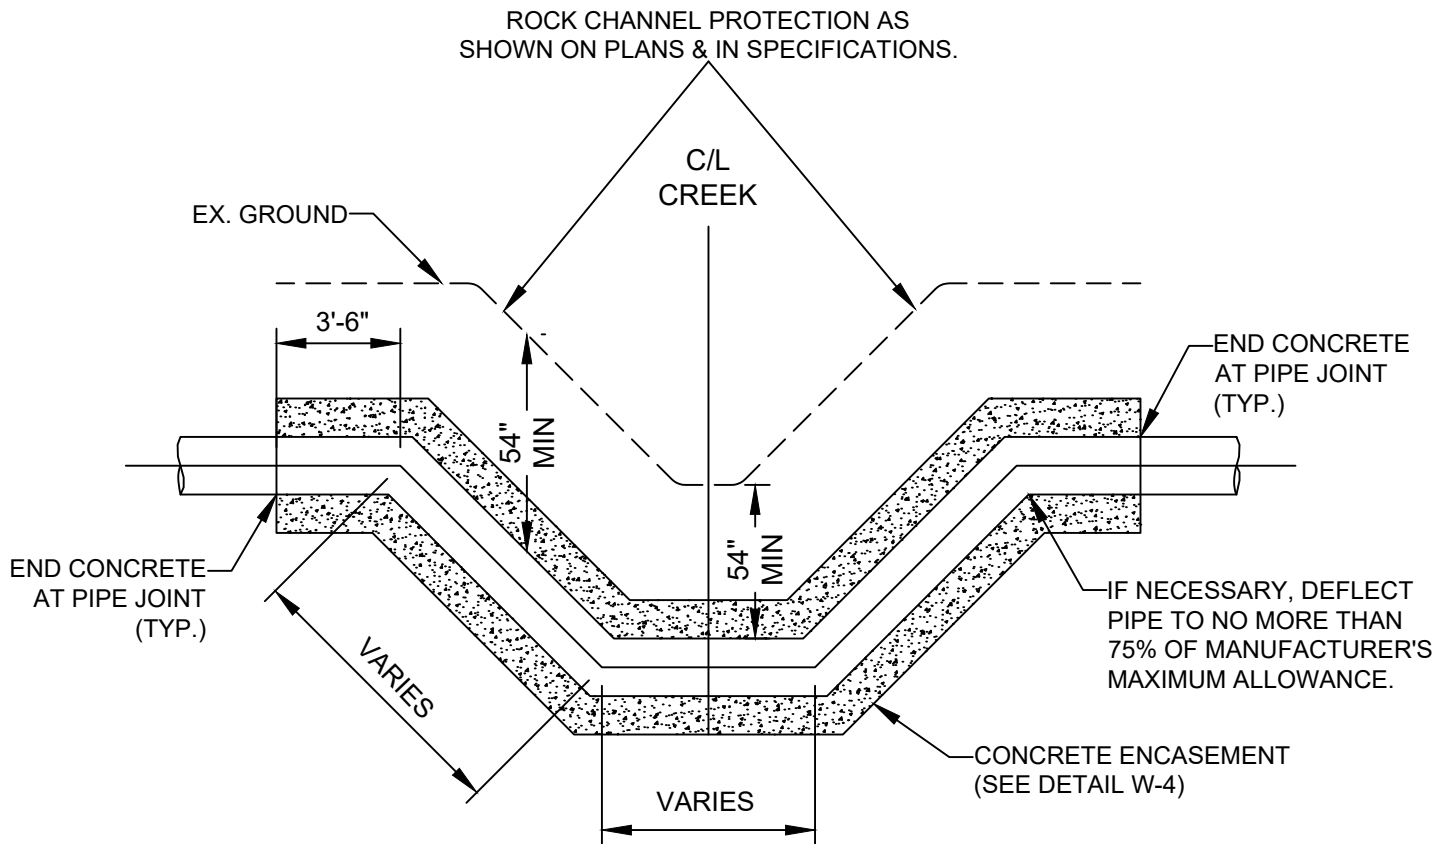

NOTES:

- 1) ALL PIPE IN CREEK CROSSINGS TO BE RESTRAINED JOINT, PER STANDARD NUMBER W-18.
- 2) WATERMAIN ENCASEMENT TO BE USED ONLY WHEN SPECIFIED ON PLANS.

## WATERMAIN ENCASEMENT AT CREEK CROSSING

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-5**



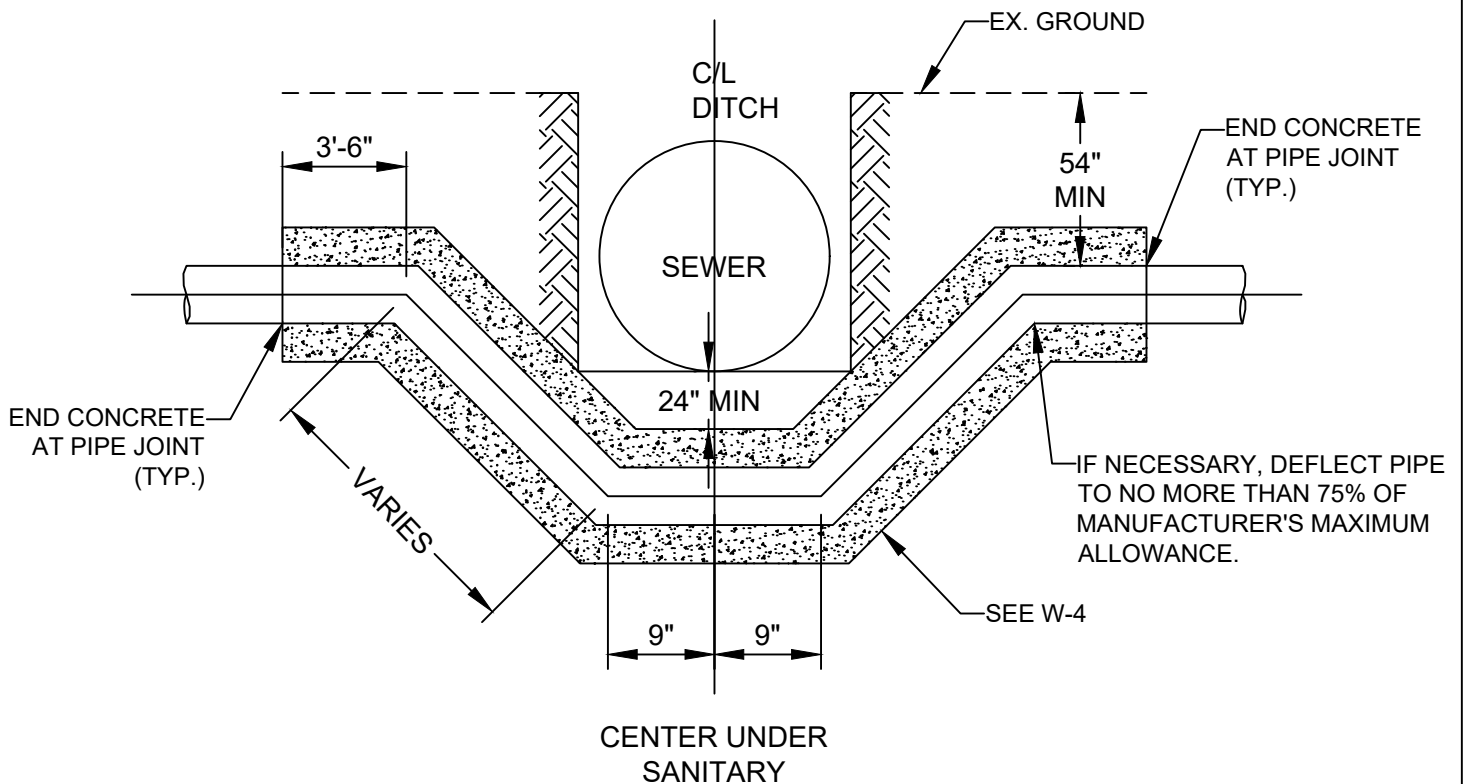

NOTE:  
WATERMAIN ENCASEMENT TO BE USED ONLY WHEN SPECIFIED ON PLANS.

ALL PIPE IN SEWER CROSSINGS TO BE RESTRAINED JOINT, PER STANDARD NUMBER W-18

## WATERMAIN ENCASEMENT AT SEWER CROSSING

APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-6**


# WATER PIPE SIZE - CARRIER PIPE SIZE (O.D.)-THICKNESS

4"	10"	1/4"
6"	12"	3/8"
8"	18"	3/8"
10"	20"	3/8"
12"	24"	1/2"
16"	24"	1/2"
20"	30"	1/2"
24"	36"	1/2"

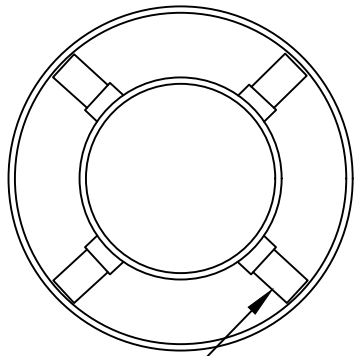


SO THAT PIPE WILL BE CENTERED IN CARRIER PIPE, THE FOLLOWING INFORMATION IS NEEDED:

1. TYPE & O.D. OF PIPE
2. TYPE OF JOINT/RESTRAINT
3. TYPE & I.D. OF CASING
4. 2 SPACER PER LENGTH OF PIPE (18")  
(SEE STANDARD PLACEMENT BELOW)

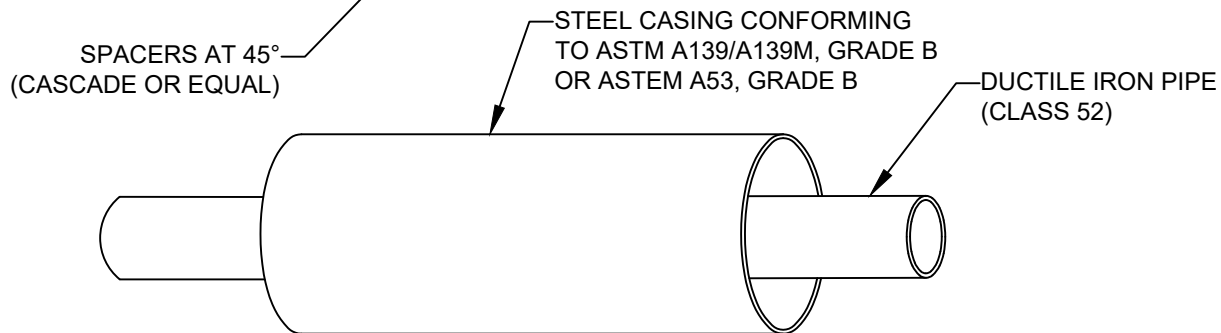

## NOTE:

1. RESTRAINED JOINT TO BE USED WITHIN LIMITS OF CASING
2. PACK END OF CASING WITH CONCRETE OR GRAVEL
3. CASING SPACER TO BE USED THRU CARRIER PIPE

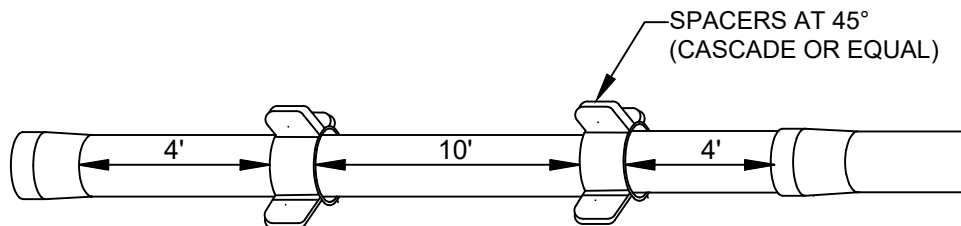

RECOMMENDED STANDARD PLACEMENT

## WATERMAIN IN CASING

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**W-7**

W.M.	F.H. BURIAL DEPTH
6"	5'-0"
8"	5'-0"
10"	5'-0"
12"	5'-0"
16"	5'-6"
18"	5'-6"
20"	5'-6"


ALL FIRE HYDRANTS AND HYDRANT VALVES MUST OPEN LEFT.

ALL HYDRANTS TO BE 5 1/4" BRONZE TO BRONZE SEAT

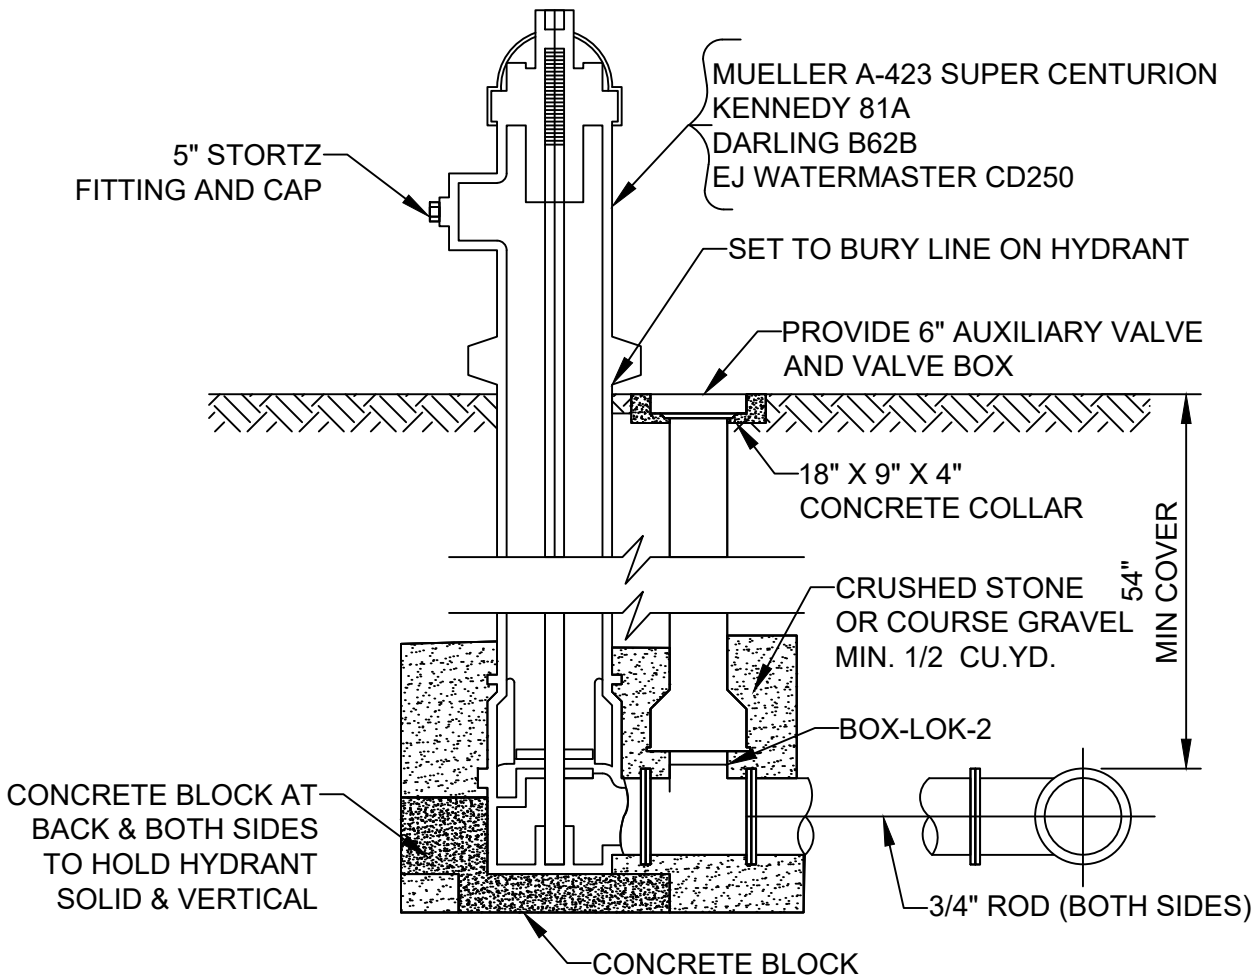

1. ALL VALVES MUST BE RESILIENT SEATED.
2. APPROVED VALVE TYPES: CLOW, DRESSER & AMERICAN DARLING. MUST CONFORM TO AWWA C509.
3. RODDING SHALL NOT BE REQUIRED IF ANCHOR FLANGES (SPOOLS) ARE USED.
4. HYDRANTS TO BE EQUIPPED WITH PRE-ATTACHED 4.5" NST PUMPER CONNECTION WITH A 5" STORTZ FITTING AND CAP.

HYDRANT SETTING		
APPROVED/REVISED	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER
MAY, 2023		W-8

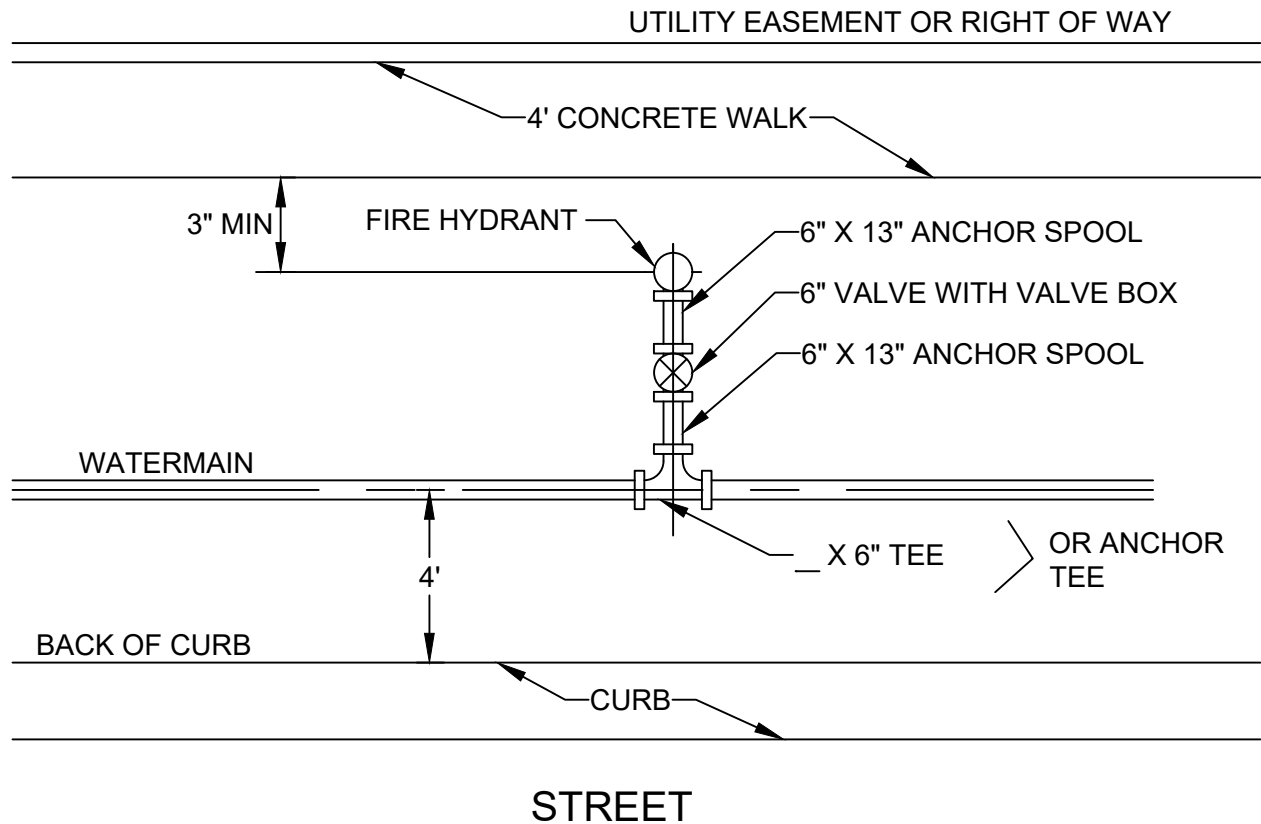


**NOTES:**

1. HYDRANT, VALVE, BEND & TEE TO BE CLOSE COUPLED (USE RESTRAINED JOINTS).
2. HYDRANT AND VALVE MUST BE A MINIMUM OF 3' FROM ANY PAVED SURFACE.
3. ALL VALVES MUST BE RESILIENT SEATED.
4. APPROVED VALVE TYPES: CLOW, DRESSER & AMERICAN DARLING. MUST CONFORM TO AWWA C509.
5. RODDING SHALL NOT BE REQ'D IF ANCHOR FLANGES (SPOOLS) ARE USED.
6. HYDRANTS TO BE EQUIPPED WITH PRE-ATTACHED 4.5" NST PUMPER CONNECTION WITH A 5" STORTZ FITTING AND CAP.

## FIRE HYDRANT ARRANGEMENT

APPROVED/REVISED	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER
JUNE, 2012		<b>W-9</b>

METER SIZE	CHART A ANGLE VALVE	CHART B CHECK VALVE	CHART C METER PIT & COVER	CHART D CORP STOP	CHART E COUPLINGS
3/4" - 5/8"	MUELLER P24258-1 FORD BA43-332W MCDONALD 4602 B-22	MUELLER P 14269 FORD HA34 323 MCDONALD 02-342	<u>METER PIT</u> 20'X30" SIGMA #2030-SW-W ROUND STRAIGHT WALL <u>COVER</u> FORD C-3T OR EQUAL	MUELLER P 15008 FORD FB1000 MCDONALD MAC-PAK COMPRESSION	FORD C44-33 MUELLER P 15403 MCDONALD 4758-22
1 "	FORD BA43-444W	FORD HA34-444	<u>METER PIT</u> 20'X30" SIGMA #2030-SW-W ROUND STRAIGHT WALL <u>COVER</u> FORD C-3T OR EQUAL	FORD FB1000	FORD C44-44 MUELLER P 15403 MCDONALD 4758-22
DOUBLE 3/4"	FORD UVB43-32W	FORD HA34-323	<u>METER PIT</u> 20'X30" SIGMA #2030-SW-W ROUND STRAIGHT WALL <u>COVER</u> FORD C-3T OR EQUAL	FORD FB1000	FORD C44-33 MUELLER P 15403 MCDONALD 4758-22

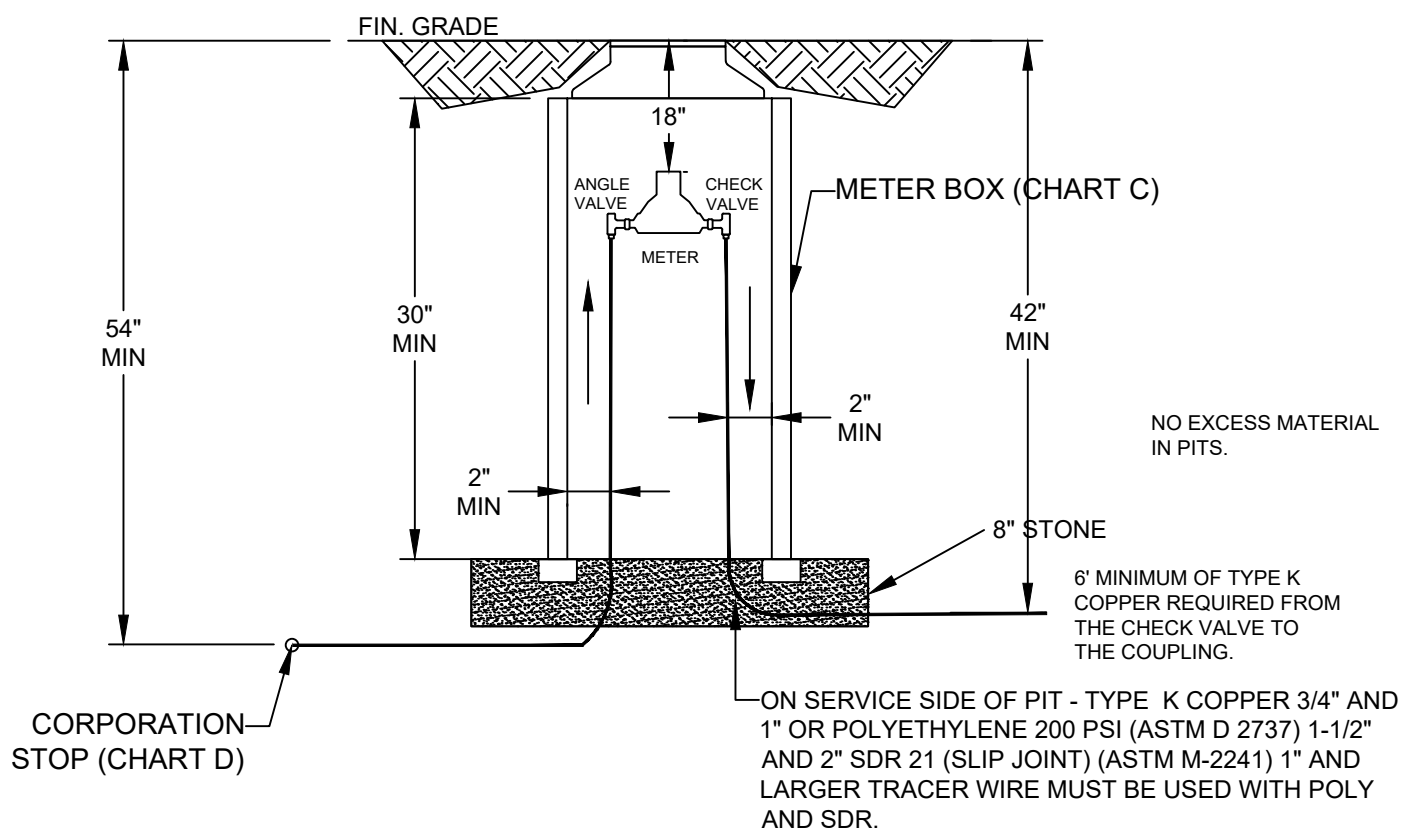


NOTE:

1. BACK FLOW PREVENTER TO BE INSTALLED AHEAD OF ANY SPRINKLER BUT NOT IN METER PIT.

## METER BOX DETAIL FOR 3/4" AND 1" METERS

APPROVED/REVISED	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER
MAY, 2023		<b>W-10A</b>

METER SIZE	CHART A ANGLE VALVE	CHART B CHECK VALVE	CHART C METER PIT & COVER	CHART D CORP STOP	CHART E COUPLINGS
1 1/2"	FORD VBH76-15-44-66 OR EQUAL	FORD B44-666 OR EQUAL	METER PIT 36'X36" CARSON STRAIGHT WALL METER PIT  COVER FORD C-3T OR EQUAL	FORD F1000-6 FORD FB1000-6	FORD C44-66 MUELLER P 15403 MCDONALD 4758-22
2 "	FORD VBH77-15B-44-77 OR EQUAL	FORD B44-777 OR EQUAL	METER PIT 36'X36" CARSON STRAIGHT WALL METER PIT  COVER FORD C-3T OR EQUAL	FORD F1000-7 FORD FB1000-7	FORD C44-77 MUELLER P 15403 MCDONALD 4758-22

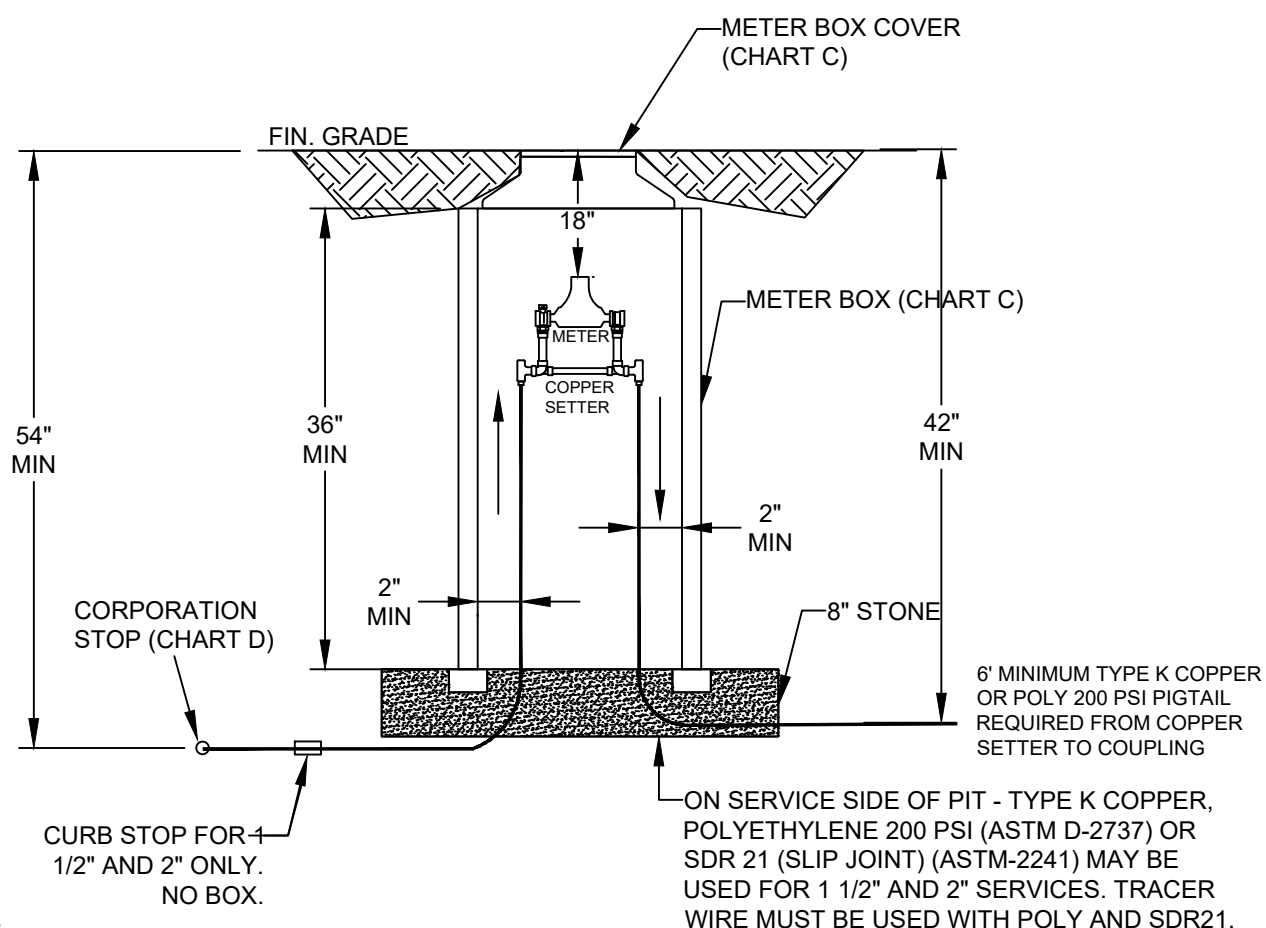

**NOTE:**


1. BACK FLOW PREVENTER TO BE INSTALLED AHEAD OF ANY SPRINKLER BUT NOT IN METER PIT.

## METER BOX DETAIL FOR 1 1/2" AND 2" METERS

APPROVED/REVISED	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER
MARCH, 2018		<b>W-10B</b>

NOTES:

1. PRIVATE MAIN APPLICATION MUST BE ACCOMPANIED BY MAINTENANCE AGREEMENT IN PROPER FORM.
2. MULTIPLE SERVICES LINES ON SINGLE TAPS SHALL BE APPROVED BY THE COUNTY ON A CASE-BY-CASE BASIS.

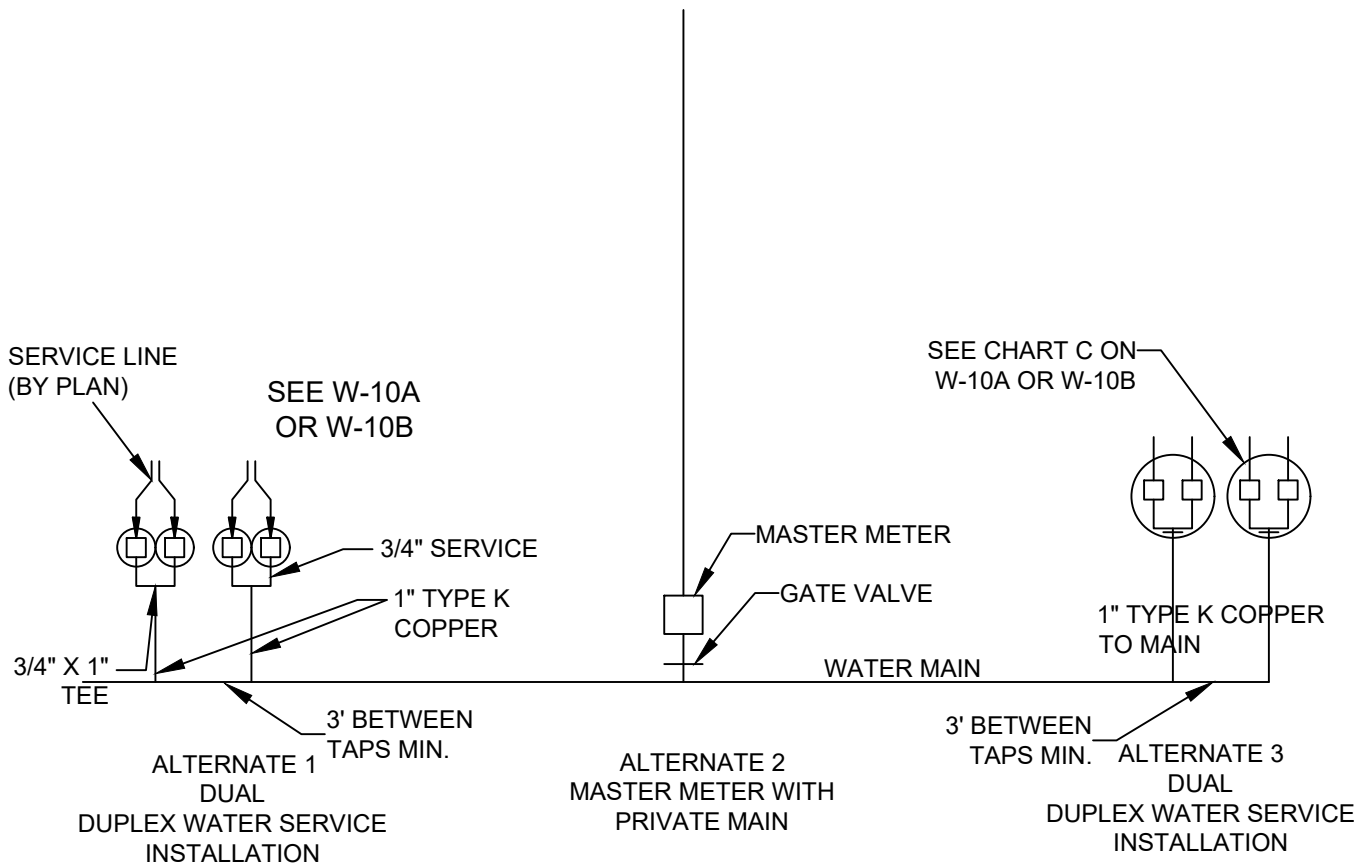

(TYPICAL LAYOUT)  
WATER METER SEE W-10A, W-10B, W-14, W-15A AND W-15B

## MULTIPLE WATER SERVICE CONNECTIONS


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-11**

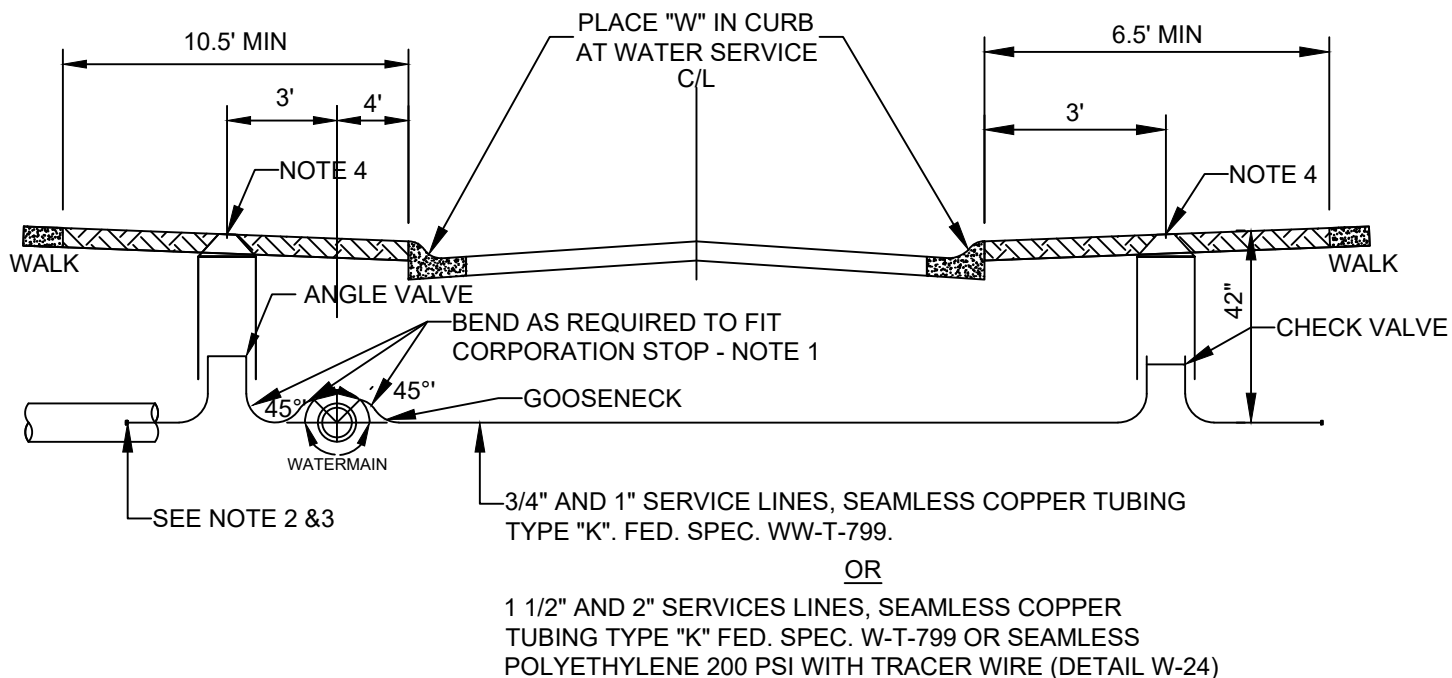

#### NOTES:

- 1) CORPORATION STOP TO BE CAST BRASS OR BRONZE. SEE W-10A OR W-10B.
- 2) ON THE SIDE OF THE ROAD WITH THE WATER MAIN, PLASTIC TUBING SHALL BE 20' +/- LONG AND EXTEND 23' BEHIND CURB TO CLEAR TELEPHONE AND ELECTRIC EASEMENTS.
- 3) CONTRACTOR SHALL PLACE 2"X4" OR LARGER POSTS, PAINTED BLUE AT BOTH ENDS OF PLASTIC CONDUIT.
- 4) CONTRACTOR SHALL INSTALL A REBAR 5' LONG VERTICALLY AT ANGLE VALVES.
- 5) WATER MAIN WITHIN 3' OF BACK OF CURB MUST HAVE CDF BACKFILL.

## TYPICAL WATER SYSTEM DETAIL

APPROVED/REVISED


MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-12**



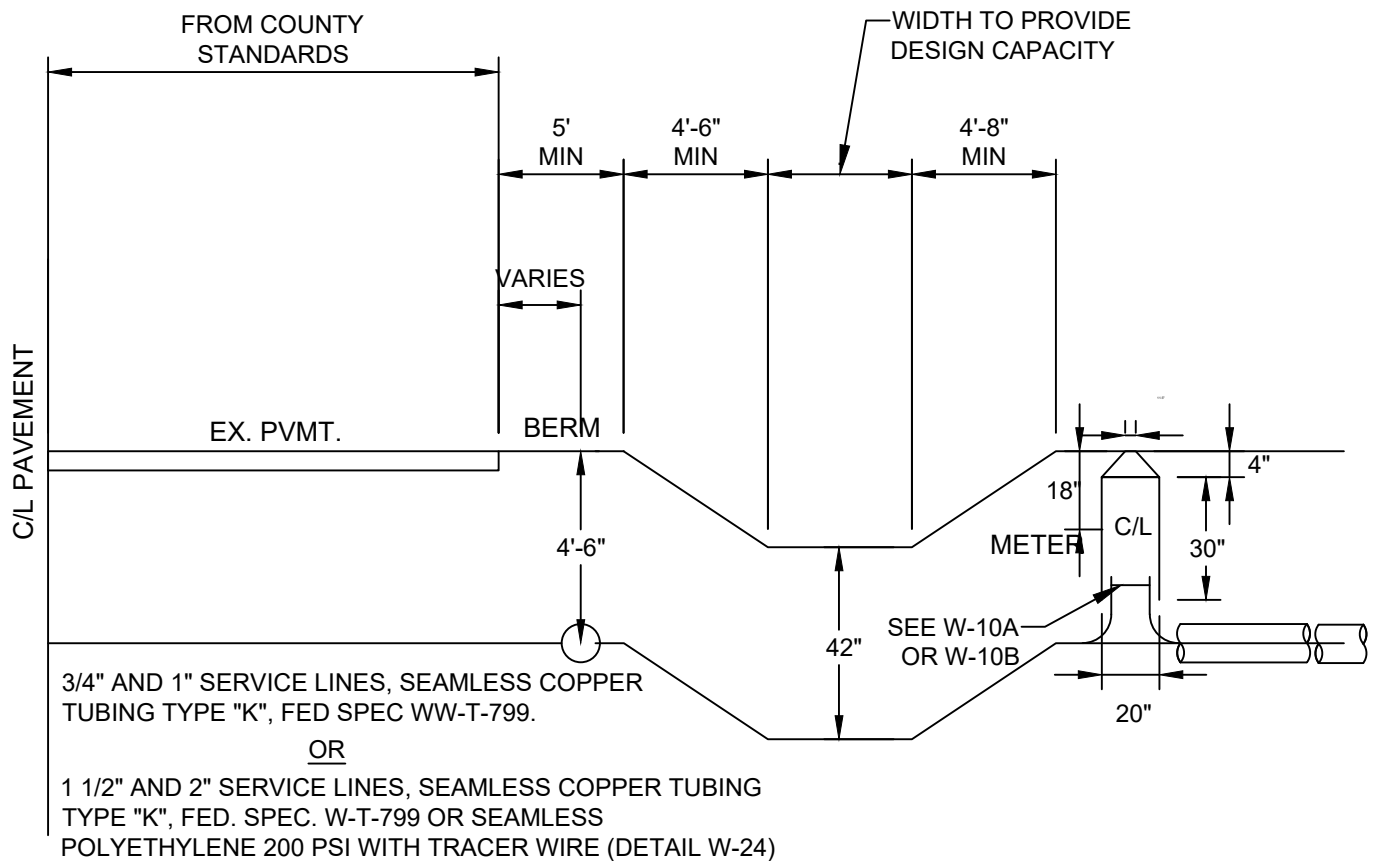

#### NOTES:

- 1) CORPORATION STOP TO BE CAST BRASS OR BRONZE. SEE W-10A OR W-10B.
- 2) PLASTIC CONDUIT (2" ID) SHALL BE 20' +/- LONG AND EXTEND A MINIMUM OF 2' INTO THE LOTS TO CLEAR UTILITY EASEMENTS.
- 3) CONTRACTOR SHALL PLACE 2"X4" OR LARGER POSTS, PAINTED BLUE AT BOTH ENDS OF PLASTIC CONDUIT.
- 4) CONTRACTOR SHALL INSTALL A REBAR 5' LONG VERTICALLY AT ANGLE VALVES.
- 5) WATER MAIN WITHIN 3' OF BACK OF CURB MUST HAVE CDF BACKFILL.

## DITCH AND METER LOCATION


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-13**

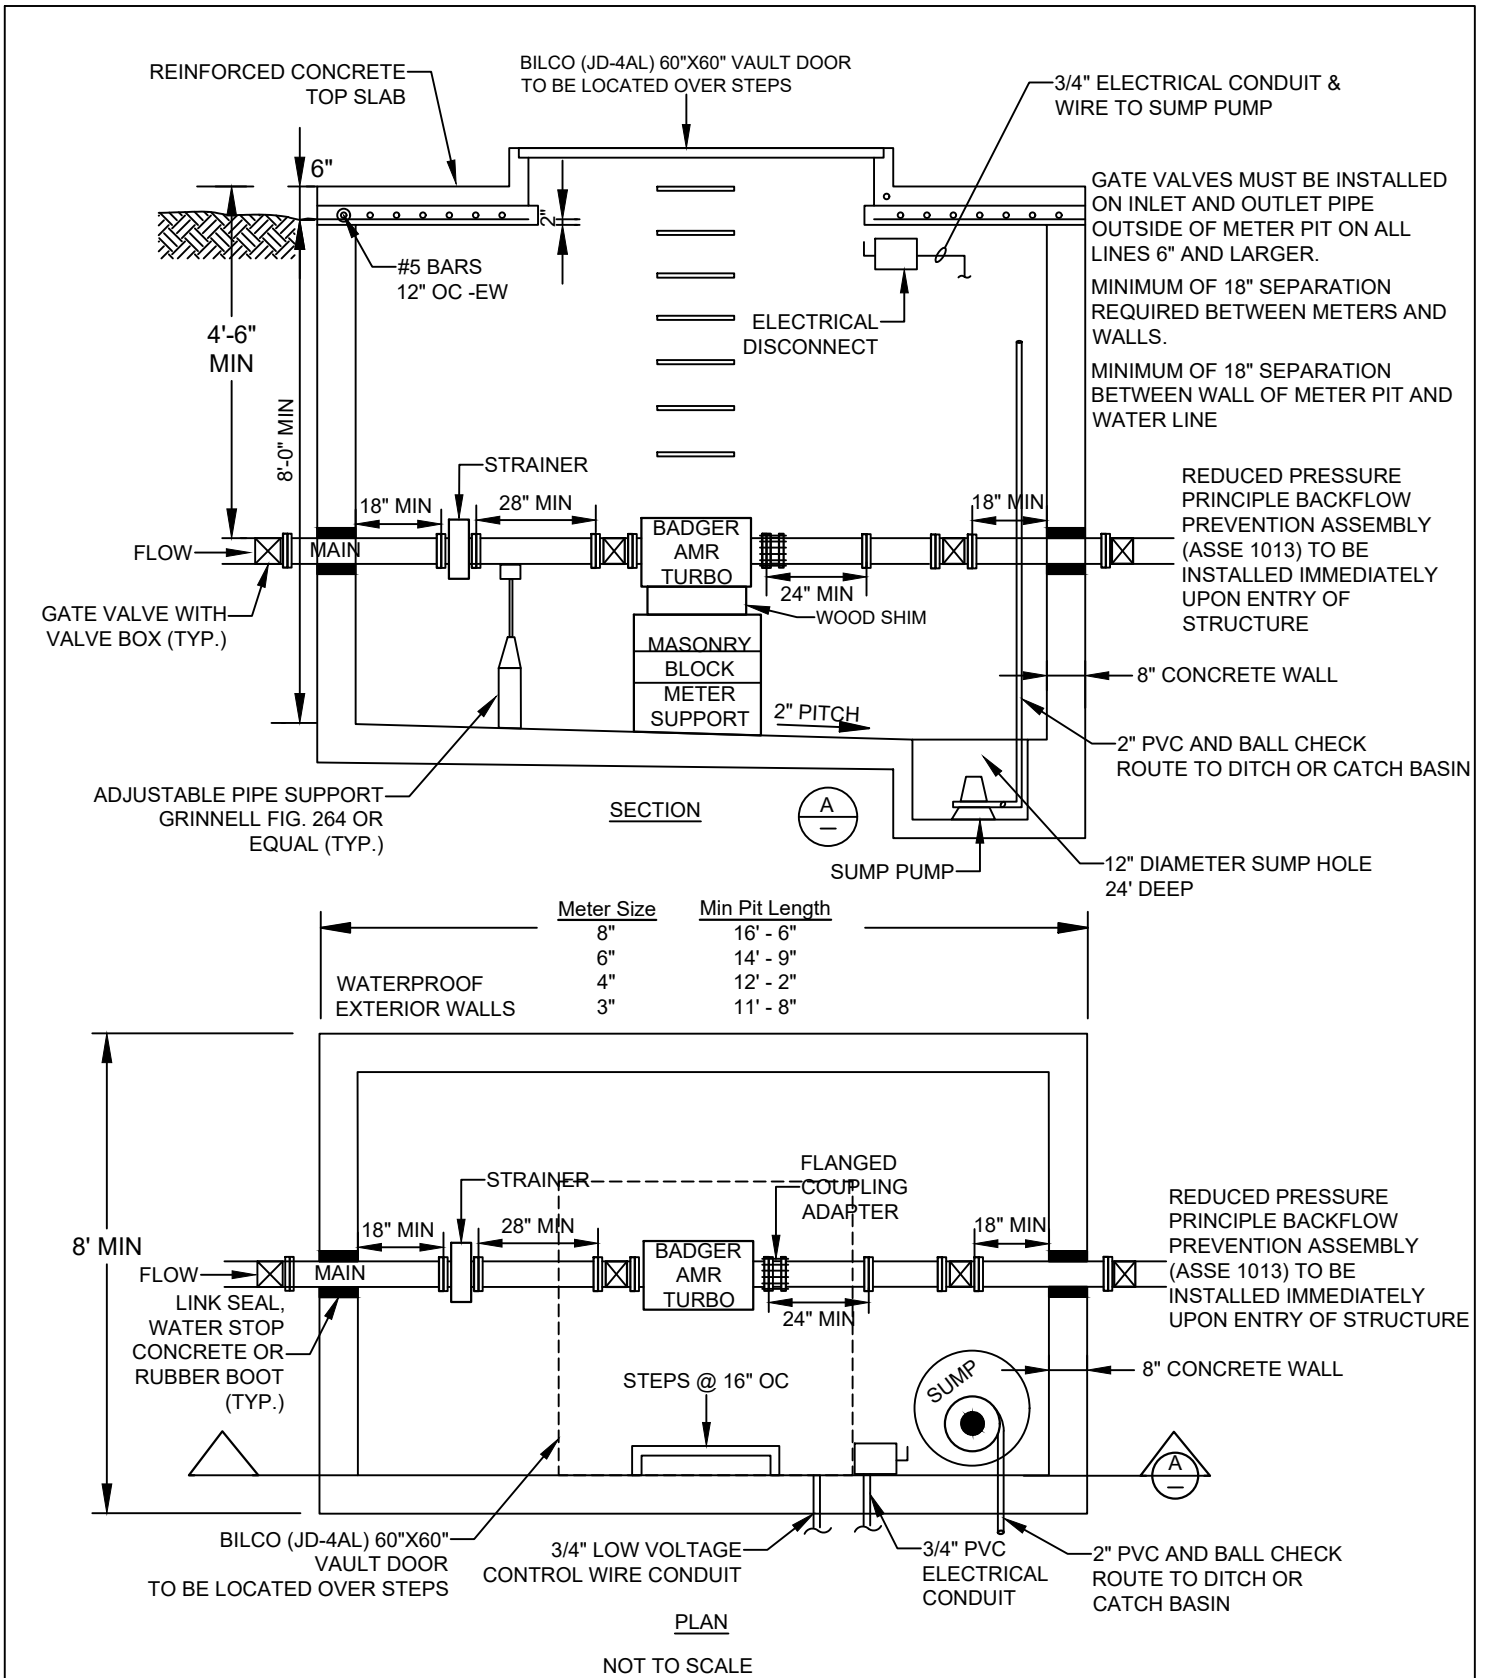

# LARGE DOMESTIC WATER METER PIT


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

W-14

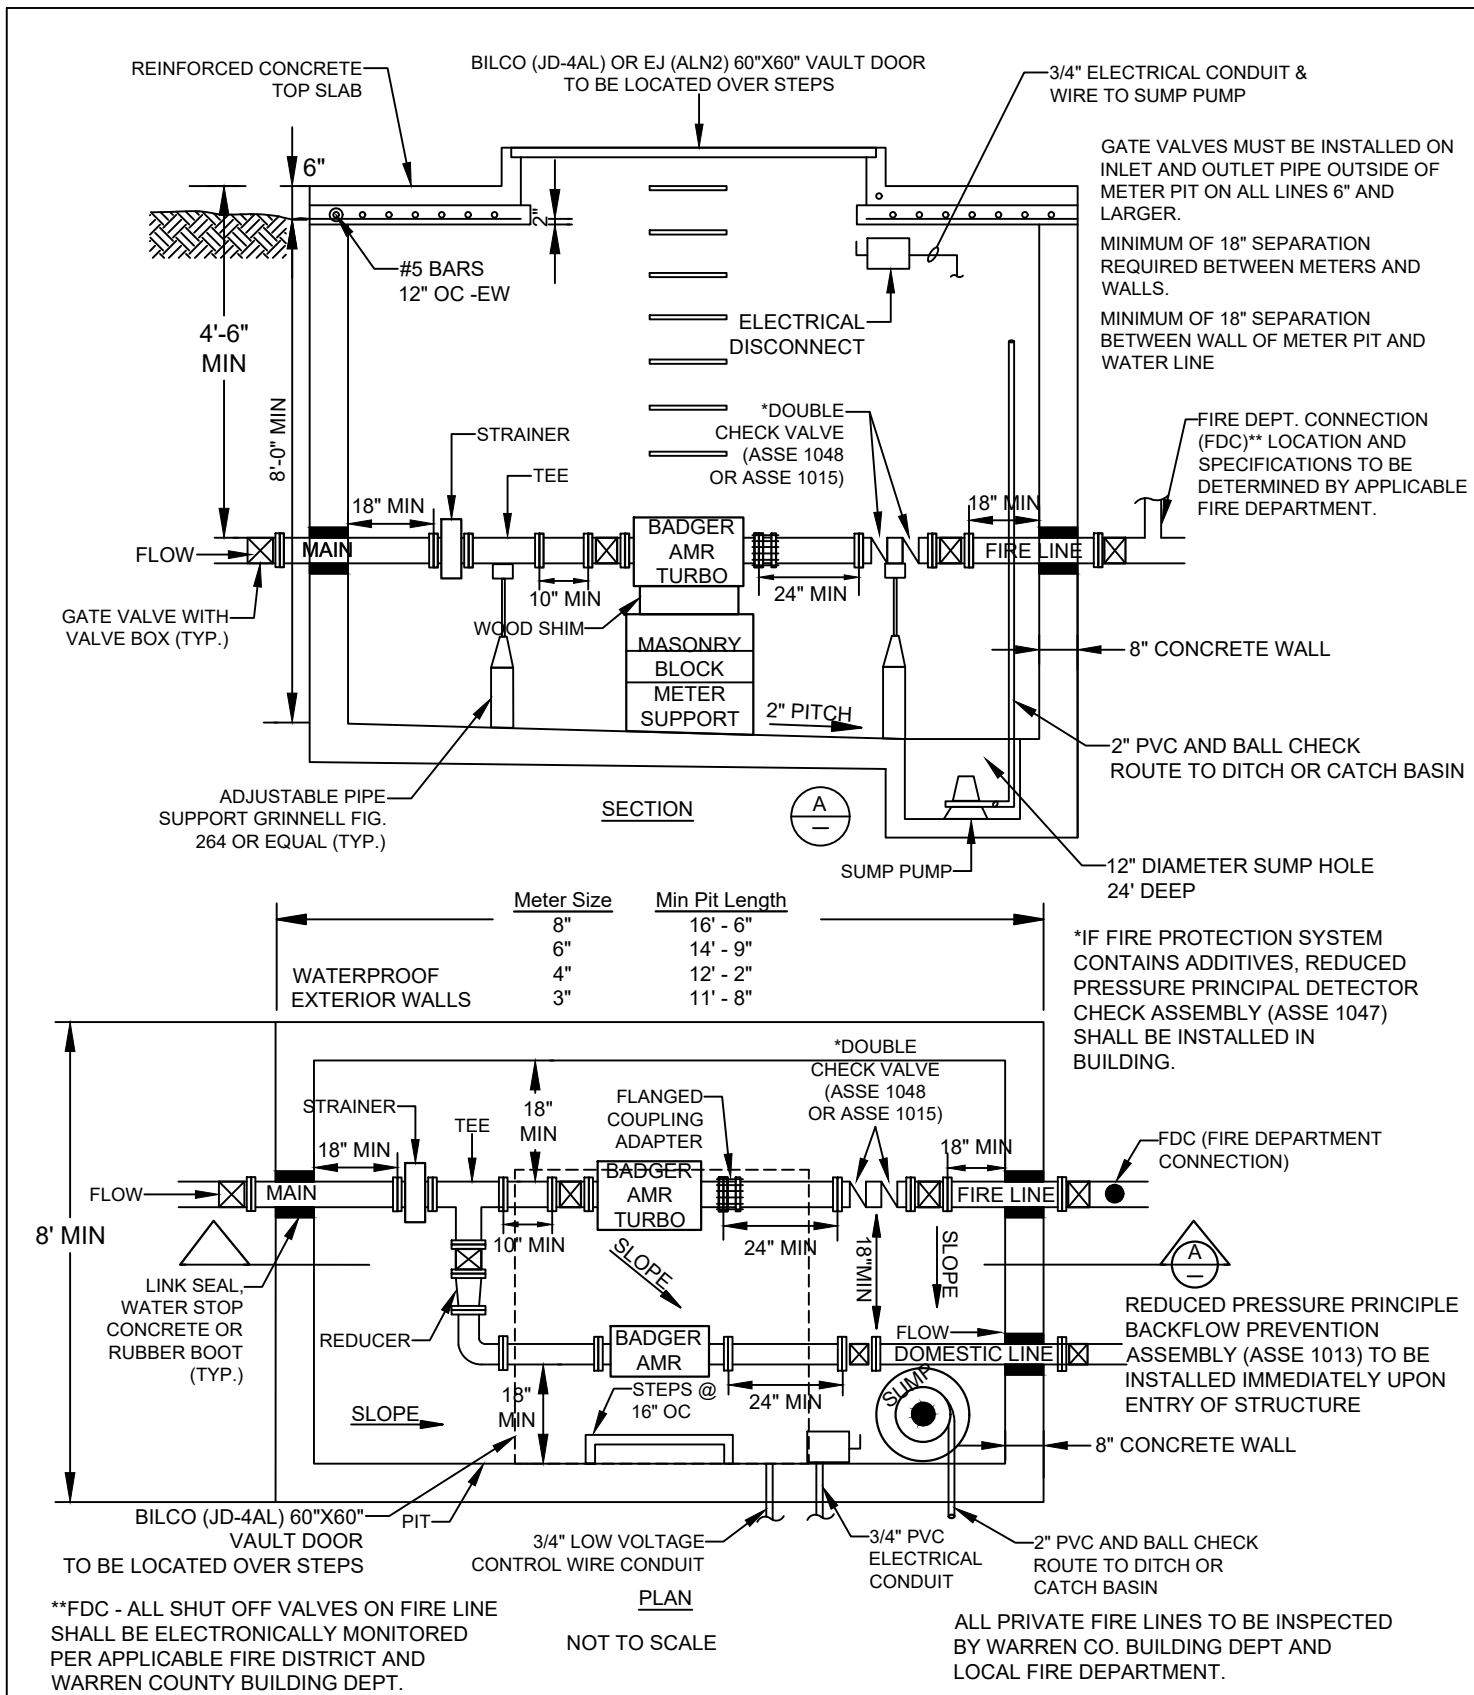

## LARGE WATER METER PIT W/ FIRE LINE W/ FDC & DOMESTIC LINE

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-15A**



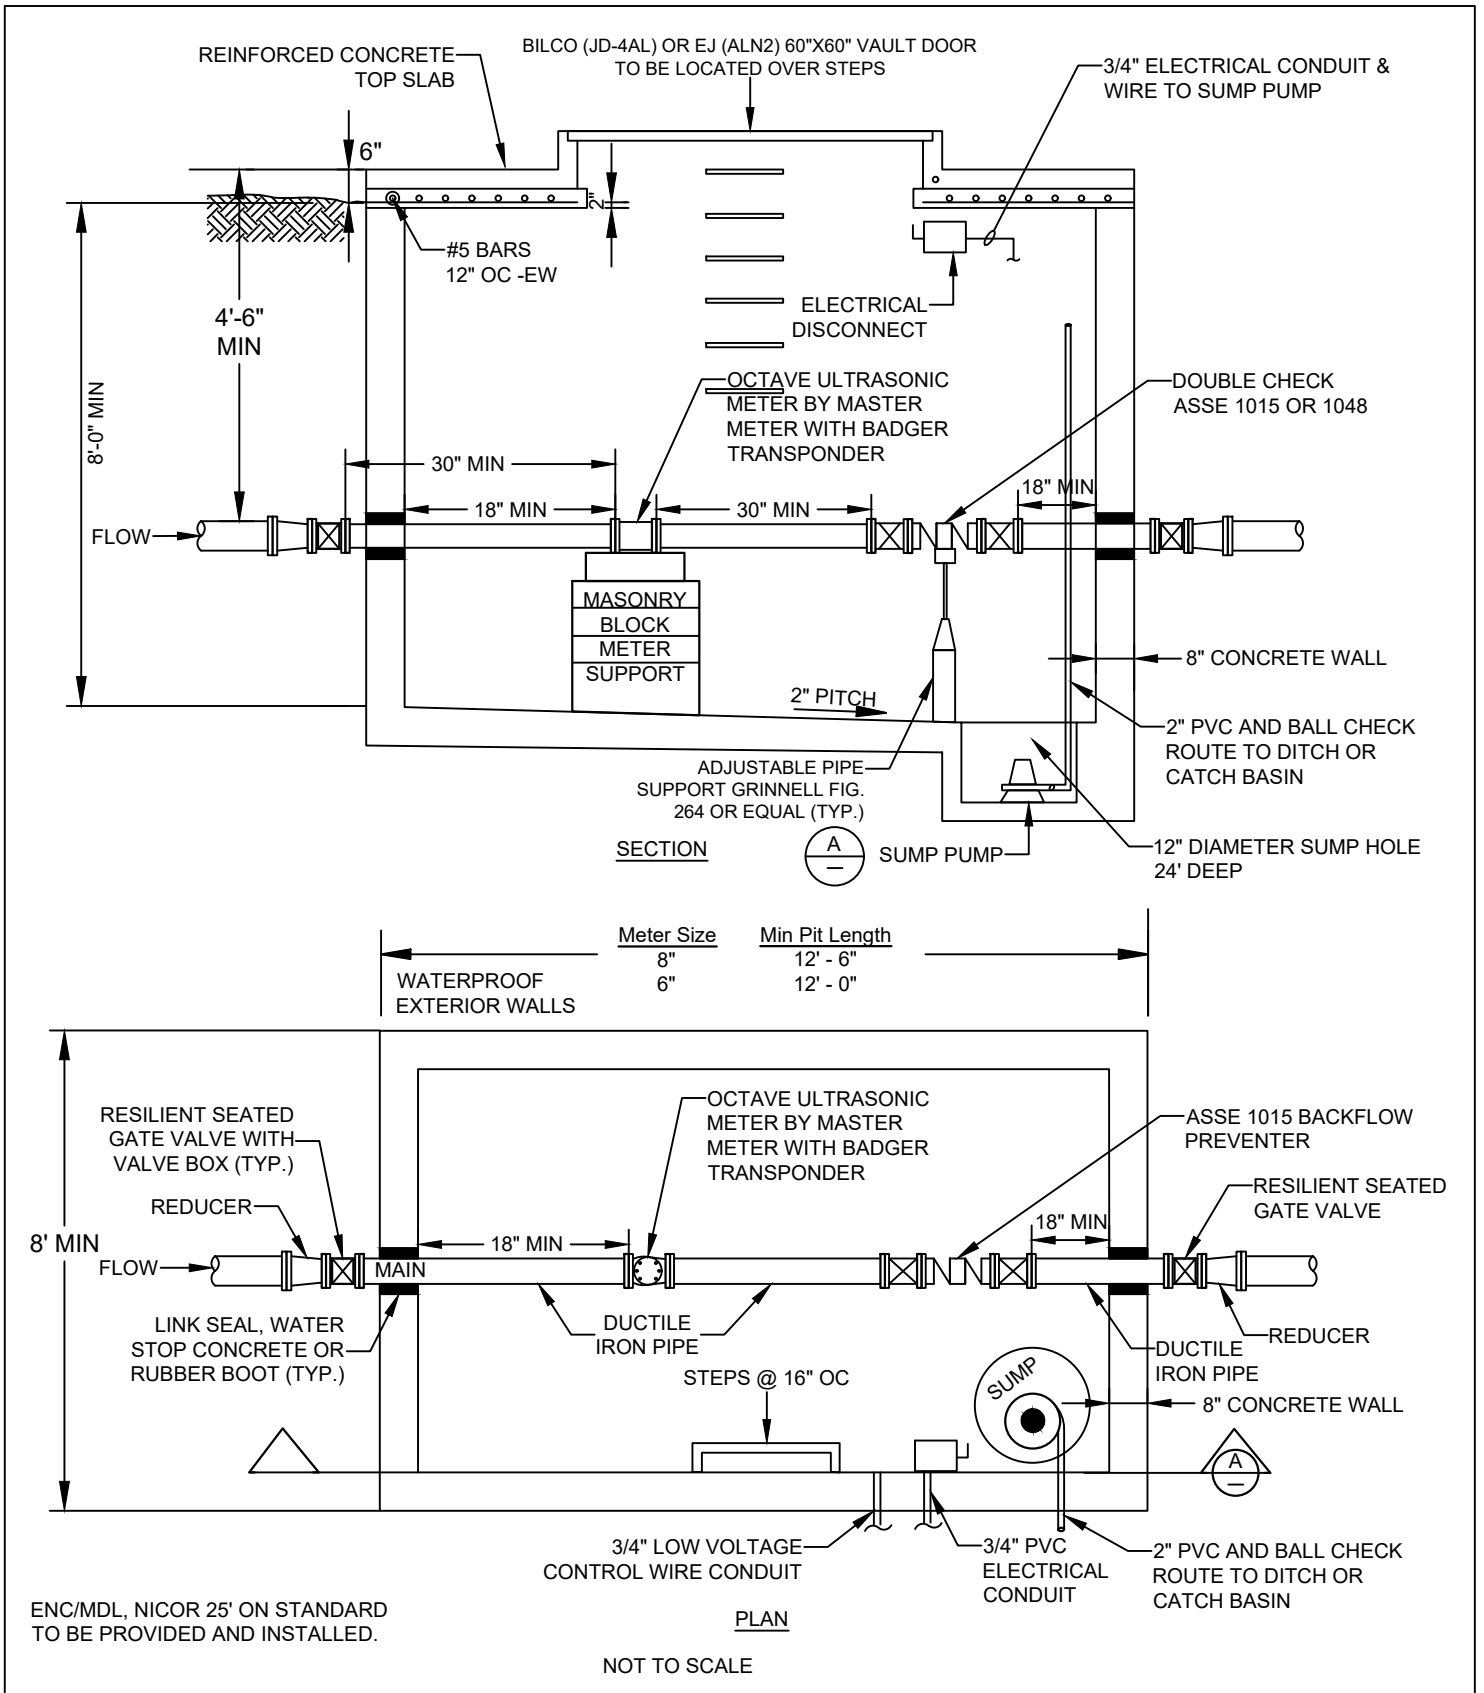

# COMBINATION FIRE/DOMESTIC METER PIT

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

W-15C

GATE VALVES - AWWA RESILIENT SEATED WITH CAST IRON BODY, BRONZE MOUNTED, FLANGED CONNECTIONS, NONRISING STEM, FUSION EPOXY COATING, 400 PSI HYDROSTATIC RATED.

FLANGED COUPLING

ADAPTORS - FLANGED ADAPTOR CONNECTIONS FOR PLAIN END PIPE AT FITTINGS AND VALVES SHALL BE DRESSER STYLE 127 OR 128, OR EQUAL.

VAULT DOOR - 60" X 60" DOUBLE LEAF ALUMINUM DIAMOND PLATE WITH HOLD OPEN ARM LOCKS. GREEN SPACE AREA HATCHES RATED FOR 300 PSF. TRAFFIC AREAS SHALL BE AASHTO H-20. DOORS SHALL BE JD-4AL, JD-4AL H20 BY BILCO, EJ ALN2, OR EQUAL.

STRAINER - STRAINERS 6" OR SMALLER MUST BE BADGER BRONZE PLATE STRAINERS OR EQUAL. SCREENS MUST BE MADE OF NON-CORROSIVE 316 STAINLESS STEEL WITH 3/16" OR 1/4" PERFORATIONS. STRAINERS 8" OR LARGER MUST BE BADGER MODEL ML-MS PLATE STRAINERS OR EQUAL. SCREENS MUST BE MADE OF NON-CORROSIVE STAINLESS STEEL.

SUMP PUMP - SUBMERSIBLE PUMP WITH AUTOMATIC LEVEL CONTROL, 115V SINGLE PHASE, DISCHARGE 25 - 30 GPM AT 10 FT TDH. SUMP PUMP OPERATION AND MAINTENANCE IS THE RESPONSIBILITY OF THE OWNER.

PIPING - ALL PIPING 3" AND LARGER SHALL BE CLASS 52 DUCTILE IRON WITH FLANGED FITTINGS. PIPING SMALLER THAN 3" SHALL BE THREADED STEEL. DOMESTIC AND SPRINKLER LINES SHALL BE TYPE K COPPER THROUGH THE VAULT.

BACKFLOW

PREVENTER - FIRE: ASSE 1048 DOUBLE CHECK DETECTOR OR ASSE 1015 DOUBLE CHECK VALVE. ASSE 1047 REDUCED PRESSURE PRINCIPLE DETECTOR IF ADDITIVES IN SYSTEM. ASSE 1047 TO BE INSTALLED IN THE BUILDING.

1. ASSE 1015 & 1048 AND NSF/ANSI 61 APPROVED MODELS:

A. ZURN WILKINS, MODEL 350, 350A, 250AST, 250DA, 250ADA, 350ASTDA, 450, OR 450 DA.

B. WATTS, SERIES 757, 757N, LF709, 774, LF757DCDA, LF757NDCDA, OR 774DCDA.

2. ASSE 1047 AND NSF/ANSI 61 APPROVED MODELS:

A. ZURN WILKINS MODEL 375DA, 375ADA, 374ASTDA, 475DA, OR 475 DAN.  
WATTS, SERIES 909RPDA, 994RPDA, OR LF957RPDA.

DOMESTIC: ASSE 1013 REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY INSTALLED IMMEDIATELY UPON ENTRY OF STRUCTURE.

IRRIGATION: ASSE 1013 REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY INSTALLED IMMEDIATELY UPON ENTRY OF STRUCTURE AND BEFORE ANY SPRINKLERS.

THE OPERATION AND MAINTENANCE OF ALL BACKFLOW PREVENTERS IS THE RESPONSIBILITY OF THE PROPERTY OWNER.

## LARGE WATER METER PIT EQUIPMENT SCHEDULE



APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-15D**

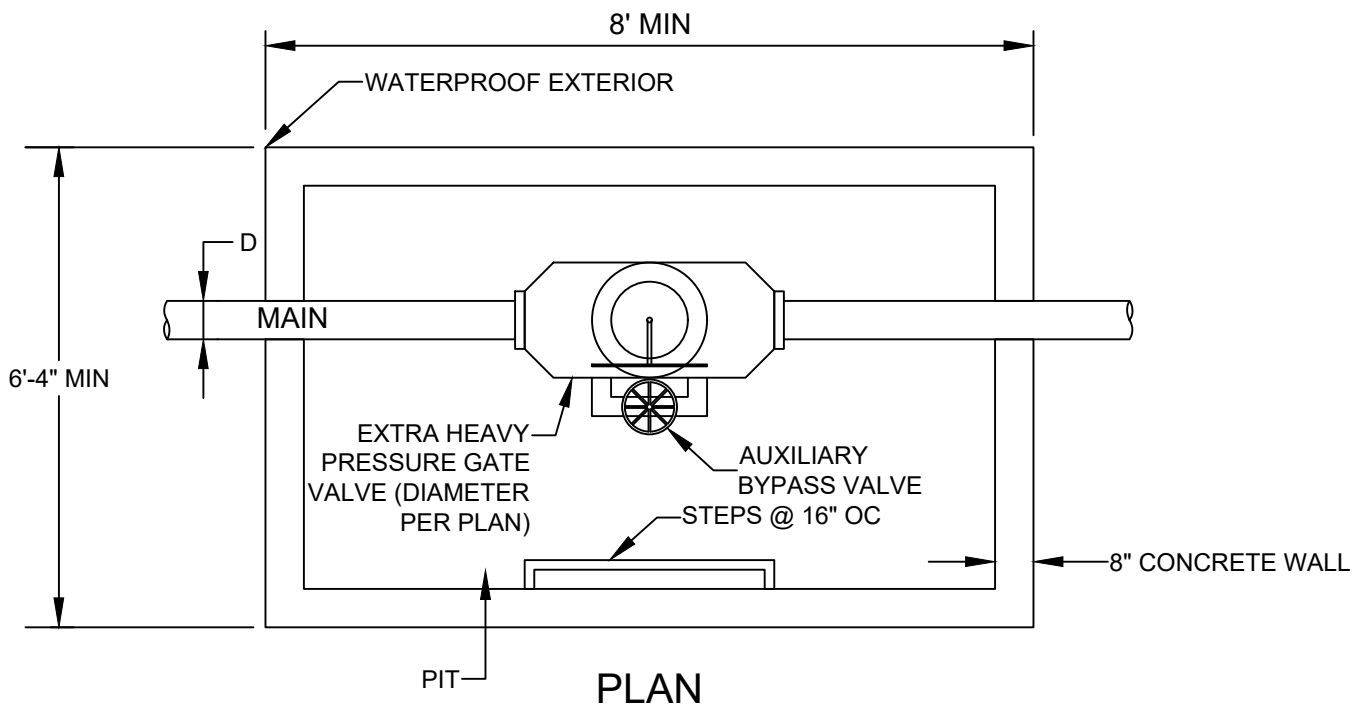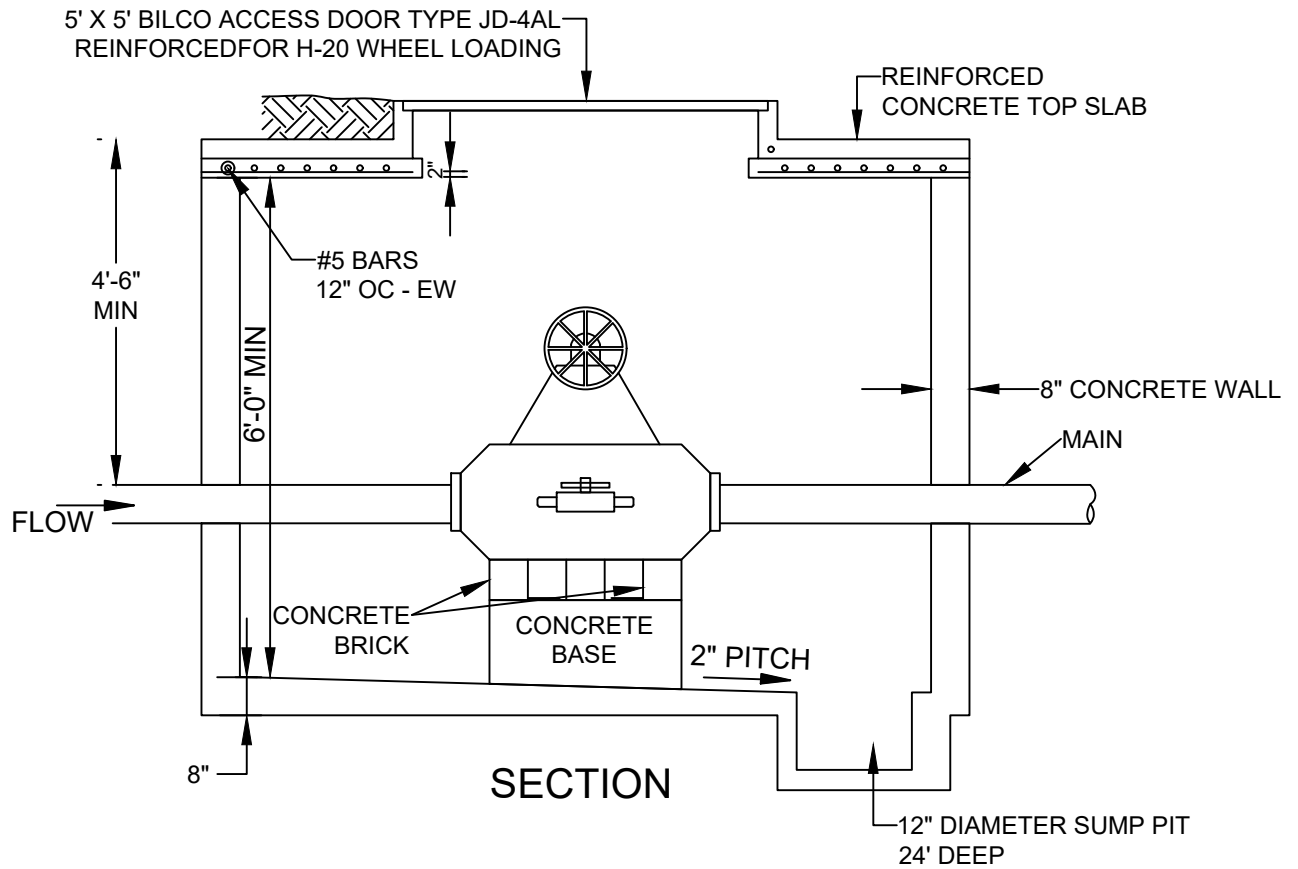


## VALVE PIT

APPROVED/REVISED  
MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER  
**W-16**

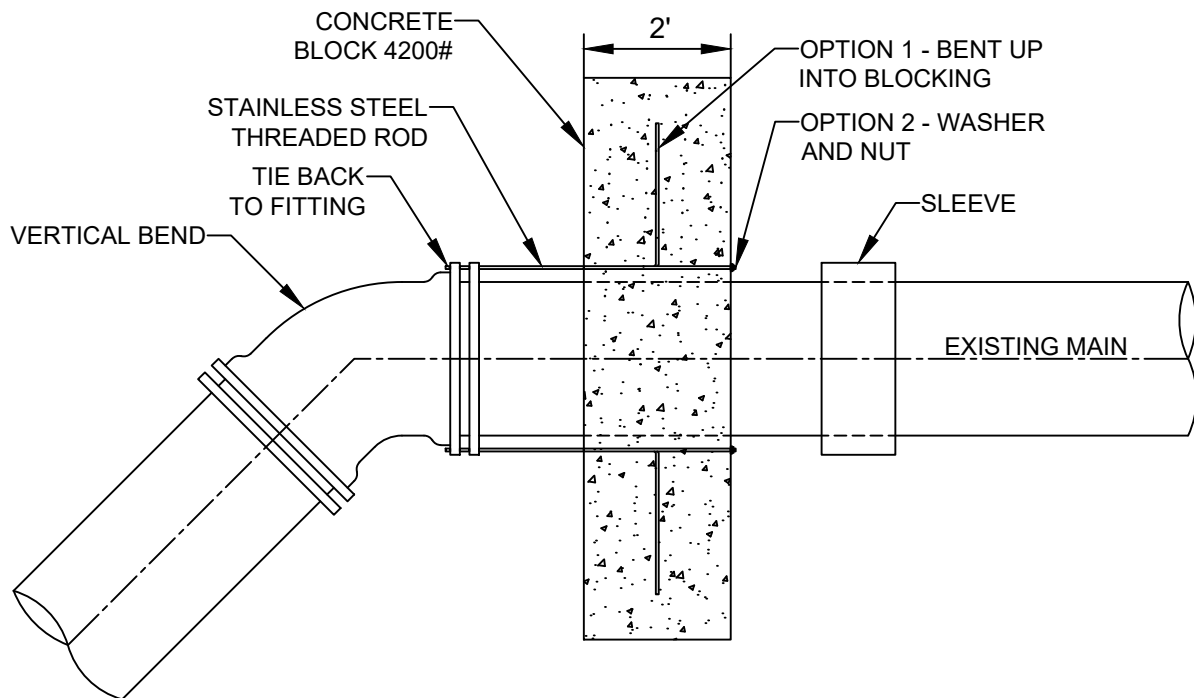

## VERTICAL BEND RESTRAINT - BLOCK DETAIL

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-17**



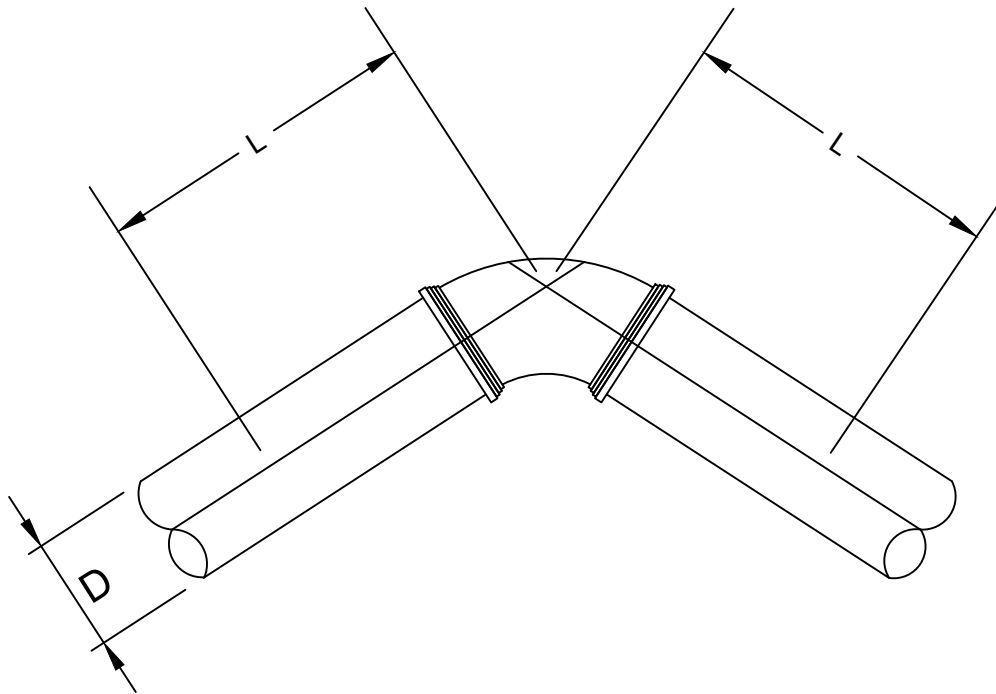

MINIMUM 60' OF RESTRAINED JOINT PIPE (RJP) IS REQUIRED BEFORE AND AFTER ALL HORIZONTAL AND VERTICAL BENDS. REFER TO TABLE BELOW.

**RESTRAINT OPTIONS:**

MECHANICAL JOINT W/MEGALUGS ~ ALL SIZES OF PIPE

US TR FLEX OR AMERICAN FLEX RING ~ ALL SIZES OF PIPE

MJ FIELD LOCKS ~ < 24" PIPE

TABLE  
REQUIRED LENGTH OF RESTRAINED JOINTS  
D - DIAMETER OF PIPE  
L - LENGTH OF PIPE

D	4"	6"	8"	10"	12"	16"	20"	24"
L	60'	60'	60'	60'	66'	98'	125'	145'

**NOTES:**

1. ALL HORIZONTAL AND VERTICAL BENDS SHALL BE LABELED WITH STATIONING.
2. LABEL LIMITS OF REQUIRED RESTRAINED JOINTS WITH STATIONING.

## REQUIRED RESTRAINED JOINTS FOR BENDS


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-18**

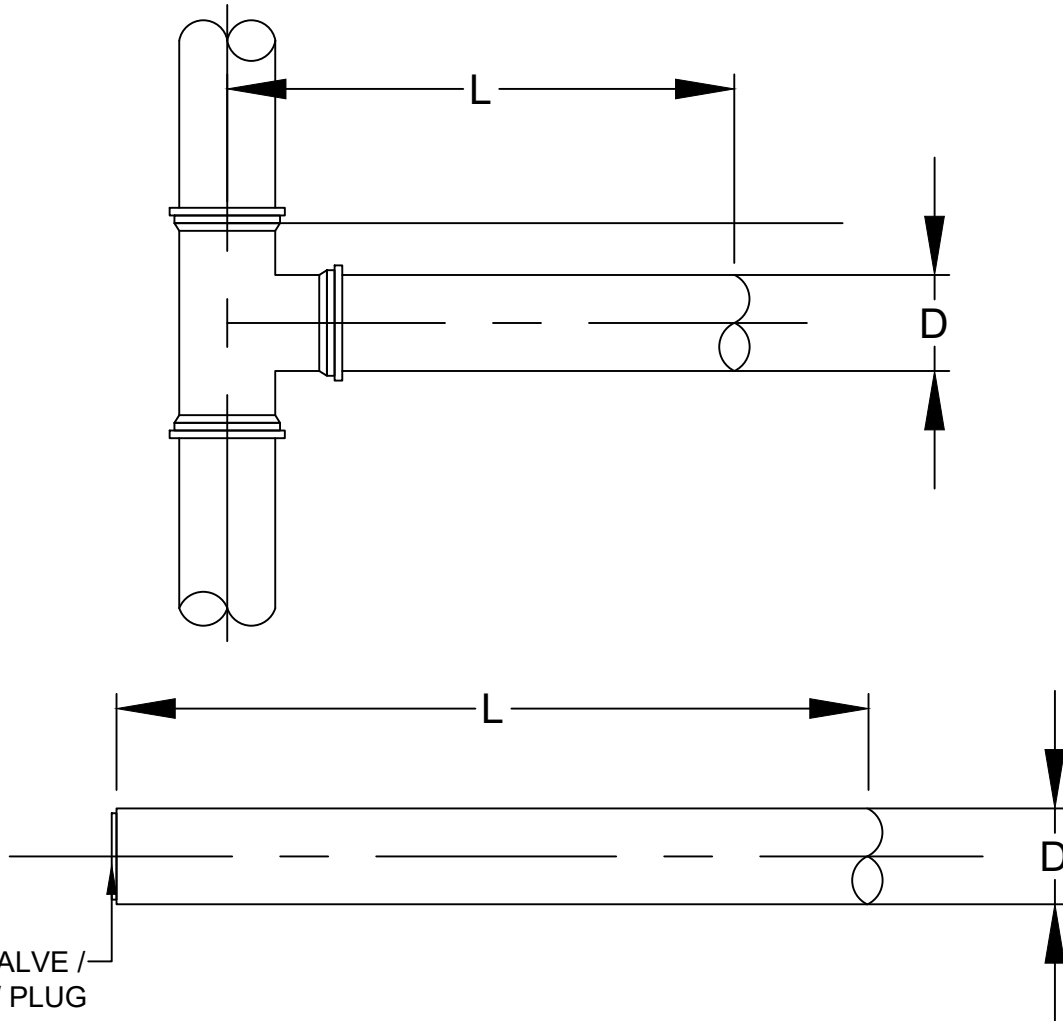

MINIMUM 60' OF RESTRAINED JOINT PIPE (RJP) IS REQUIRED BEFORE AND AFTER ALL HORIZONTAL AND VERTICAL BENDS. REFER TO TABLE BELOW.

**RESTRAINT OPTIONS:**

MECHANICAL JOINT W/MEGALUGS ~ ALL SIZES OF PIPE  
US TR FLEX OR AMERICAN FLEX RING ~ ALL SIZES OF PIPE  
MJ FIELD LOCKS ~ < 24" PIPE

TABLE  
REQUIRED LENGTH OF RESTRAINED JOINTS  
D - DIAMETER OF PIPE  
L - LENGTH OF PIPE

D	4"	6"	8"	10"	12"	16"	20"	24"
L	60'	60'	60'	60'	66'	98'	125'	145'

**NOTES:**

- ALL DEAD END VALVES, PLUGS, CAPS AND TEES SHALL BE LABELED WITH STATIONING.
- LABEL LIMITS OF REQUIRED RESTRAINED JOINTS WITH STATIONING.

**REQUIRED RESTRAINED JOINTS - DEAD END VALVES  
PLUGS, CAPS & TEES**


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-19**

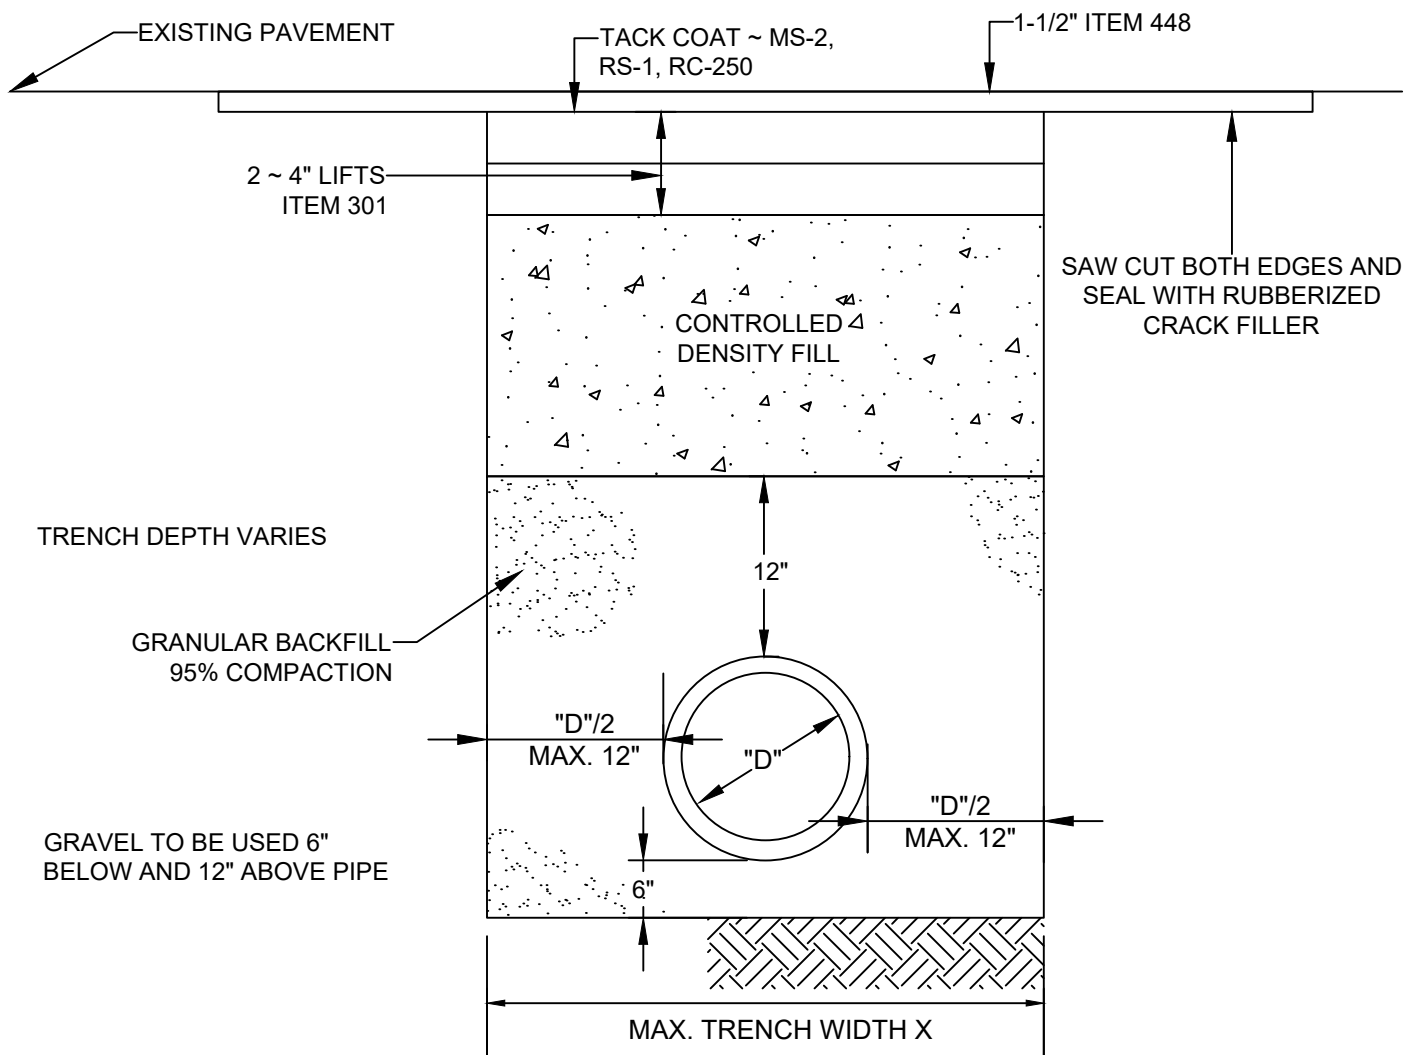

**NOTES:**

1. ALL DIMENSIONS ARE MINIMUM - ACTUAL TO BE PER COUNTY ENGINEER OR ODOT INSTRUCTIONS & PERMIT.
2. TRAFFIC MUST BE MAINTAINED AT ALL TIMES; LIGHTS, SIGNS, BARRICADES AND IF NECESSARY, FLAGMAN AN WATCHMEN TO BE ON JOB FOR PROTECTION OF THE PUBLIC. STREET PLATES MUST CONFORM TO COUNTY ENGINEER OR ODOT REQUIREMENTS.
3. FLASHFILL OR CONTROLLED DENSITY FILL TO A MINIMUM DISTANCE OF 5 FEET BEYOND THE EDGE OF PAVEMENT. TRENCH BACKFILL AND PAVEMENT RESTORATION MUST CONFORM TO THE APPLICABLE WARREN COUNTY ENGINEER OR ODOT SPECIFICATIONS.
4. EXISTING PAVEMENT AND EDGES SHALL BE NEATLY AND SQUARELY TRIMMED AND/OR MILLED. PAVEMENT MUST MATCH EXISTING ROAD THICKNESS OR AS SPECIFIED BY COUNTY ENGINEER OR ODOT.

**ROAD PAVEMENT CUT AND RESTORATION AT  
ROADWAY CROSSING**


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-20**

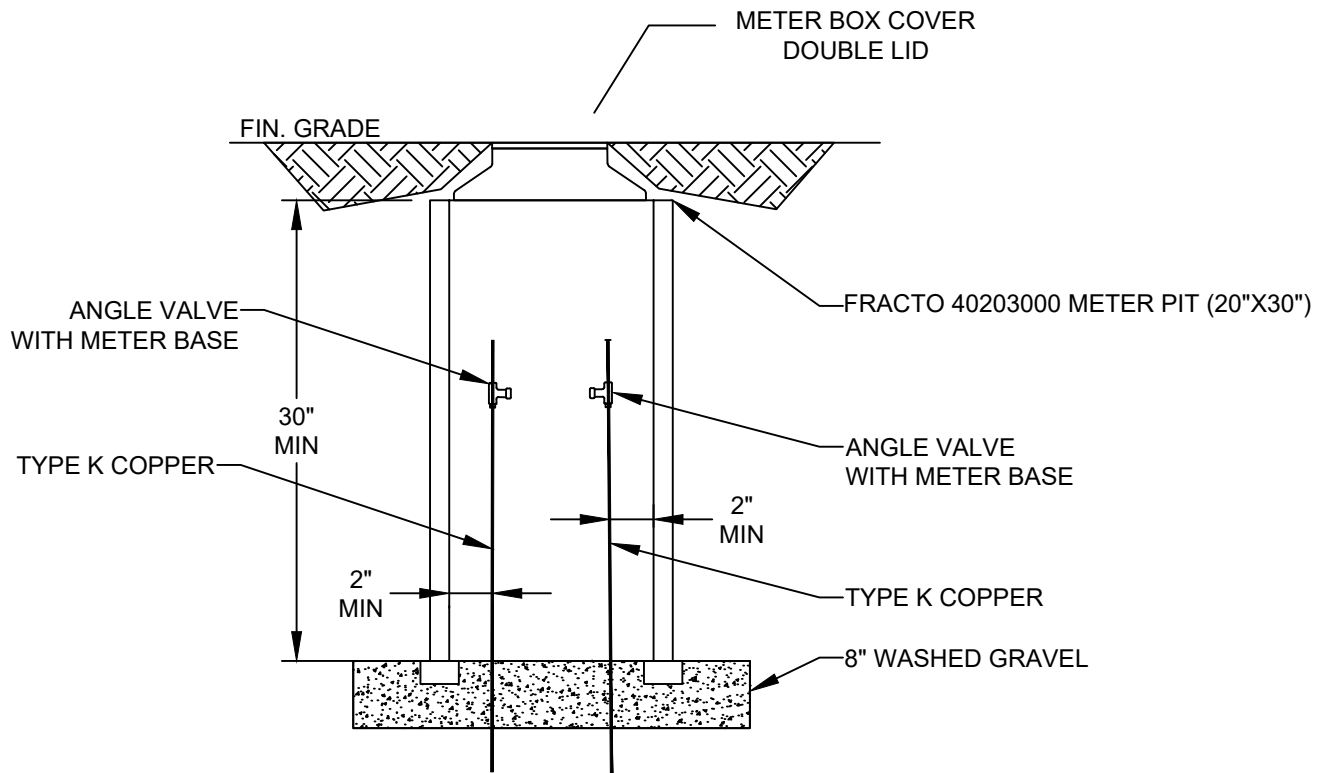

**NOTE:**

CONNECT ON BOTH SIDES OF MAIN LINE GATE VALVE WITH 3/4" TYPE K COPPER CORP STOPS. INSTALL METER PIT & LID WITH 3/4" TYPE K COPPER LINES A MINIMUM OF 18" BELOW METER LID. ONE (1) ANGLE VALVE WITH METER BASE SHALL BE INSTALLED ON BOTH LINES.

## METER TEST PIT AT CREEK CROSSING


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-21**

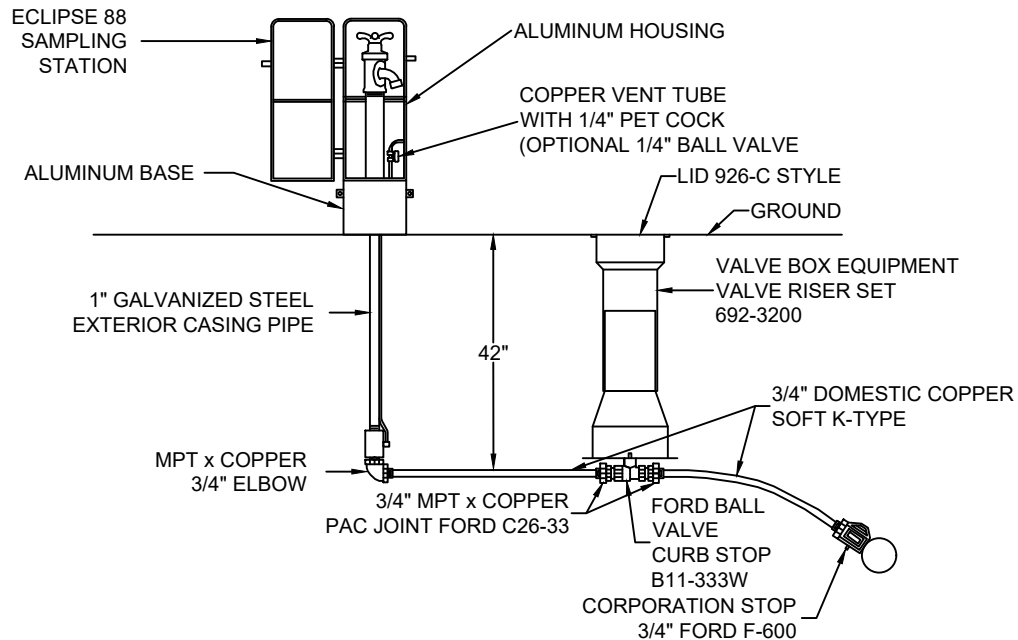

SAMPLING STATION TO BE REQUIRED ON EVERY NEW PLATTED SUBDIVISION.

SAMPLING STATIONS SHALL BE BURIED 42", WITH A 3/4" FIP INLET AND A (3/4" HOSE OR UNTHREADED) NOZZLE.

ALL STATIONS SHALL BE ENCLOSED IN A LOCKABLE, NONREMOVABLE, ALUMINUM CAST HOUSING.

WHEN OPENED, THE STATION SHALL REQUIRE NO KEY FOR OPERATION, AND THE WATER WILL FLOW IN AN ALL BRASS WATERWAY.

ALL WORKING PARTS WILL ALSO BE OF BRASS AND BE REMOVABLE FROM ABOVE GROUND WITH NO DIGGING. EXTERIOR PIPING SHALL BE BRASS OR GALVANIZED.

A COPPER VENT TUBE WILL ENABLE EACH STATION TO BE PUMPED FREE OF STANDING WATER TO PREVENT FREEZING AND TO MINIMIZE BACTERIA GROWTH.

ECLIPSE NO. #88 SAMPLING STATION SHALL BE MAUFACTURED BY KUPFERIA FOUNDRY, ST LOUIS, MO 63102.

## SAMPLING STATION


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-22**

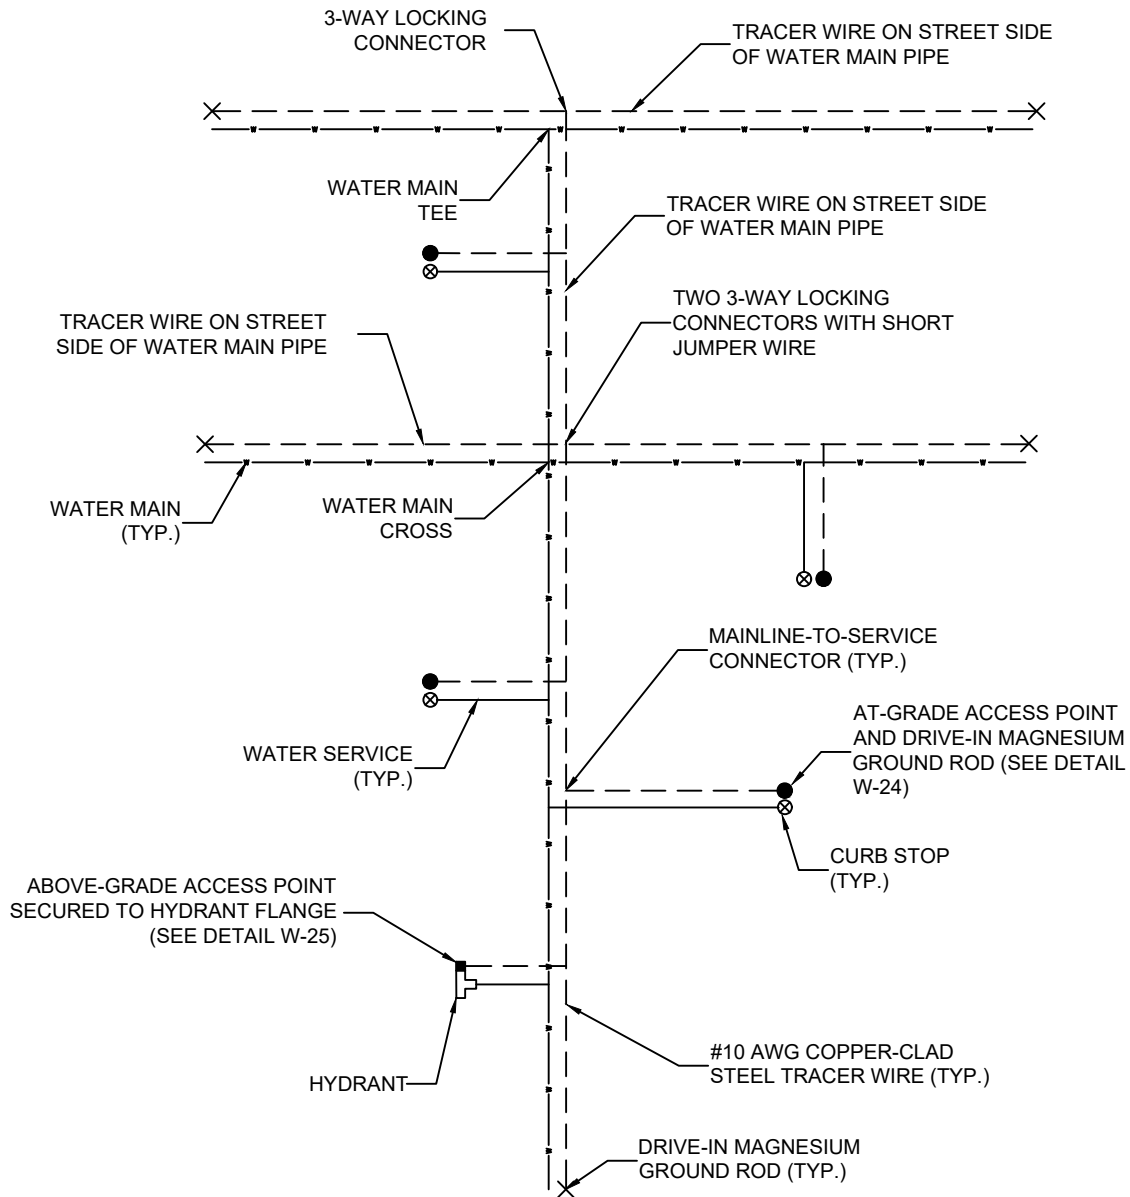

**NOTES:**

1. WIRE SHOWN AWAY FROM PIPE FOR CLARITY.
2. WIRE SHALL BE INSTALLED ON THE BOTTOM SIDE OF THE PIPE BELOW THE SPRING LING.
3. THE WIRE SHALL BE FASTENED TO THE PIPE WITH TAPE OR PLASTIC TIES AT 5' INTERVALS.
4. TRACER WIRE SHALL BE COPPERHEAD INDUSTRIES, PART NO. 1030B-HS, OR EQUAL.
5. AT-GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. RB14B2T-SW, OR EQUAL.
6. ABOVE GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. T2-B-FLPKG, OR EQUAL.
7. 3-WAY LOCKING CONNECTORS SHALL BE COPPERHEAD INDUSTRIES, PART NO. LSC1030C, OR EQUAL.
8. MAINLINE TO SERVICE CONNECTOR SHALL BE COPPERHEAD INDUSTRIES, PART NO. 3WB-01, OR EQUAL.

## TRACER WIRE - PLAN

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**W-23**

## WATER SERVICE - PLAN VIEW

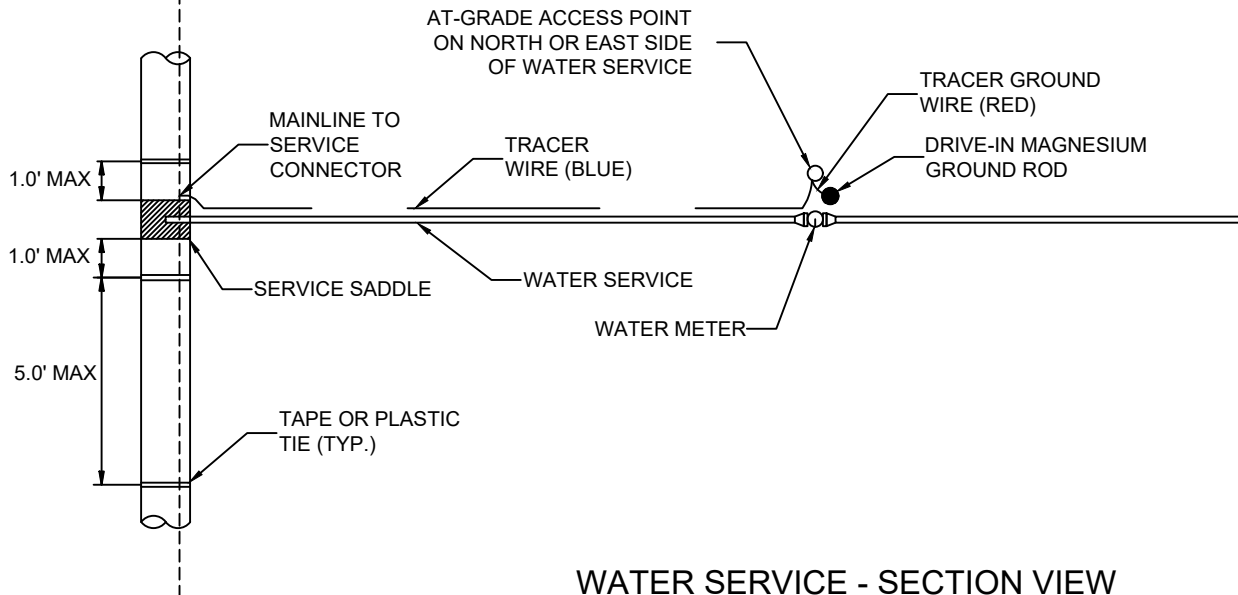

## WATER SERVICE - SECTION VIEW

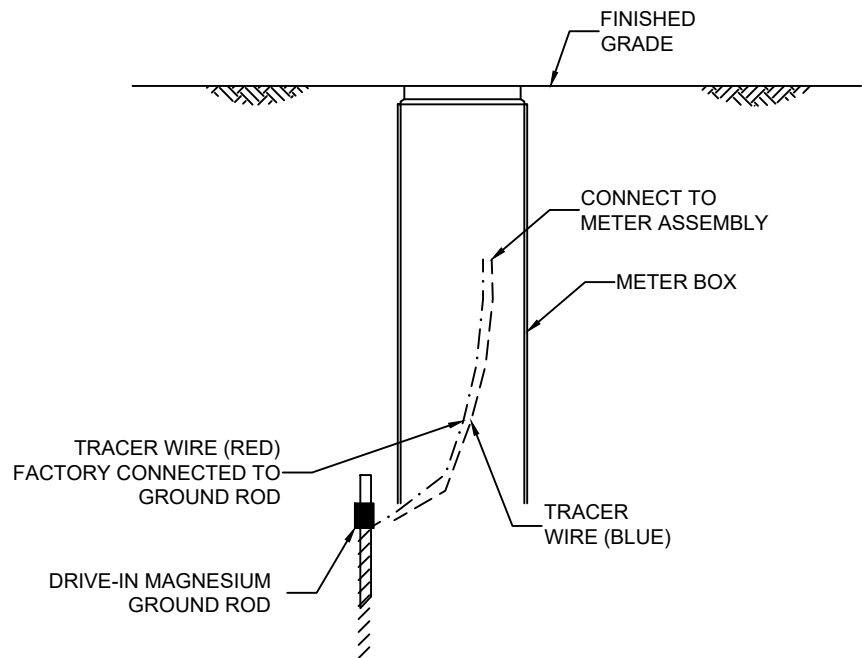

### NOTES:

1. WIRE SHOWN AWAY FROM PIPE FOR CLARITY.
2. WIRE SHALL BE INSTALLED ON THE BOTTOM SIDE OF THE PIPE BELOW THE SPRING LING.
3. THE WIRE SHALL BE FASTENED TO THE PIPE WITH TAPE OR PLASTIC TIES AT 5' INTERVALS.
4. TRACER WIRE SHALL BE COPPERHEAD INDUSTRIES, PART NO. 1030B-HS, OR EQUAL.
5. AT-GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. RB14B2T-SW, OR EQUAL.
6. ABOVE GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. T2-B-FLPKG, OR EQUAL.
7. 3-WAY LOCKING CONNECTORS SHALL BE COPPERHEAD INDUSTRIES, PART NO. LSC1030C, OR EQUAL.
8. MAINLINE TO SERVICE CONNECTOR SHALL BE COPPERHEAD INDUSTRIES, PART NO. 3WB-01, OR EQUAL.
9. GROUND ROD AND TRACER WIRE SHALL BE COPPERHEAD INDUSTRIES, PART NO. ANO-12, OR EQUAL.

## TRACER WIRE - WATER SERVICE PLAN

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

W-24

## HYDRANT - PLAN VIEW

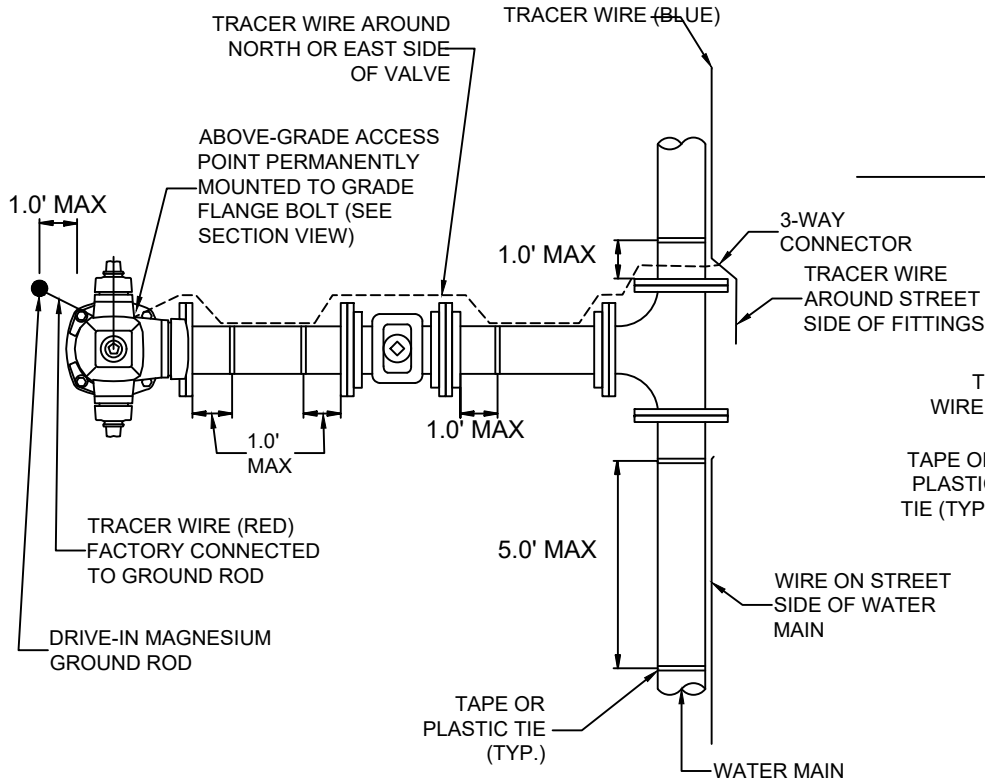

## HYDRANT - SECTION VIEW

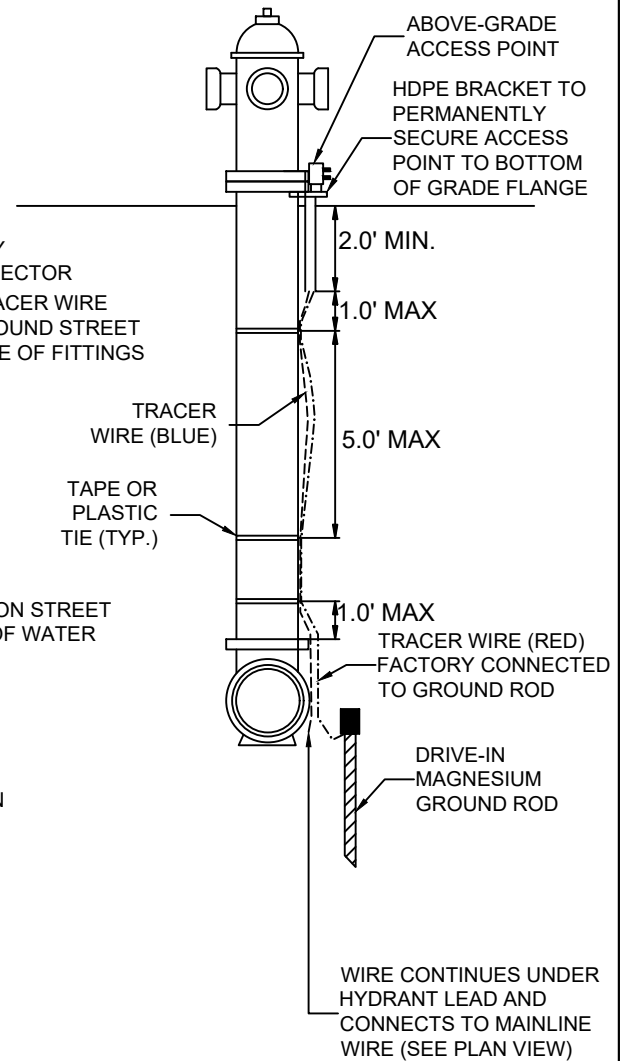

### NOTES:

1. WIRE SHOWN AWAY FROM PIPE FOR CLARITY.
2. WIRE SHALL BE INSTALLED ON THE BOTTOM SIDE OF THE PIPE BELOW THE SPRING LING.
3. THE WIRE SHALL BE FASTENED TO THE PIPE WITH TAPE OR PLASTIC TIES AT 5' INTERVALS.
4. TRACER WIRE SHALL BE COPPERHEAD INDUSTRIES, PART NO. 1030B-HS, OR EQUAL.
5. AT-GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. RB14B2T-SW, OR EQUAL.
6. ABOVE GRADE ACCESS POINT SHALL BE COPPERHEAD INDUSTRIES, PART NO. T2-B-FLPKG, OR EQUAL.
7. 3-WAY LOCKING CONNECTORS SHALL BE COPPERHEAD INDUSTRIES, PART NO. LSC1030C, OR EQUAL.
8. MAINLINE TO SERVICE CONNECTOR SHALL BE COPPERHEAD INDUSTRIES, PART NO. 3WB-01, OR EQUAL.
9. GROUND ROD AND TRACER WIRE SHALL BE COPPERHEAD INDUSTRIES, PART NO. ANO-12, OR EQUAL.
10. FOR HYDRANT SETTING AND HYDRANT ARRANGEMENT SEE DETAILS W-8 AND W-9.

## TRACER WIRE - FIRE HYDRANT PLAN

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-25**



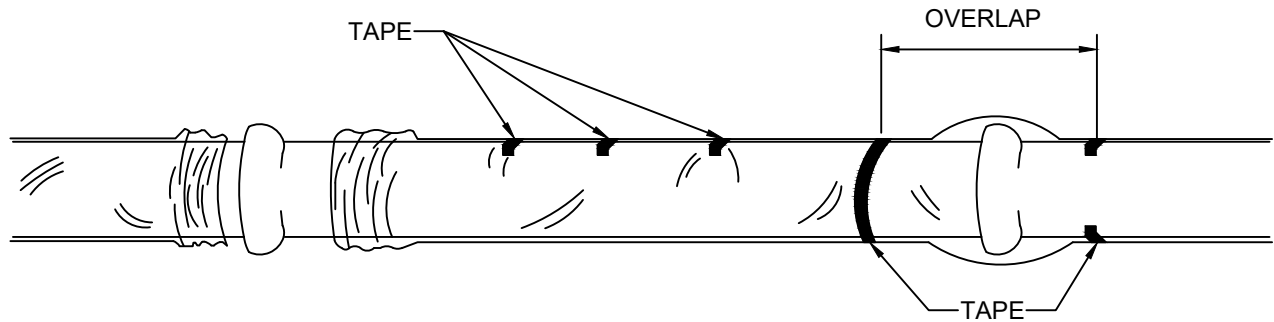

TUBE SIZE REQUIRED							
PIPE DIAMETER	4"	6"	8"	10"	12"	16"	20"
MIN. FLAT TUBE WIDTH	14"	16"	20"	24"	27"	34"	41"

#### MATERIALS:

1. POLYETHYLENE ENCASEMENT: IN ACCORDANCE WITH ASTM D-1248 TYPE 1, CLASS A OR C, GRADE E-1.  
FLOW RATE = 0.4 MAX, DIELECTRIC STRENGTH  
VOLUME RESISTIVELY MIN. OHM-CM<sup>3</sup> = 10<sup>6</sup>  
POLYETHYLENE FILE THICKNESS = 8 MILS  
TENSILE STRENGTH = 1200 P.S.I MIN.  
ELONGATION = 300% MIN.  
DIELECTRIC STRENGTH = 800 VOLTS/MIL
2. TAPE: POLYETHYLENE TAPE 1-1/2" WIDE AS RECOMMENDED BY THE FILM MANUFACTURER.

#### PROCEDURE FOR APPLYING POLYETHYLENE ENCASEMENT

1. CUT POLYETHYLENE TUBE TO A LENGTH APPROXIMATELY TWO FEET LONGER THAN THE LENGTH OF THE PIPE SECTION, SLIP THE TUBE AROUND THE PIPE, CENTERING IT TO PROVIDE A ONE-FOOT OVERLAP ON EACH ADJUSTMENT PIPE SECTION, AND BUNCHING IT ACCORDION FASHION LENGTHWISE UNTIL IT CLEARS THE PIPE ENDS.
2. LOWER THE PIPE INTO THE TRENCH AND MAKE THE PIPE JOINT WITH THE PRECEDING SECTION OF PIPE. A SHALLOW BELL HOLE MUST BE MADE AT THE JOINTS TO FACILITATE INSTALLATION OF THE POLYETHYLENE TUBE.
3. AFTER ASSEMBLING THE PIPE JOINT, MAKE THE OVERLAP OF THE POLYETHYLENE TUBE, PULL THE BUNCHED POLYETHYLENE FROM THE PRECEDING LENGTH OF PIPE, SLIP IT OVER THE END OF THE NEW LENGTH OF PIPE AND SECURE IT IN PLACE. THEN SLIP THE END OF THE POLYETHYLENE FROM THE NEW PIPE SECTION OVER THE END OF THE PRECEDING LENGTH OF PIPE, SECURE THE OVERLAP IN PLACE, TAKE UP THE SLACK WIDTH TO MAKE IT SNUG, BUT NOT TOO TIGHT, FIT ALONG THIS BARREL OF PIPE, SECURING THE FOLD AT QUARTER POINTS.
4. REPAIR ANY RIPS, PUNCTURES, OR OTHER DAMAGE TO THE POLYETHYLENE WITH ADHESIVE TAPE OR WITH SHORT LENGTH OF THE POLYETHYLENE TUBE CUT OPEN, WRAPPED AROUND THE PIPE, AND SECURED IN PLACE. PROCEED WITH INSTALLATION OF THE NEXT SECTION OF PIPE IN THE SAME MANNER.

#### PIPE SHAPED APPURTENANCES:

BENDS, REDUCERS, OFFSETS AND OTHER PIPE-SHAPED APPURTENANCES SHALL BE COVERED WITH POLYETHYLENE IN THE SAME MANNER AS THE PIPE.

## POLYETHYLENE ENCASEMENT - DUCTILE IRON PIPE

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-26A**

JUNCTIONS BETWEEN WRAPPED AND UNWRAPPED PIPE:

WHERE POLYETHYLENE WRAPPED PIPE JOINTS A PIPE WHICH IS NOT WRAPPED, EXTEND THE POLYETHYLENE TUBE TO COVER THE UNWRAPPED PIPE A DISTANCE OF AT LEAST TWO FEET. SECURE THE END WITH CIRCUMFERENTIAL TURNS OF TAPE.

ODD SHAPED APPURTENANCES

VALVES, TEES, CROSSES AND OTHER ODD-SHAPED PIECES WHICH CANNOT BE WRAPPED PRACTICALLY IN A TUBE SHALL BE WRAPPED WITH A FLAT SHEET OR SPLIT LENGTH OF POLYETHYLENE TUBE. THE SHEET SHALL BE PASSED UNDER THE APPURTENANCE AND BROUGHT UP AROUND THE BODY. SEAMS SHALL BE MADE BY BRINGIN THE EDGES TOGETHER, FOLDING OVER TWICE AND TAPPING DOWN. SLACK WIDTH AND OVERLAPS AT JOINTS SHALL BE HANDLED AS DESCRIBED ABOVE. TAPE POLYETHYLENE SECURELY IN PLACE AT VALVE STEM AND OTHER PENETRATIONS.

BACKFILL FOR POLYETHYLENE WRAPPED PIPE

BACKFILL MATERIAL SHALL BE AS SHOWN IN STANDARD DETAIL W-2. SPECIAL CARE SHOULD BE TAKEN TO PREVENT DAMAGE TO THE POLYETHYLENE WRAPPING WHEN PLACING BACKFILL. BACKFILL MATERIAL SHOULD BE FREE FROM CINDERS, REFUSE, BOULDERS, ROCKS, STONES OR OTHER MATERIAL THAT COULD DAMAGE THE POLYETHYLENE.

**POLYETHYLENE ENCASEMENT - DUCTILE IRON PIPE CONT.**

APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-26B**

PROCEDURE FOR MAKING OPENINGS FOR BRANCHES, SERVICE TAPS, BLOW-OFFS, AIR VALVES, AND SIMILAR APPURTENANCES

1. WRAPPING THREE (3) LAYERS OF POLYVINYL - COMPATIBLE ADHESIVE TAPE COMPLETELY AROUND THE PIPE TO COVER THE AREA WHERE THE TAPPING MACHINE AND CHAIN WILL BE MOUNTED, EXTENDING A MINIMUM OF 2" BEYOND THE MOUNTING SURFACE.
2. MOUNT THE TAPPING MACHINE ON THE PIPE AREA COVERED BY THE TAPE AND MAKE THE TAP AND INSTALL THE FERRULE DIRECTLY THROUGH THE TAPE AND POLYETHYLENE.
3. INSPECT THE ENTIRE CIRCUMFERENTIAL AREA FOR DAMAGE AND MAKE ANY NECESSARY REPAIRS WITH TAPE.
4. ON HOUSE SERVICES TO MINIMIZE THE POSSIBILITY OF DISSIMILAR METAL CORROSION AT SERVICE CONNECTIONS, WRAP THE FERRULE AND A MINIMUM CLEAR DISTANCE OF THREE (3) FEET OF THE COPPER SERVICE WITH POLYETHYLENE OR A SUITABLE DIELECTRIC TAPE.

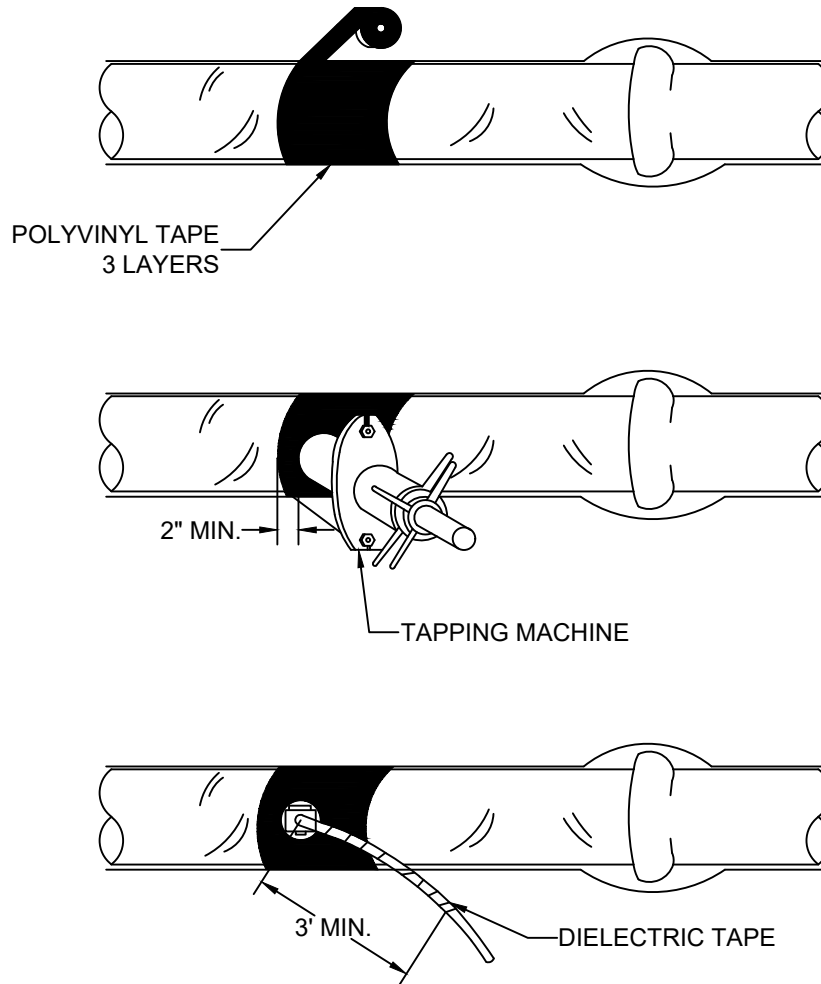

## TAPPING POLYETHYLENE ENCASED PIPE

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**W-27**

## GENERAL NOTES - WATER

1. ALL WATER MAINS SHALL HAVE A MINIMUM COVER OF 4'-6".
  - A. ALL WATER SERVICE LATERALS SHALL HAVE A MINIMUM COVER OF 42".
2. ALL WATER MAINS SHALL BE DUCTILE IRON CONFORMING WITH AWWA SPEC. C-151 CLASS 52 IN SIZES 4"-16" AND PSI CLASS 350 FOR 20" AND ABOVE.
3. COMPACT FITTINGS ARE PERMITTED.
4. ALL WATER VALVES MUST OPEN LEFT. ALL VALVE BOX LIDS MUST BE CAST/ STAMPED "WCWD" IN 1 1/2" LETTERS AND BE NEENAH NF-19130002 OR EQUAL. ALL VALVE EXTENSIONS TO HAVE SET SCREWS. ALL VALVES TO BE EQUIPPED WITH BOX-LOX-2.
5. A CONCRETE SLAB MUST BE PROVIDED AT FINAL GRADE AROUND ALL MAIN VALVE BOXES. THE SLABS MUST BE EIGHTEEN INCHES (18") SQUARE/CIRCLE AND NINE INCHES (9") THICK. PRE-FABRICATED CONCRETE RINGS ARE ACCEPTABLE.
6. WATER AND SEWER LINES SHALL HAVE A MINIMUM OF TEN FEET (10') HORIZONTAL SEPARATION AND/OR TWO FEET (2') VERTICAL SEPARATION.
7. NO GATE VALVE, METER PIT, BLOW OFF OR CORPORATION STOP SHALL BE LOCATED UNDER OR WITHIN THREE FEET (3') OF DRIVEWAYS, ROADWAYS OR SIDEWALKS.
8. NO DRIVEWAY SHALL BE INSTALLED WITHIN FIVE FEET (5') OF A FIRE HYDRANT.
9. A MINIMUM OF THREE FEET (3') IS REQUIRED BETWEEN CORPORATION STOPS. NO TAP SHALL BE MADE WITHIN THREE (3') OF A BELL.
10. THE LOCATION OF WATER SERVICE LATERALS MUST BE STAMPED IN THE CURB AT THE TIME THE CURB IS PLACED TO PERMANENTLY INDICATE THE LOCATION OF SAID LATERALS.
11. THE LOCATION OF ALL WATER SERVICE LATERALS, BENDS, TEES, ETC. MUST BE PROVIDED ON THE AS-BUILT PLANS. ALL OF THESE APPURTENANCES SHOULD BE SURVEYED IN STATE PLANE COORDINATES AND ELECTRONICALLY DELIVERED WITH AS-BUILTS.
12. CONTRACTOR SHALL SUBMIT AS-BUILT PLANS OF SANITARY AND WATER LATERALS TO THE OWNER.
13. ALL WATER MAINS CROSSING UNDER STORM DRAINS SHALL BE BACK-FILLED WITH GRANULAR MATERIAL, O.D.O.T. ITEM 310.02, BETWEEN MAINS AND DRAINS.
14. ALL NEW WATER MAINS SHALL BE PRESSURE TESTED FOR 2 HOURS AT 200 PSI. ALLOWABLE LEAKAGE SHALL BE PER TABLE 6A OF AWWA C-600.
15. WHERE PVC IS USED IN RURAL WATER SERVICE AREAS, DETECTABLE WATER TAPE, PRESCO #PSD3105B52, SHOULD BE PLACED 1' ABOVE WATER MAIN.

APPROVED/REVISED  MAY, 2023	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>WG-1A</b>

## GENERAL NOTES - WATER (CONTINUED)

16. EACH SERVICE LATERAL MUST BE A CONTINUOUS PIECE OF PIPE FROM THE CORP STOP TO THE METER. COUPLINGS SHALL NOT BE ALLOWED. TYPE K COPPER SHALL BE USED FOR 3/4" AND 1" SERVICES. POLYETHYLENE 200 PSI (COPPER TUBE SIZE) MAY BE USED FOR 1 1/2" AND 2" SERVICES. TRACER WIRE MUST BE USED WITH POLY AND SDR 21.
17. SERVICE LINES 1" AND LARGER MUST BE EITHER TYPE K COPPER, POLY 200 PSI (ASTM D-2737) OR SDR 21 (SLIP JOINT) (ASTM-2241). TRACER WIRE MUST BE TAPED EVENLY EVERY 3' ON POLY AND SDR 21 FROM THE METER PIT INTO THE STRUCTURE BEING SERVED (A 3' LEAD IS REQUIRED INSIDE THE PIT).
18. 1 1/2" AND 2" SERVICE LINES FROM THE CORP STOP TO THE METER PIT MUST BE TYPE K COPPER OR POLYETHYLENE 200 PSI. POLY MUST HAVE A TRACER WIRE. SEE W-10B.
19. FIRE HYDRANTS MUST BE PROVIDED AT THE ENTRANCE TO ALL SUBDIVISIONS AND AT ALL STREET INTERSECTIONS.
20. AN APPROVED BACKFLOW PREVENTION ASSEMBLY SHALL BE INSTALLED ON ALL WATER SERVICE LATERALS BY THE PROPERTY OWNER PRIOR TO ANY POINT OF CONNECTION OR USAGE. THE FOLLOWING DEVICES AND LOCATIONS ARE REQUIRED.
  - A) RESIDENTIAL DWELLING UNITS (3 FAMILY OR LESS): LOCATED IMMEDIATELY UPON ENTRY OF STRUCTURE. DUEL CHECK VALVE A.S.S.E. 1024.
  - B) LANDSCAPE IRRIGATION SYSTEMS: REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY A.S.S.E. 1013. LOCATED IMMEDIATELY UPON ENTRY OF STRUCTURE.
  - C) FIRE PROTECTION SYSTEMS: DOUBLE CHECK DETECTOR CHECK ASSEMBLY A.S.S.E. 1048 OR REDUCED PRESSURE PRINCIPLE DETECTOR CHECK A.S.S.E. 1047 IF SYSTEM CONTAINS ADDITIVES; A.S.S.E. 1048 LOCATED IN VAULT AND A.S.S.E. 1047 LOCATED IN BUILDING.
  - D) NON-RESIDENTIAL SERVICES: REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY A.S.S.E. 1013, LOCATED IMMEDIATELY UPON ENTRY OF STRUCTURE.
21. BACFKLOW PREVENITION DEVICE THAT COMPLIES WITH A.S.S.E. 1013 IS TO BE INSTALLED AHEAD OF ANY SPRINKLER BUT NOT IN THE METER PIT.
22. NEW BACKFLOW PREVENTION DEVICES BEING INSTALLED ON EXISTING SERVICES SHALL BE INSTALLED EITHER IMMEDIATELY UPON ENTRY TO THE BUILDING, BEFORE ANY CONNECTIONS, OR IN A PIT OR ABOVE GROUND HEATED INCLOSURE (IN ACCORDANCE WITH DEVICE INSTALLATION REQUIREMENTS) A MINIMUM OF 4 FEET AWAY FROM THE EXISTING METER PIT OR VAULT.
23. SWAB PIPE WITH 50 PPM CHLORINE SOLUTION BEFORE INSTALLATION.
24. DEDUCT METERS SHALL NOT BE ALLOWED.
25. NO IRRIGATION CONNECTIONS SHALL BE ALLOWED IN THE METER PIT.
26. ALL MATERIALS USED SHALL BE DOMESTIC, MADE IN THE UNITED STATES OF AMERICA.

APPROVED/REVISED  MAY, 2023	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>WG-1B</b>

## PROCEDURE FOR CONNECTION TO EXISTING WATER SYSTEM

1. MUST NOTIFY WARREN COUNTY WATER DEPARTMENT THREE (3) DAYS IN ADVANCE OF ANY SHUT DOWN. WARREN COUNTY WILL ISSUE THE SHUT DOWN NOTIFICATION AND/OR BOIL ADVISORY TO AFFECTED CUSTOMERS PER OHIO EPA REQUIREMENTS IF DETERMINED NECESSARY BY WARREN COUNTY.
2. EXPOSE EXISTING MAIN AT PROPOSED CONNECTION POINT. NO WET TAP SHALL BE MADE WITHIN THREE (3) FEET OF A BELL OR PIPE CONNECTION.
3. COUNTY PERSONNEL TO OPERATE CLOSING OF APPROPRIATE VALVES TO ISOLATE LINE TO BE TAPPED.
4. INSTALL PROPER TAPPING SLEEVE AND TAPPING VALVE. THE TAPPING SLEEVE AND VALVE SHALL BE TESTED AT 200 PSI FOR A PERIOD OF AT LEAST 5 MINUTES. THE PIPE SLUG MUST BE REMOVED AND INSPECTED BY COUNTY PERSONNEL.
5. IF THE TAPPING SLEEVE AND VALVE WILL BE UNDER FUTURE PAVEMENT, THE BURIED VALVE MUST BE LEFT OPEN AND A NEW VALVE SET OUT OF PAVEMENT.
6. FIELD CUT EXISTING MAIN AS NECESSARY TO ACCOMMODATE TEE AND CLOSE COUPLED VALVES AT EACH END OF TEE. CARE IS TO BE TAKEN SO AS NOT TO GET DIRT IN EXISTING MAIN.
7. THOROUGHLY CLEAN AND DISINFECT PIPE AND APPURTENANCES TO BE INSTALLED.
8. INSTALL TEE AND VALVES - DRESSER COUPLINGS CAN BE USED IF NECESSARY. PROPOSED MAIN VALVE IS TO BE CAPPED AND SHUT OFF. EXISTING MAIN IS THEN TO BE RETURNED TO SERVICE BY COUNTY PERSONNEL.
9. CONSTRUCTION OF PROPOSED MAIN IS TO BE COMPLETED WITHIN A JOINT OF CONNECTION TO TEE AND VALVES INSTALLED ABOVE.
10. ENTIRE LINE IS TO BE PRESSURE TESTED AND DISINFECTED TO COUNTY STANDARDS.
11. ENTIRE LENGTH OF PIPE IS TO BE THOROUGHLY CLEANED AND DISINFECTED PRIOR TO INSTALLATION. PERMATEX CHLORINE TABLETS TO BE USED FOR DISINFECTION. DOSAGE SHALL BE PER MANUFACTURER'S SPECIFICATIONS BASED ON PIPE MATERIAL.
12. NEW MAIN IS TO BE PUT INTO SERVICE BY COUNTY PERSONNEL.
13. TAPPING SLEEVES/SADDLES TO BE TWO-PIECE CAST IRON OR DUCTILE IRON (MUELLER H615). JCM412 OR FORD FTSS TAPPING SLEEVES PERMITTED ON C-900. SIZE ON SIZE TAPPING SLEEVES ARE NOT PERMITTED.

APPROVED/REVISED  MARCH, 2018	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>WG-2</b>

**PROCEDURE FOR RELOCATING OR LOWERING SERVICE LATERAL  
AND RELOCATING OR BRINGING TO GRADE METER PITS**

1. ALL AFFECTED USERS MUST BE NOTIFIED FORTY-EIGHT (48) HOURS IN ADVANCE AS TO THE TIME AND DURATION OF THE SHUTOFF. ANY DISCONTINUANCE OF SERVICE MUST BE COORDINATED THROUGH WARREN COUNTY PRIOR TO ANY SHUT DOWN.
2. ALL WORK MUST BE PERFORMED ACCORDING TO ALL WARREN COUNTY SPECIFICATIONS, PARTICULARLY W-10A, W-10B, AND W-12.
3. EACH SERVICE LATERAL MUST BE A CONTINUOUS PIECE OF PIPE FROM THE CORP STOP TO THE METER. COUPLINGS SHALL NOT BE PERMITTED. TYPE K COPPER SHALL BE USED FOR 3/4" AND 1" SERVICES. POLYETHYLENE 200 PSI MAY BE USED FOR 1 1/2" AND 2" SERVICES.
4. METER PITS MUST BE ADJUSTED TO GRADE USING RING RISERS OR PIT RISERS. METERS MUST BE ADJUSTED WITH METER RESETTERS (FORD V42).
5. ALL PROCEDURES MUST BE DISCUSSED AT A PRECONSTRUCTION MEETING PRIOR TO THE INITIATION OF CONSTRUCTION.

APPROVED/REVISED  MARCH, 2018	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>WG-3</b>

## SEWER DETAILS

S-1	PRECAST MANHOLE
S-2	PRECAST MANHOLE INSIDE DROP CONNECTION
S-3	VENTED MANHOLE
S-4	MANHOLE CHANNELS
S-5	SANITARY MANHOLE INVERT TRANSITION BASE SECTIONS
S-6	SANITARY GRAVITY SEWER TRENCH DETAIL
S-7	ROAD PAVEMENT CUT AND RESTORATION AT ROADWAY CROSSING
S-8	SEWER IN CASING
S-9	CONCRETE ANCHOR
S-10	FULL CONCRETE ENCASEMENT
S-11	SANITARY SEWER CREEK CROSSING
S-12	AERIAL SANITARY SEWER CROSSING
S-13	DEEP HOUSE CONNECTIONS
S-14A	HOUSE CONNECTIONS - TYPE A & TYPE B
S-14B	HOUSE CONNECTIONS - TYPE C
S-14C	HOUSE CONNECTIONS
S-15	FORCE MAIN CLEANOUT
S-16	AIR RELEASE VALVE ASSEMBLY
S-17	SANITARY CLEANOUT
S-18	REQUIRED RESTRAINED JOINTS FOR BENDS
S-19	FORCE MAIN TRENCH DETAIL
S-20	IMPERVIOUS DAM DETAIL
S-21	LATERAL SADDLE INSTALLATION DETAIL FOR PVC PIPE
S-22	SADDLED WYE GASKET HUB & GASKET SKIRT W/ STAINLESS STEEL BANDS
S-23	STANDARD PRECAST CONCRETE DOGHOUSE MANHOLE
SG-1	DETAILED PROCEDURES FOR SANITARY SEWER
SG-2A	GENERAL NOTES - SANITARY SEWER
SG-2B	GENERAL NOTES - SANITARY SEWER (CONTINUED)
SG-3	PIPE CONNECTION INTO MANHOLES
SG-4	SEWER TESTING

## TABLE OF CONTENTS - SANITARY SEWER DETAILS

APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**TOC**



MANHOLE SHALL CONFORM TO  
A.S.T.M. SPECIFICATION C-478

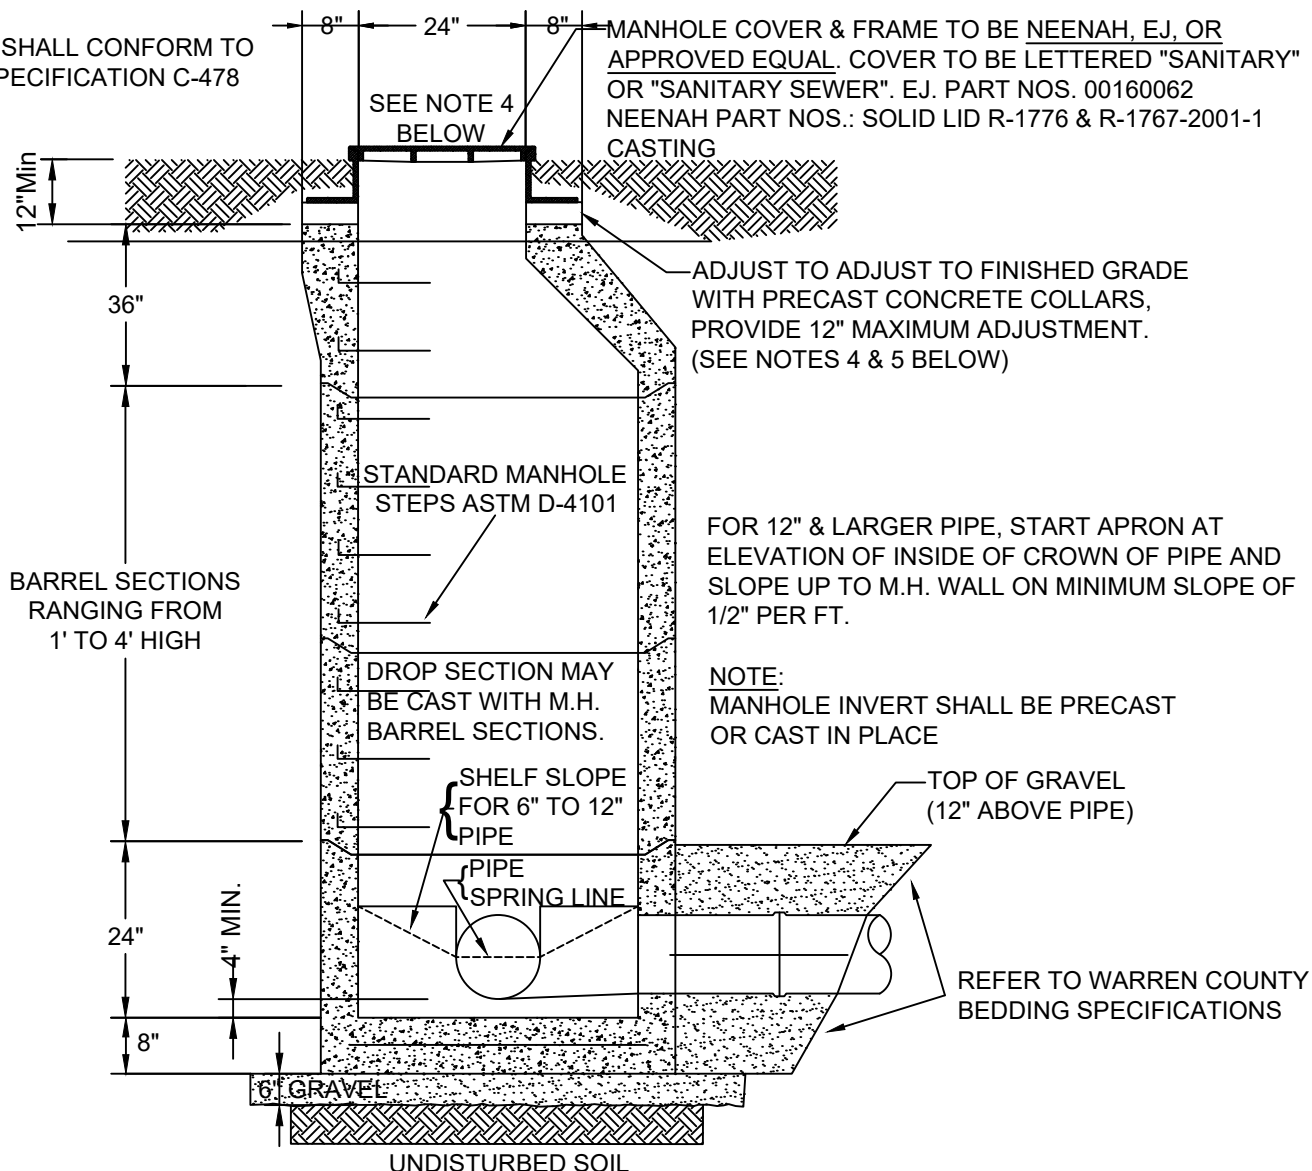

**NOTES:**

1. MINIMUM WALL THICKNESS AND STEEL REINFORCING TO CONFORM WITH A.S.T.M. DESIGNATION C-478. STEEL SHALL BE COLD DRAWING WIRE IN ACCORDANCE WITH A.S.T.M. DESIGNATION A-82.
2. WATER TIGHT GASKETS ARE REQUIRED AT ALL JOINTS (C-443 FOR RUBBER TYPE JOINTS).
3. EXCEPT AS OTHERWISE NOTED ON THE SEWER STAKING PLAN, WHERE PIPE SIZES CHANGE AT THE MANHOLE, THE INSIDE TOPS OF PIPES ARE TO BE SET AT THE SAME ELEVATION.
4. TOP OF CASTING SHALL BE EVEN WITH FINISHED GRADE AT PAVE LOCATIONS (ROADWAYS AND PARKING LOTS) AND AT DEVELOPED LOTS. IN UNDEVELOPED LOTS, TOP OF CASTING TO BE A MINIMUM OF 12" ABOVE FINISHED GRADE OR AS OTHERWISE SHOWN ON PLAN.
5. WITHIN A NEW SUBDIVISION, TEMPORARY ADJUSTING COLLAR MUST BE PROVIDED 1 FOOT ABOVE ROUGH/FINISHED GRADE. RISERS (12" MAXIMUM) ARE PERMITTED. MANHOLES SHALL BE LOWERED TO FINISHED GRADE WHEN SUBDIVISION IMPROVEMENTS ARE COMPLETED AND THE LOTS IS BUILT ON.
6. NO MANHOLE, OR ANY PORTION OF MANHOLE, SHALL BE LOCATED UNDER A SIDEWALK OR DRIVEWAY. MANHOLES SHALL ONLY BE ALLOWED IN ROADWAY PAVEMENT UPON PERMISSION BY THE COUNTY SANITARY ENGINEER.
7. A MINIMUM DROP OF 0.20' MUST BE MAINTAINED BETWEEN INLET AND OUTLET INVERTS IN MANHOLES.

## PRECAST MANHOLE

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-1**

MANHOLE COVER & FRAME TO BE NEENAH, EJ, OR  
APPROVED EQUAL. COVER TO BE LETTERED "SANITARY"  
 OR "SANITARY SEWER". EJ. PART NOS. 00160062  
 NEENAH PART NOS.: SOLID LID R-1776 & R-1767-2001-1  
 CASTING

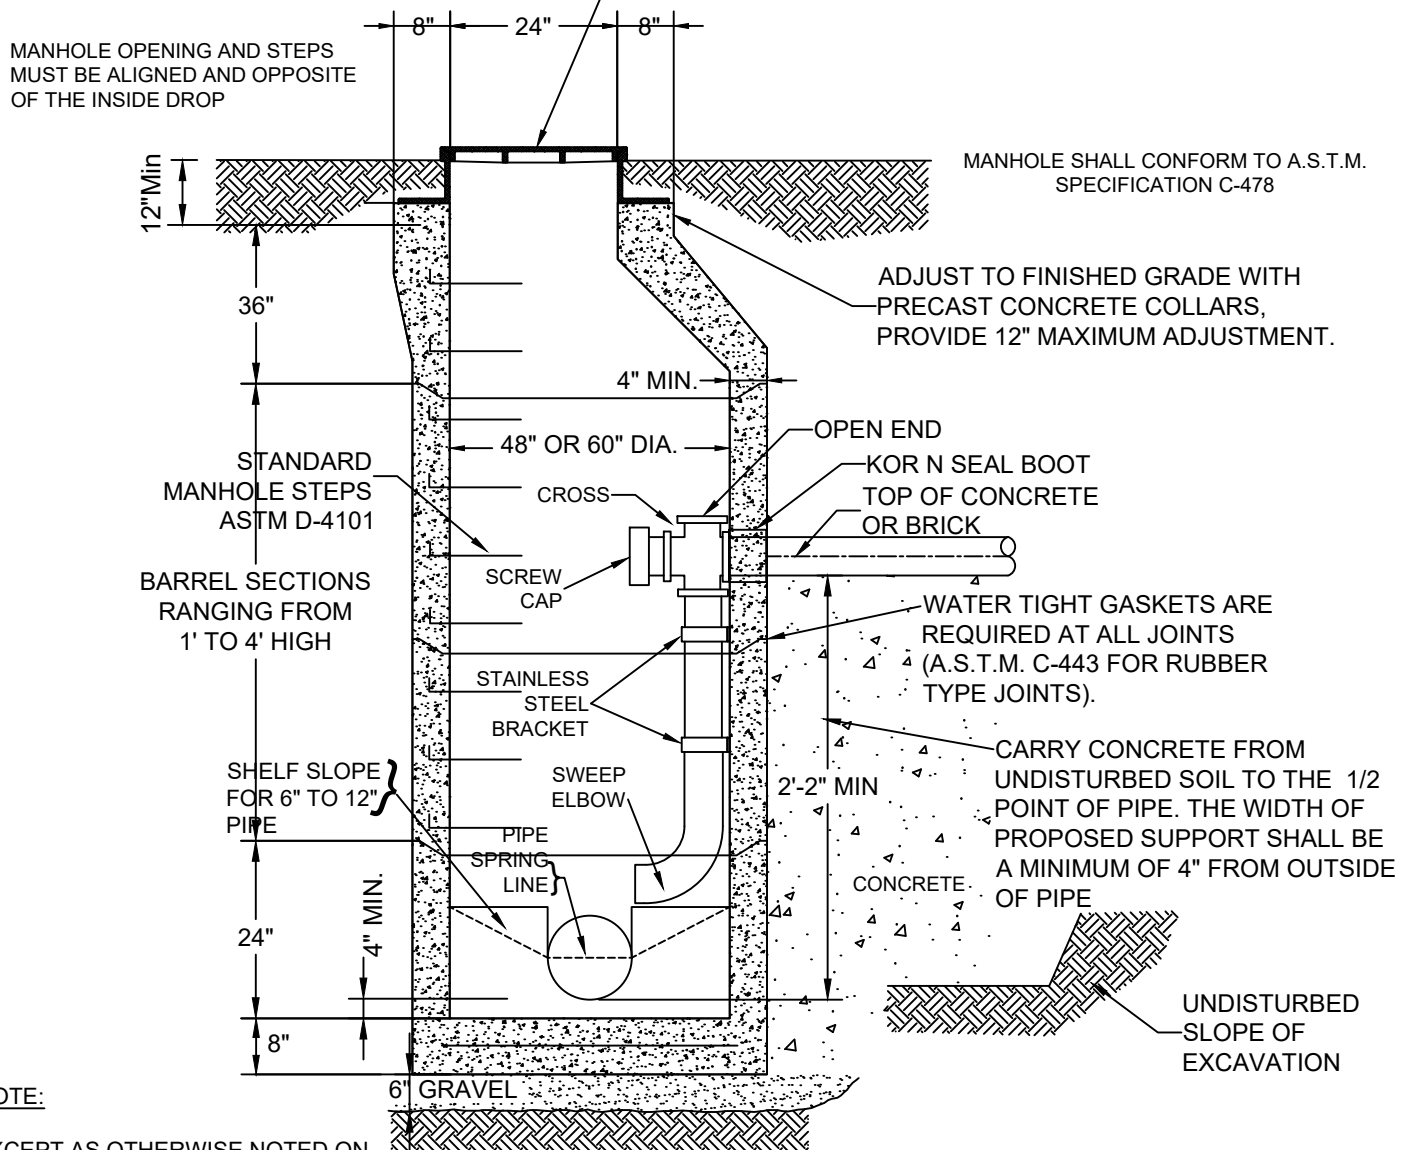

EXCEPT AS OTHERWISE NOTED ON THE SEWER STAKING PLAN, WHERE PIPE SIZES CHANGE AT THE MH, THE INSIDE TOPS OF PIPES ARE TO BE AT THE SAME ELEVATION.

MINIMUM WALL THICKNESS AND  
STEEL REINFORCING TO CONFORM  
WITH ASTM DESIGNATION C-478.  
STEEL SHALL BE COLD DRAWN WIRE  
IN ACCORDANCE WITH ASTM  
DESIGNATION A-82.


NO MANHOLE, OR ANY PORTION OF A MANHOLE, SHALL BE LOCATED UNDER A SIDEWALK OR DRIVEWAY. MANHOLE SHALL ONLY BE ALLOWED IN ROADWAY PAVEMENT UPON PERMISSION BY THE COUNTY SANITARY ENGINEER.

WITHIN A NEW SUBDIVISION, TEMPORARY  
ADJUSTING COLLAR MUST BE PROVIDED  
1 FOOT ABOVE ROUGH/FINISHED GRADE.  
RISERS (12" MAXIMUM) ARE PERMITTED.  
MANHOLES SHALL BE LOWERED TO  
FINISHED GRADE WHEN SUBDIVISION  
IMPROVEMENTS ARE COMPLETED AND  
THE LOT IS BUILT ON .

## PRECAST MANHOLE INSIDE DROP CONNECTION

STANDARD NUMBER

S-2

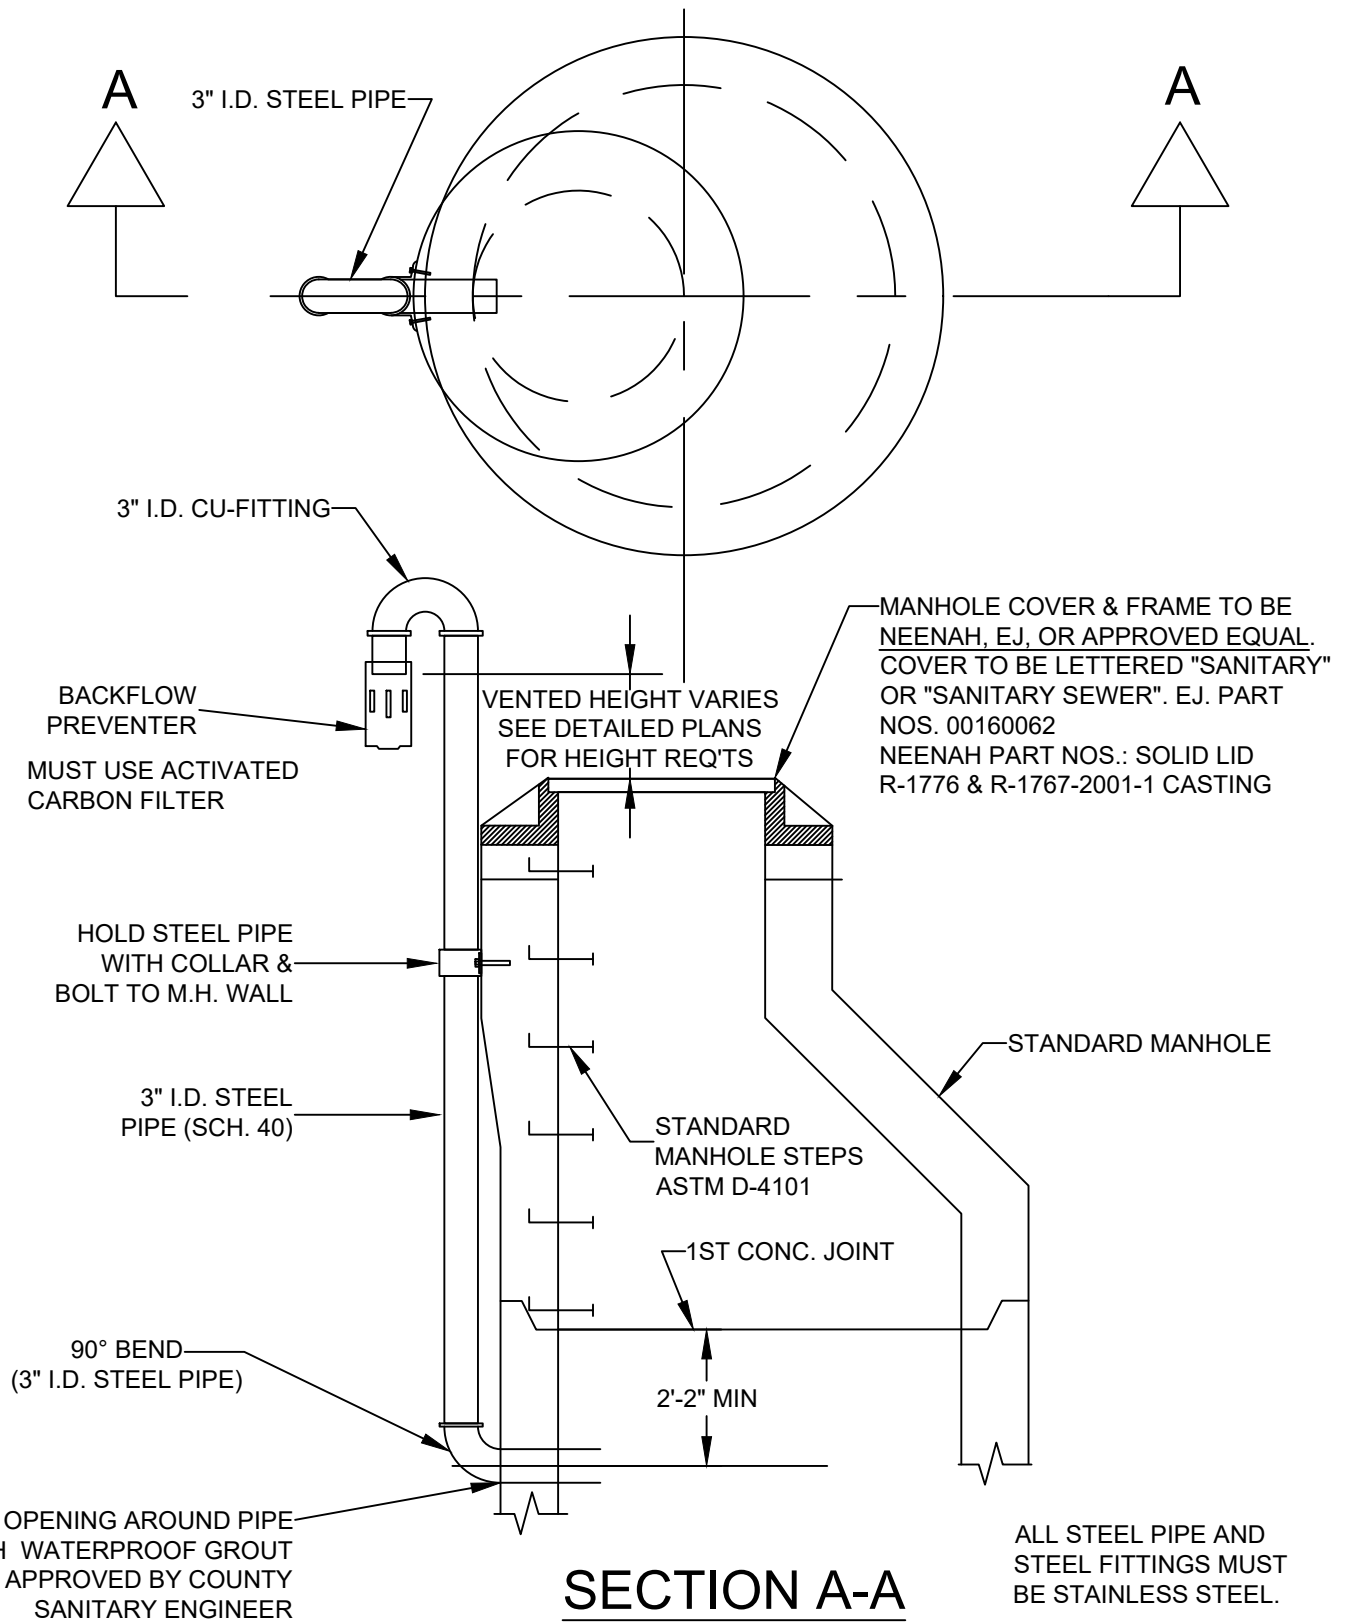

## VENTED MANHOLE





APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-3**

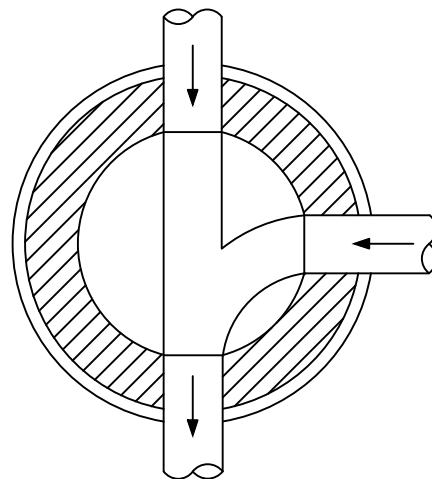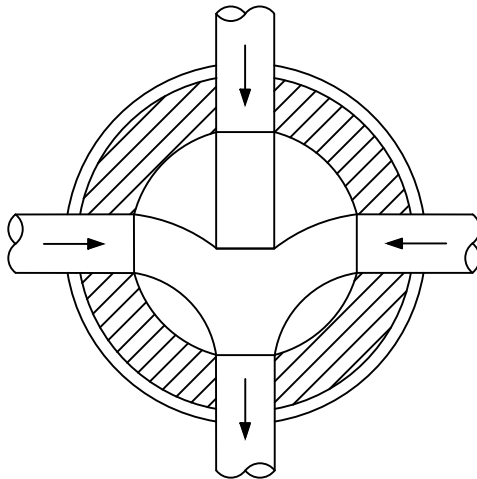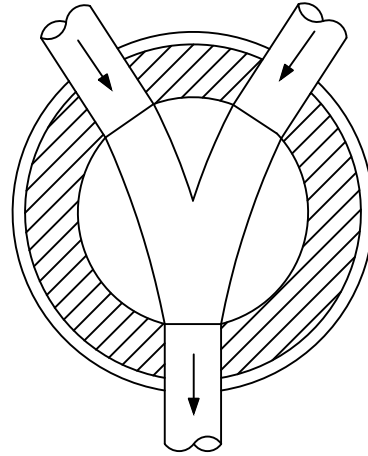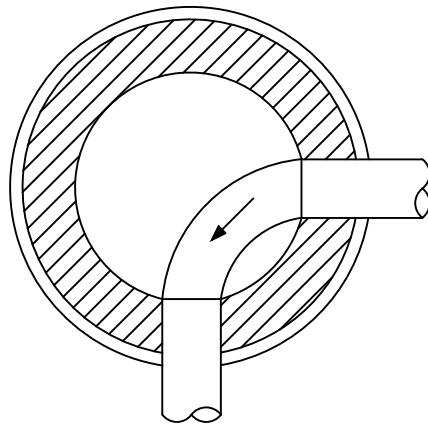

**NOTE:**

1. MODIFY MANHOLE CHANNEL ENTRANCE CONDITIONS TO SUIT ENTRANCE NEEDS OF INDIVIDUAL CASES, MAINTAINING CHANNEL CONCEPT.
2. CHANNELS MUST BE SUITABLE FOR INSTALLATION & REMOVAL OF EXPANSION PLUG USED FOR FLUSHING.
3. ALL CONSTRUCTION DETAILS & DIMENSION ARE TO CONFORM TO THOSE SHOWN FOR STANDARD MANHOLES.
4. ALL CHANNELS MUST BE SMOOTH AND UNIFORM. TRANSITION MUST NOT CREATE OBSTRUCTION TO FLOW.
5. SLOPE CHANNELS UNIFORMLY TO MAINTAIN A MINIMUM DROP OF 0.20' BETWEEN INLET AND OUTLET INVERTS.

## MANHOLE CHANNELS

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**S-4**

THREE PIPE TRANSITION

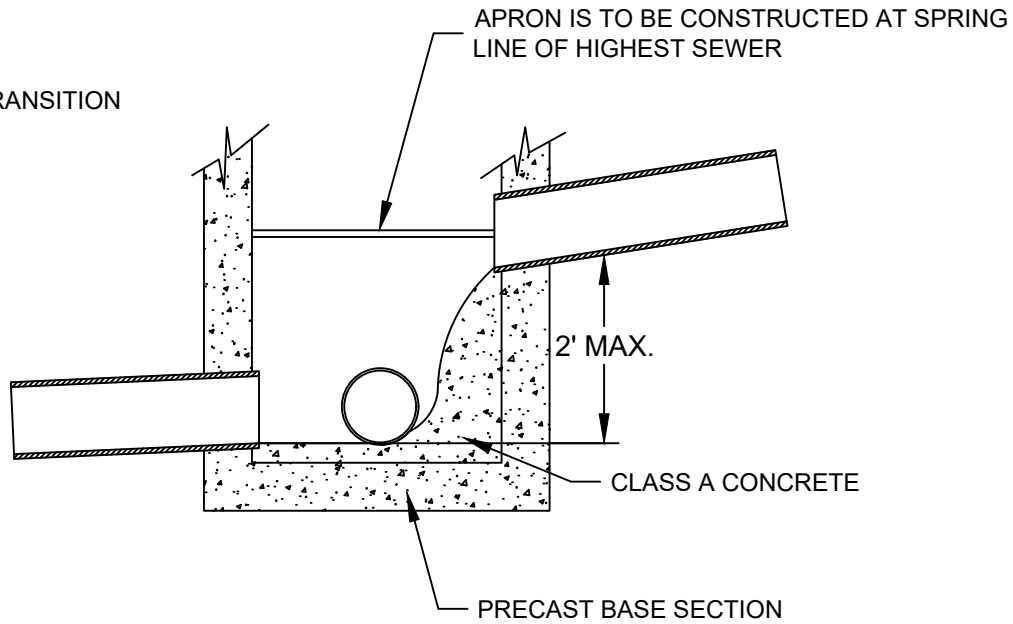

TWO PIPE TRANSITION

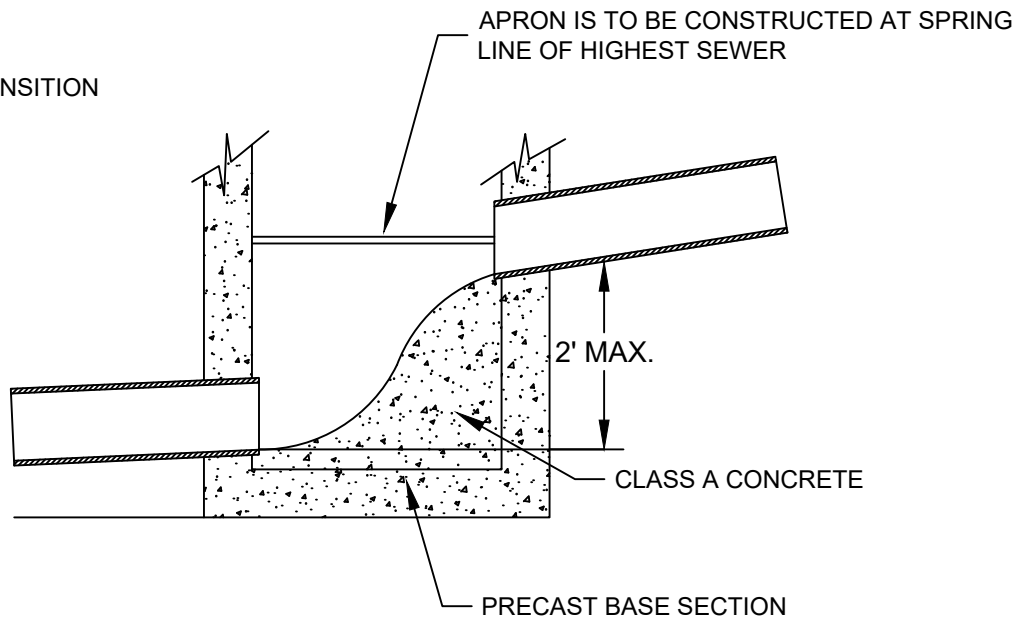

NOTE:

DROP MANHOLES ARE TO BE USED WHEN THE SEWER ENTERING THE MANHOLE IS TWO (2) FEET OR GREATER ABOVE THE MANHOLE INVERT.

## SANITARY M.H. INVERT TRANSITION BASE SECTIONS


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-5**

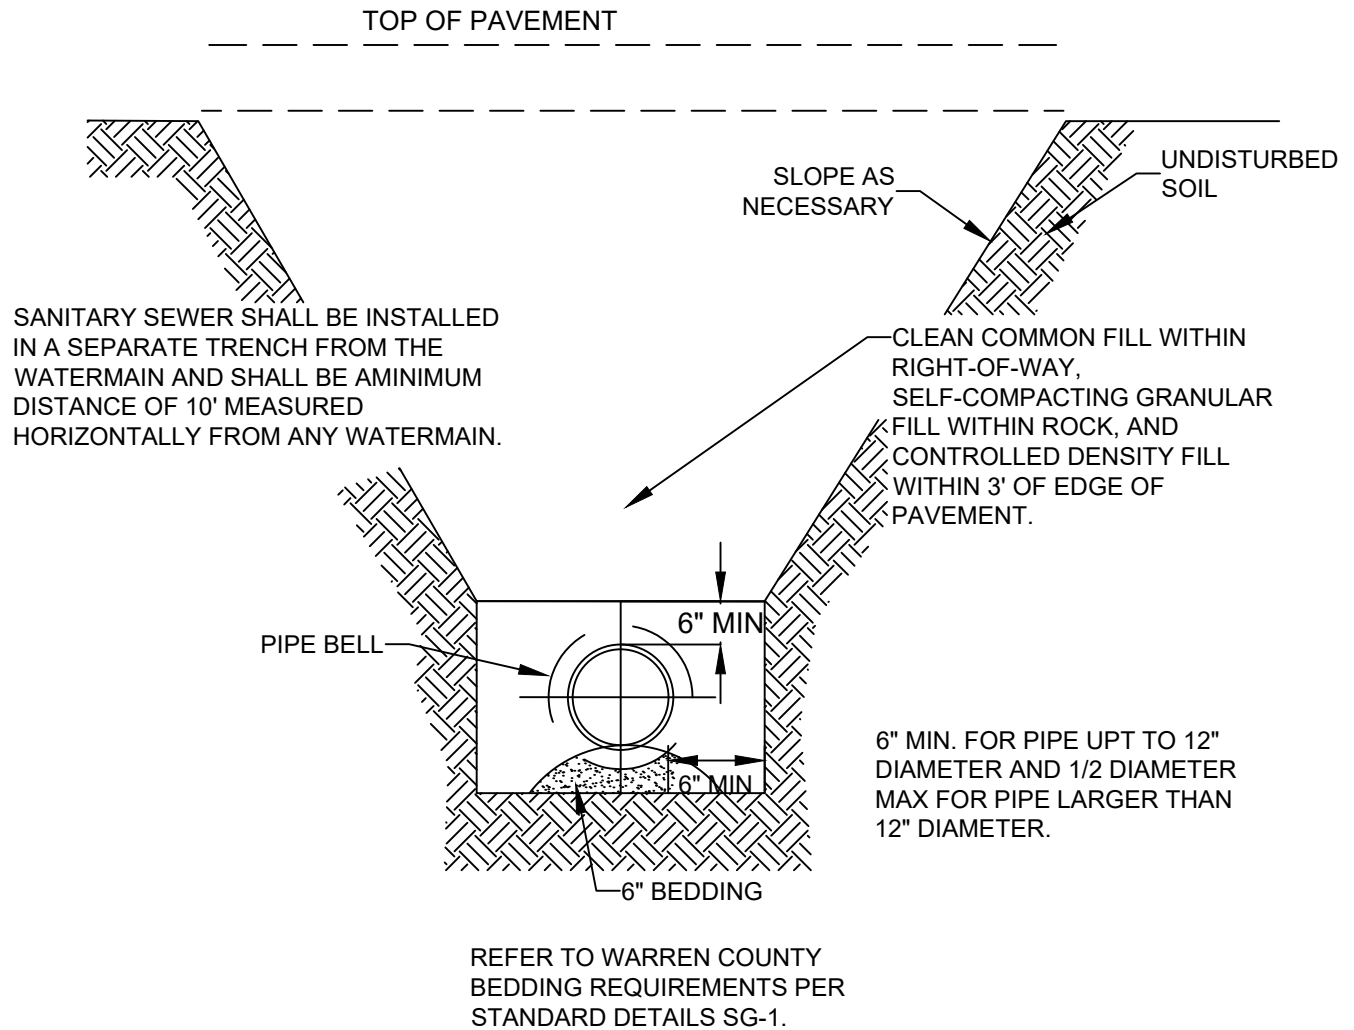

**NOTES:**

1. TRENCH SIDES SHALL MEET OSHA REQUIREMENTS.
2. TRENCH SHALL HAVE FLAT BOTTOM SO THAT PIPE WILL BE SUPPORTED UNIFORMLY ALONG THE BARREL.
3. NO SUPPORT BY BLOCKING IS PERMITTED.

## SANITARY GRAVITY SEWER TRENCH DETIAL


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-6**

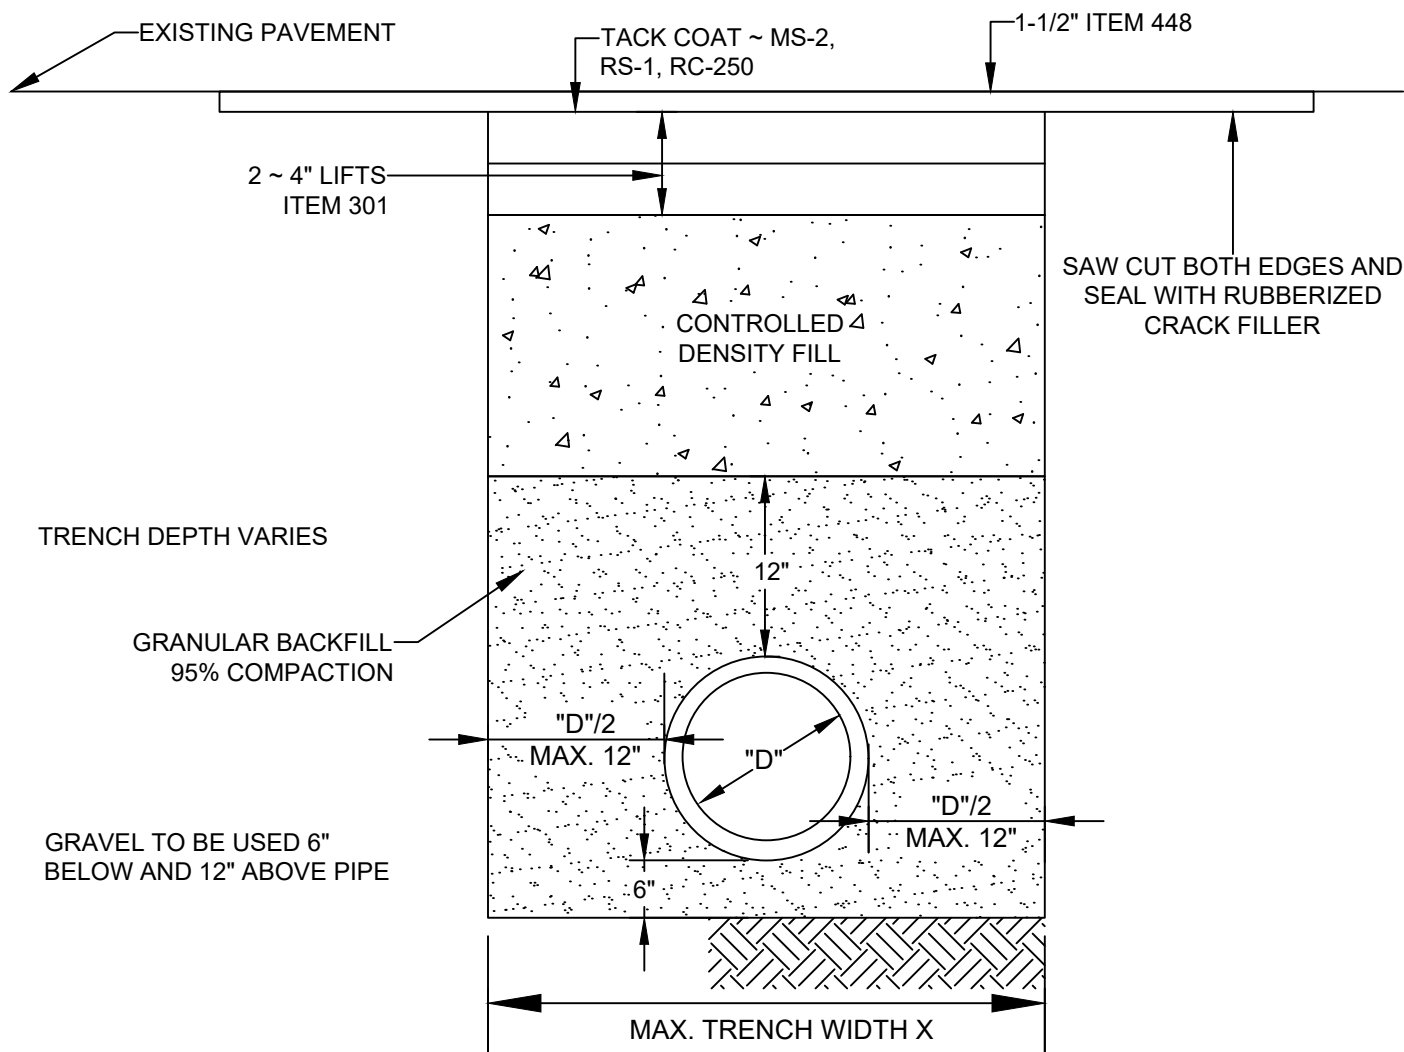

#### NOTES:

1. ALL DIMENSIONS ARE MINIMUM - ACTUAL TO BE PER COUNTY ENGINEER OR ODOT INSTRUCTIONS & PERMIT.
2. TRAFFIC MUST BE MAINTAINED AT ALL TIMES; LIGHTS, SIGNS, BARRICADES AND IF NECESSARY, FLAGMAN AND WATCHMEN TO BE ON JOB FOR PROTECTION OF THE PUBLIC. STREET PLATES MUST CONFORM TO COUNTY ENGINEER OR ODOT REQUIREMENTS.
3. FLASHFILL OR CONTROLLED DENSITY FILL TO A MINIMUM DISTANCE OF 5 FEET BEYOND THE EDGE OF PAVEMENT. TRENCH BACKFILL AND PAVEMENT RESTORATION MUST CONFORM TO THE APPLICABLE WARREN COUNTY ENGINEER OR ODOT SPECIFICATIONS.
4. EXISTING PAVEMENT AND EDGES SHALL BE NEATLY AND SQUARELY TRIMMED AND/OR MILLED. PAVEMENT MUST MATCH EXISTING ROAD THICKNESS OR AS SPECIFIED BY COUNTY ENGINEER OR ODOT.

## ROAD PAVEMENT CUT AND RESTORATION AT ROADWAY CROSSING

APPROVED/REVISED

MARCH, 2018


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-7**


# WATER PIPE SIZE - CARRIER PIPE SIZE (O.D.)-THICKNESS

4"	10"	1/4"
6"	12"	3/8"
8"	18"	3/8"
10"	20"	3/8"
12"	24"	1/2"
16"	24"	1/2"
20"	30"	1/2"
24"	36"	1/2"

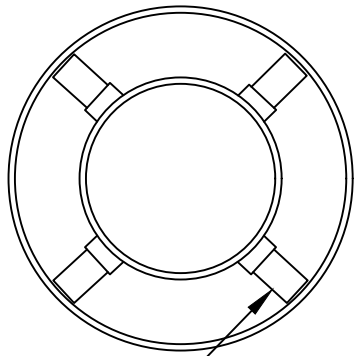


SO THAT PIPE WILL BE CENTERED IN CARRIER PIPE, THE FOLLOWING INFORMATION IS NEEDED:

1. TYPE & O.D. OF PIPE
2. TYPE OF JOINT/RESTRAINT
3. TYPE & I.D. OF CASING
4. 2 SPACER PER LENGTH OF PIPE (18")  
(SEE STANDARD PLACEMENT BELOW)

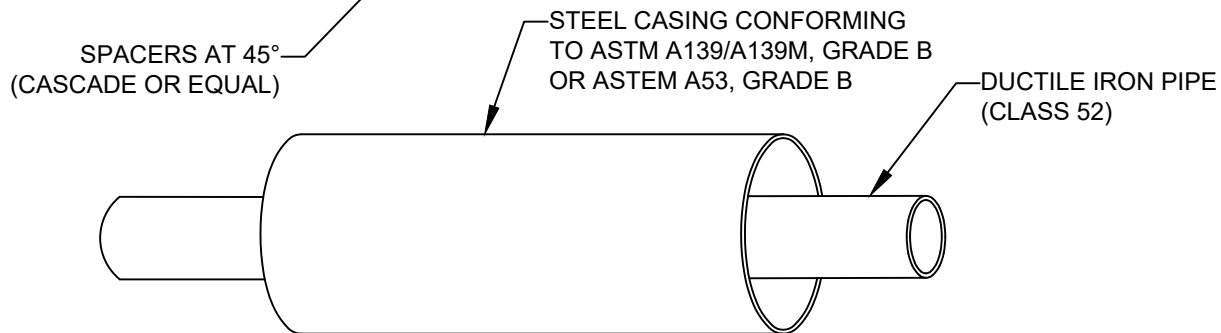

## NOTE:

1. RESTRAINED JOINT TO BE USED WITHIN LIMITS OF CASING
2. PACK END OF CASING WITH CONCRETE OR GRAVEL
3. CASING SPACER TO BE USED THRU CARRIER PIPE

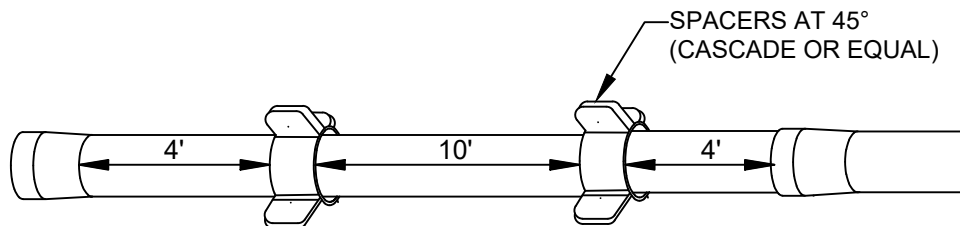

RECOMMENDED STANDARD PLACEMENT

## SEWER IN CASING

APPROVED/REVISED


MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**S-8**



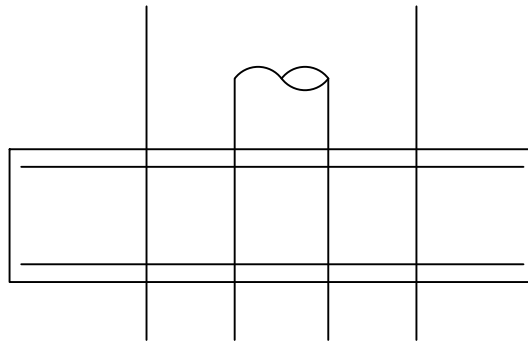

4000 PSI CONCRETE

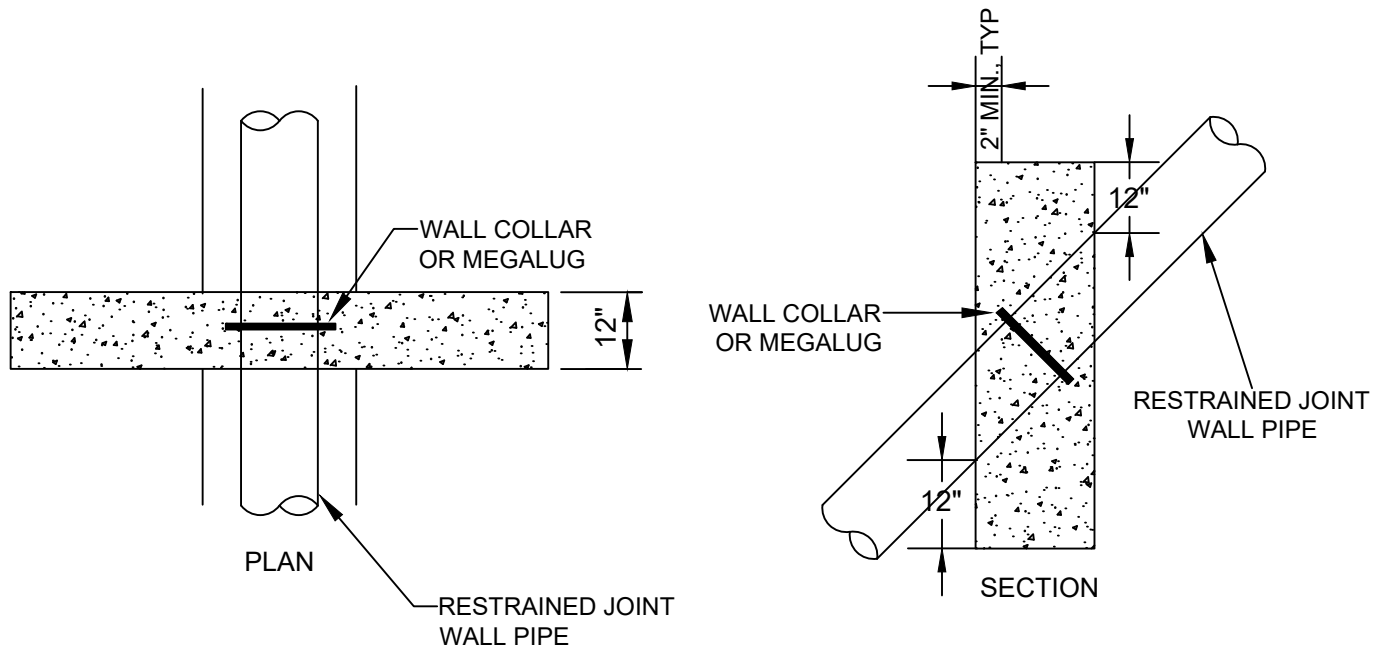

SEWERS ON 20 PERCENT SLOPE OR GREATER SHALL BE CASS 53 RESTRAINED JOINT DUCTILE IRON ANCHORED WITH CONCRETE ANCHORS SPACED AS FOLLOWS:

1. NOT OVER 36 FEET CENTER TO CENTER ON GRADES 20 PERCENT TO 35 PERCENT.
2. NOT OVER 24 FEET CENTER TO CENTER ON GRADES 35 PERCENT TO 50 PERCENT.
3. NOT OVER 16 FEET CENTER TO CENTER ON GRADES 50 PERCENT AND OVER.

## CONCRETE ANCHOR


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-9**

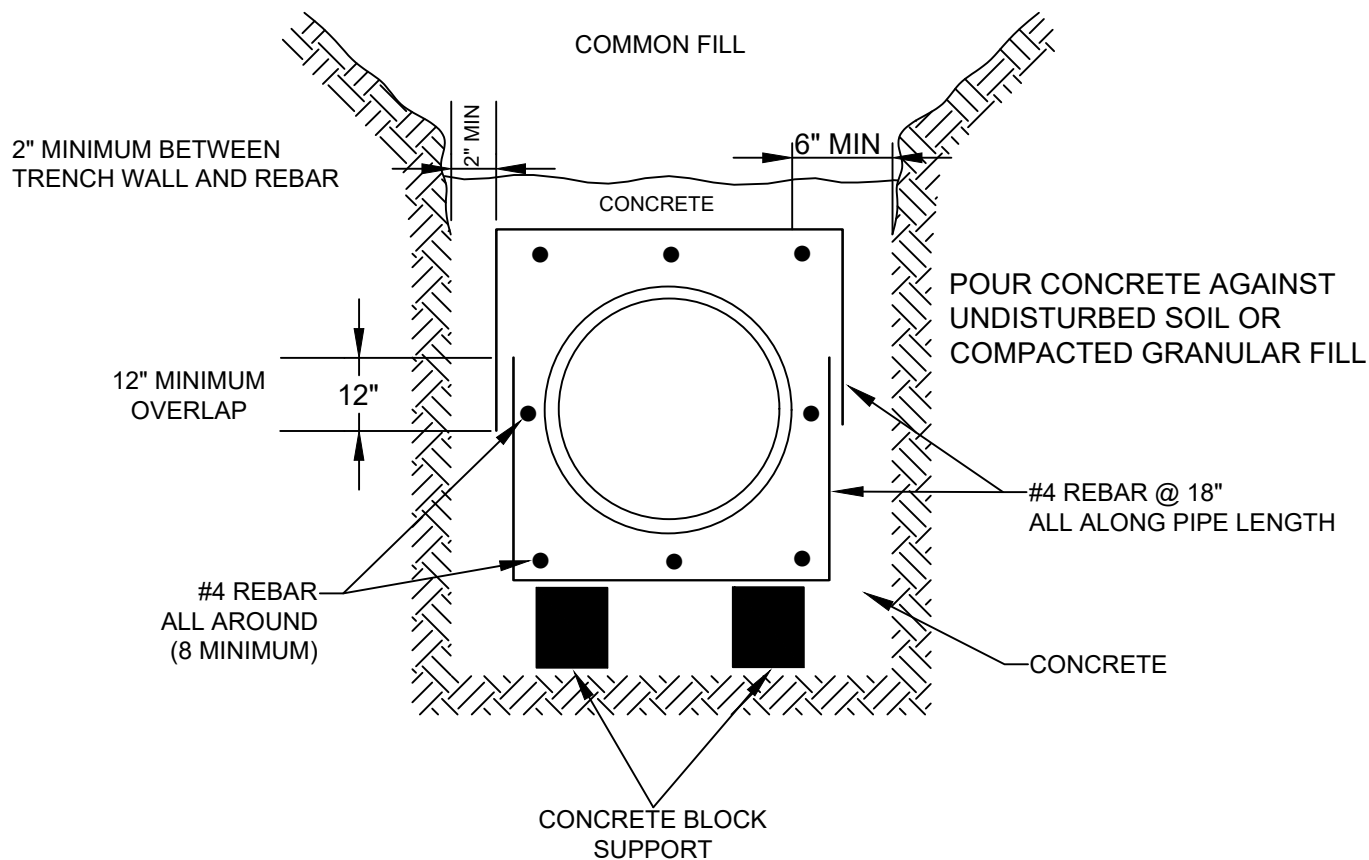

NOTES:

- 1) CONCRETE SHALL BE 3000 P.S.I. MINIMUM 28 DAYS STRENGTH (4" SLUMP).
- 2) SUPPORT PIPE AND REBAR CAGE ON CONCRETE BRICKS DURING CONCRETE PLACEMENT.
- 3) CONCRETE ENCASEMENT SHALL BE TERMINATED AT PIPE JOINTS ONLY.

## FULL CONCRETE ENCASEMENT


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-10**

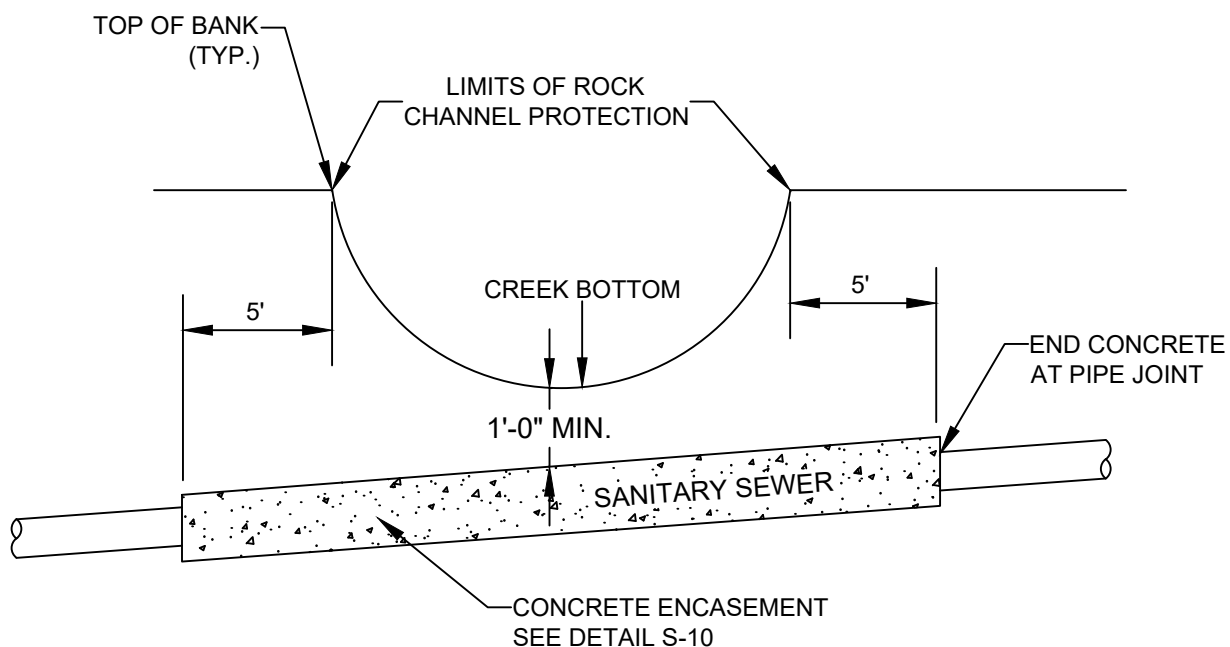

## SANITARY SEWER CREEK CROSSING


APPROVED/REVISED

MARCH, 2018


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-11**

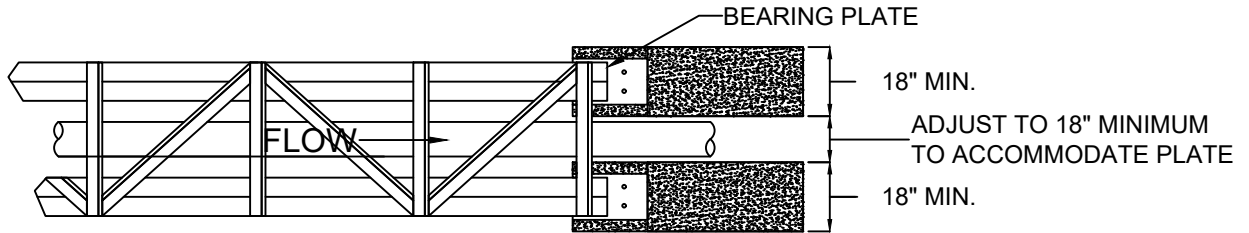

## PLAN

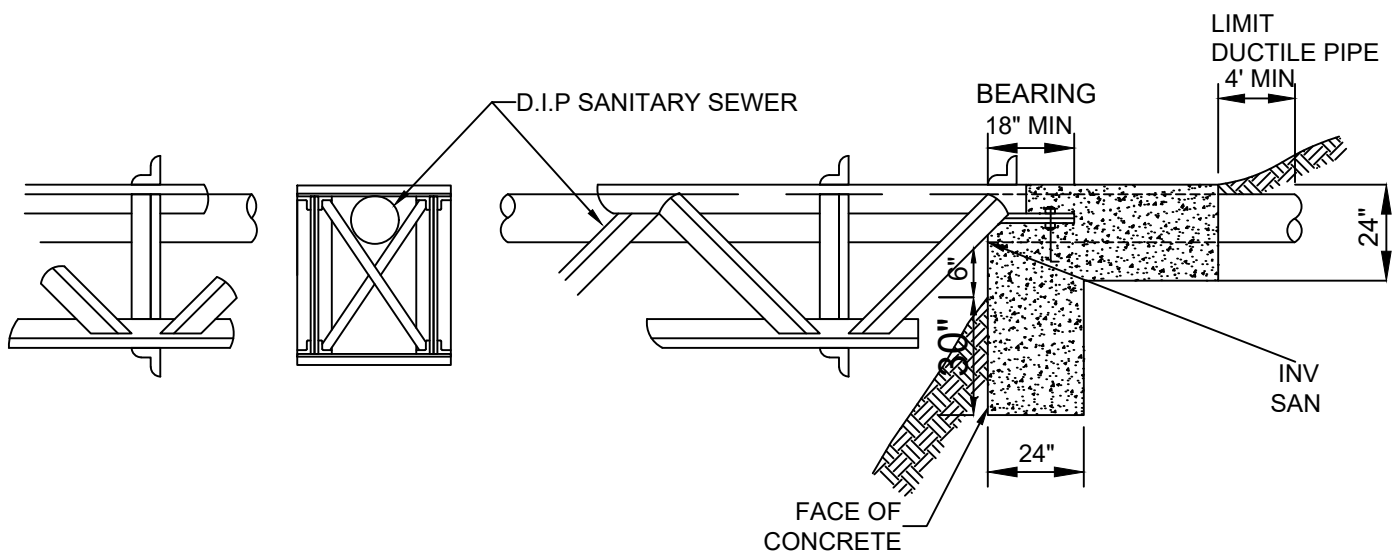

## ELEVATION

### NOTES:

1. STRUCTURAL DESIGN, CALCULATIONS, AND DRAWING SHALL BE PREPARED AND STAMPED BY AN OHIO REGISTERED PROFESSIONAL ENGINEER AND SUBMITTED TO THE COUNTY FOR REVIEW.
2. SUBMIT COMPLETE DRAWINGS INCLUDING, BUT NOT LIMITED TO:
  - a. COMPLETE DETAILS WITH STRUCTURAL SELECTION AND MATERIAL PROPERTIES FOR ALL PROPOSED SECTIONS (BEAMS, COLUMNS, DECKING, ETC.)
  - b. STRUCTURAL CALCULATIONS, PREPARED AND STAMPED BY AN OHIO REGISTERED PROFESSIONAL ENGINEER.
  - c. PROTECTIVE COATINGS.

## AERIAL SANITARY SEWER CROSSING


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-12**

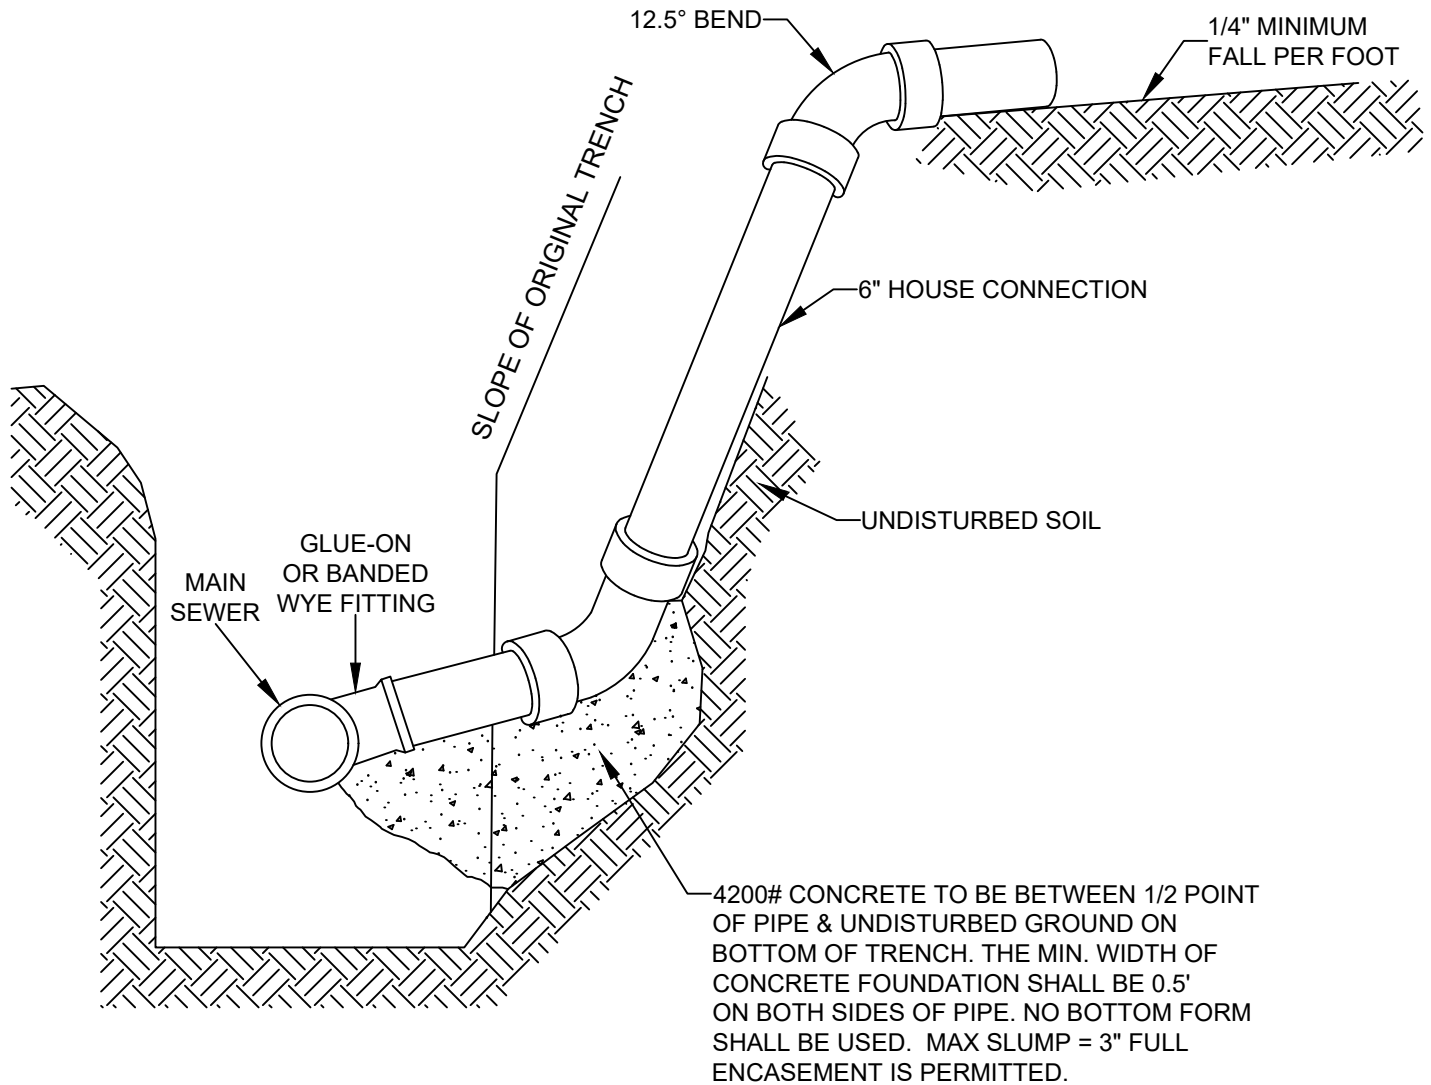

**NOTES:**

1. ALL JOINTS SHALL BE WATER TIGHT.
2. PIPE TO BE BEDDED SO THAT PIPE LOADS ARE NOT IMPOSED ON EXISTING WYES OR SADDLES.
3. EXCAVATION CLOSER THAN TWO FEET (2') FROM PIPE, WYES OR SADDLES SHALL BE DONE BY HAND.
4. DEEP HOUSE CONNECTION TO BE USED WHEN HOUSE CONNECTION IS MADE TO A SEWER DEEPER THAN 12'.

## DEEP HOUSE CONNECTIONS

APPROVED/REVISED


MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**S-13**

## TYPE "A"

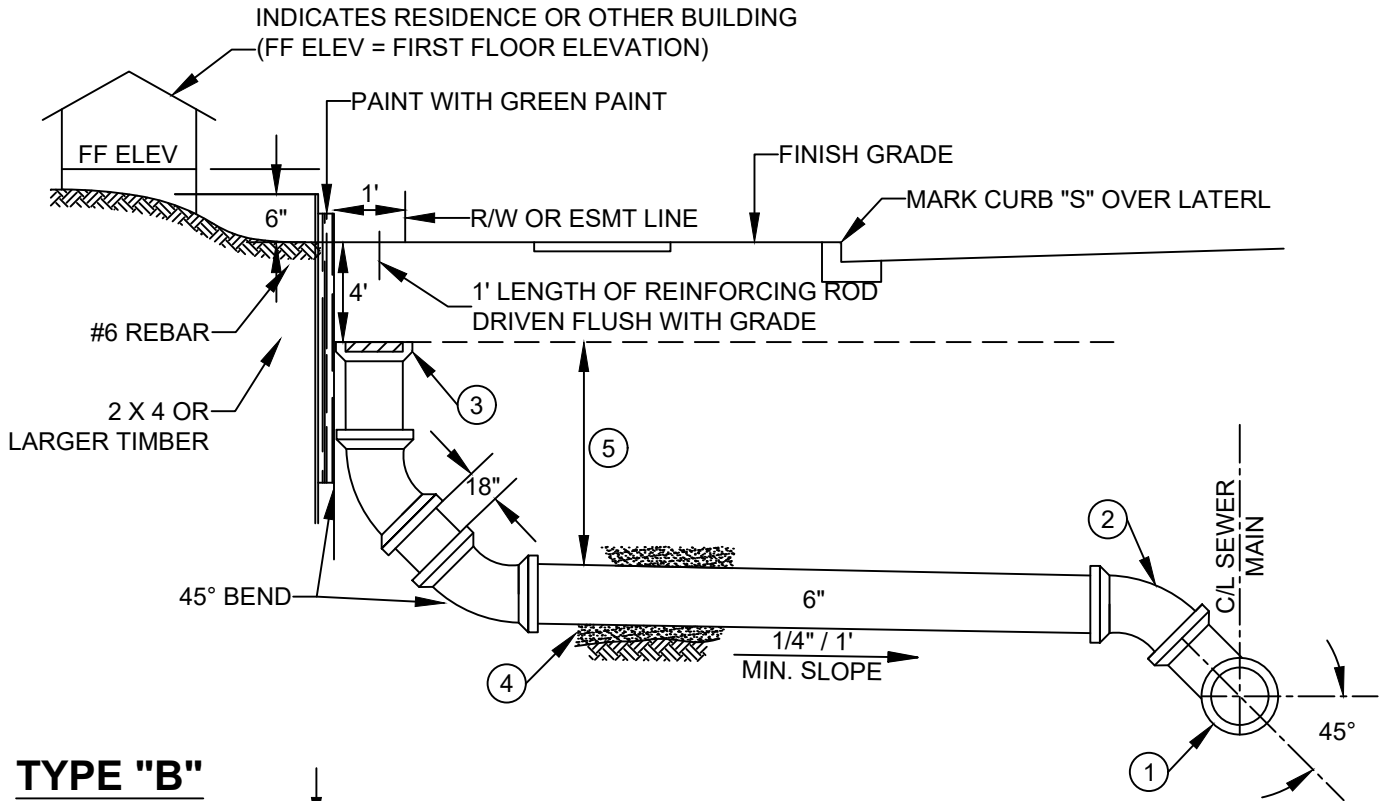

## TYPE "B"

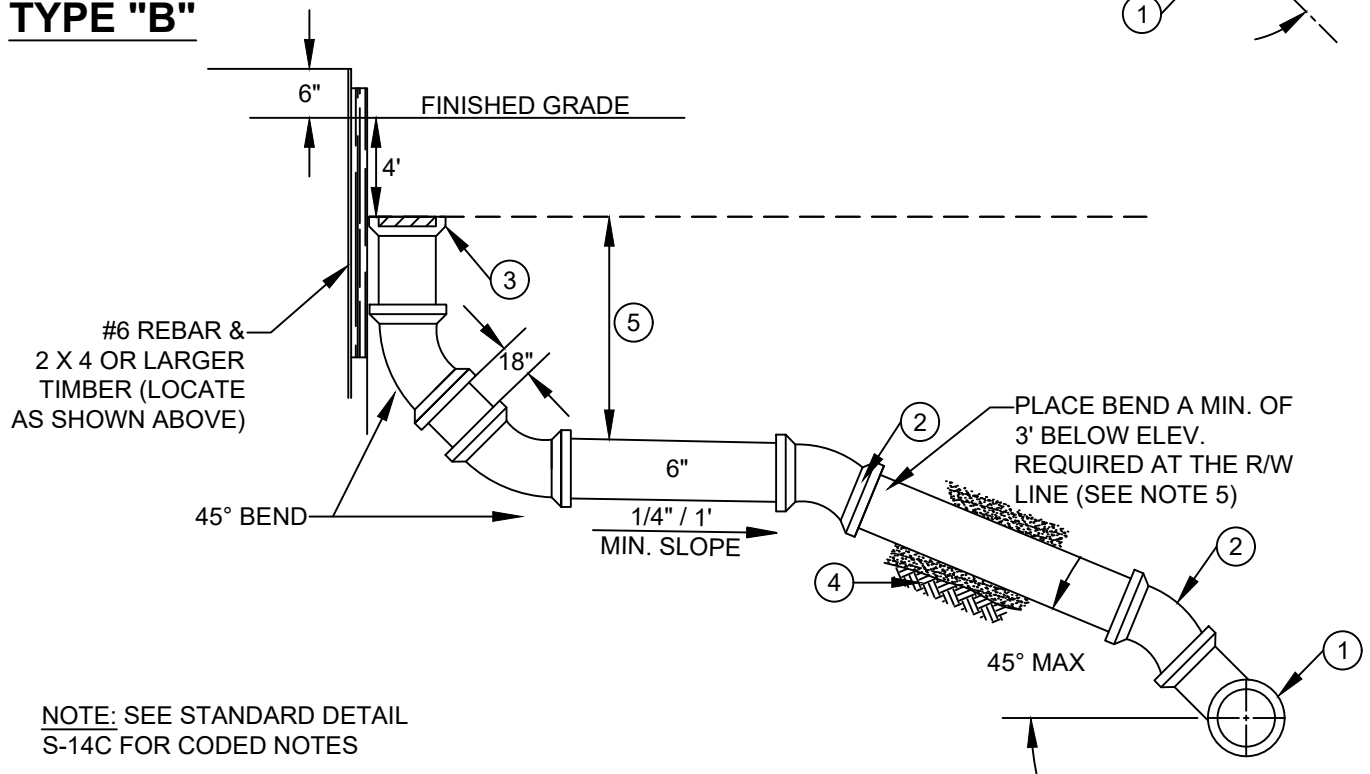

NOTE: SEE STANDARD DETAIL  
S-14C FOR CODED NOTES

## HOUSE CONNECTIONS

SHT 1 OF 3

APPROVED/REVISED


MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-14A**

## TYPE "C"

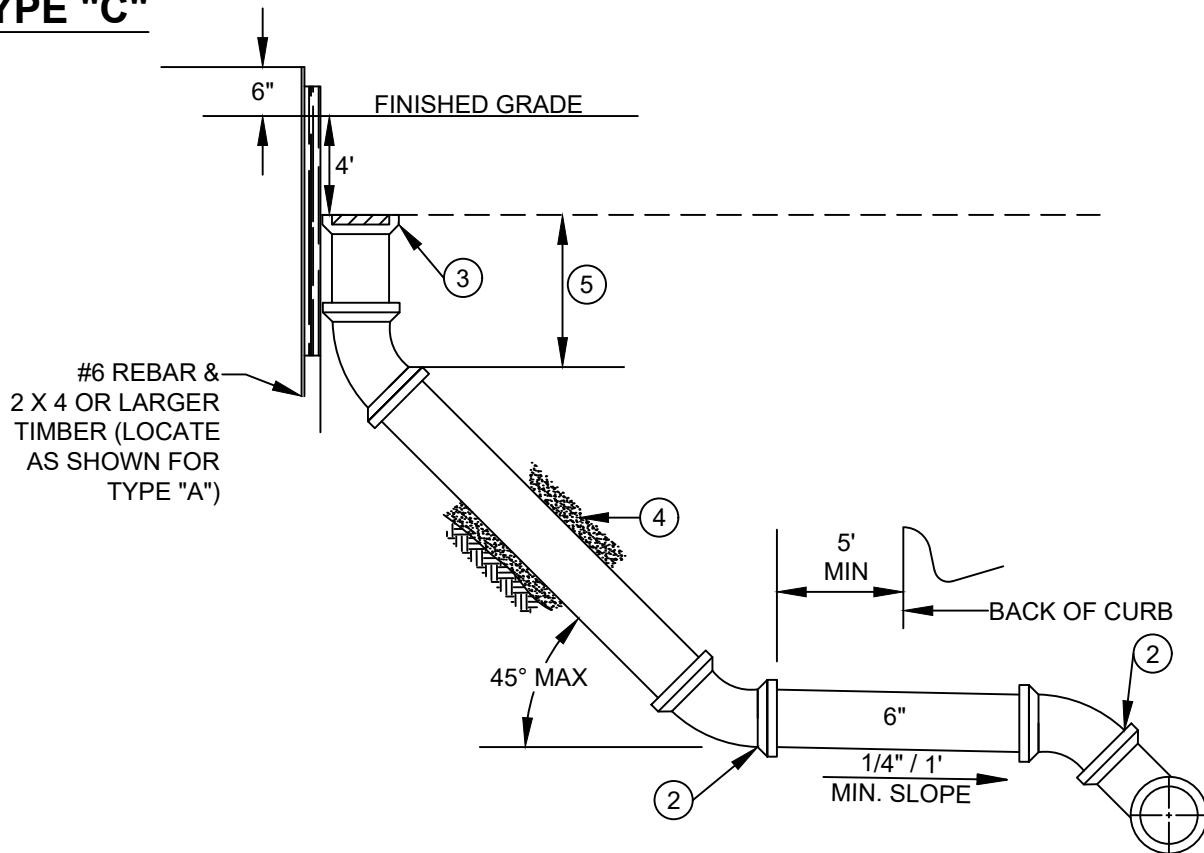

NOTE: SEE STANDARD DETAIL  
S-14C FOR CODED NOTES

## HOUSE CONNECTIONS

SHT 2 OF 3


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-14B**

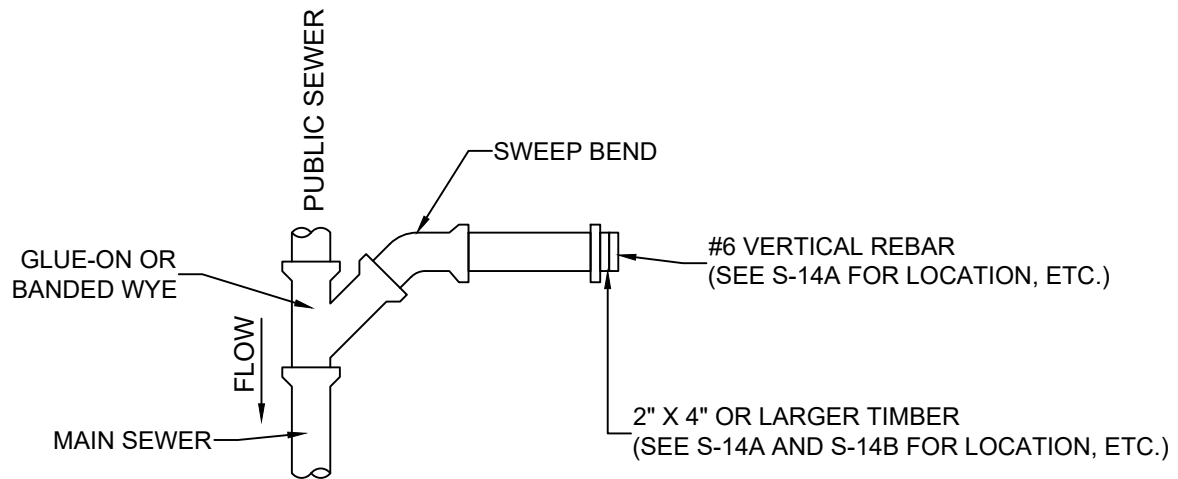

- ① 6" TEE OR WY - ROTATE 45° FROM HORIZONTAL WHEN ⑤ DIMENSION IS ATTAINABLE.
- ② 6" 1/8 BEND OR 1/16 BEND AS NEEDED.
- ③ CAP UNLESS JOINING EXISTING HOUSE LOCATION.
- ④ BED WITH 4" GRANULAR MATERIAL AND BACKFILL WITH GRANULAR MATERIAL TO 4" ABOVE PIPE.
- ⑤ 6' FOR HOUSES ON SLAB.  
8' FOR HOUSES WITH CRAWL SPACE.  
10' FOR HOUSES WITH BASEMENT.

**NOTE:**

- A. USE TYPE "B" WHEN SEWER INVERT ELEVATION IS 5' TO 10' BELOW THE ELEVATION REQUIRED AT R/W LINE.
- B. USE DEEP HOUSE CONNECTION (S-13) WHEN SEWER INVERT ELEVATION IS 10' OR MORE BELOW THE ELEVATION REQUIRED AT R/W LINE.
- C. IN ALL OTHER CASES USE TYPE "A" OR TYPE "C".

## HOUSE CONNECTIONS

SHT 3 OF 3

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-14C**



NOTE: TOP OF CASTING SHALL BE AT FINISHED GRADE AT PAVED LOCATIONS (ROADWAYS AND PARKING LOTS) AND AT DEVELOPED LOTS. IN UNDEVELOPED LOTS, TOP OF CASTING TO BE A MINIMUM OF 12" ABOVE FINISHED GRADE OR AS SHOWN ON PLAN.

MANHOLE COVER & FRAME TO BE NEENAH, E.J. OR APPROVED EQUAL. COVER TO BE LETTERED "SANITARY" OR "SANITARY SEWER". E.J. PART NOS. 00160041B01 SOLID LID R-1776 & R-1767-2001-1 CASTING

FINISHED GRADE

MANHOLE COVER & FRAME TO BE NEENAH, E.J. OR APPROVED EQUAL. COVER TO BE LETTERED "SANITARY" OR "SANITARY SEWER". E.J. PART NOS. 00160041B01 SOLID LID R-1776 & R-1767-2001-1 CASTING

ADJUST TO FINISHED GRADE WITH PRECAST CONCRETE COLLARS, PROVIDE 12" MAXIMUM ADJUSTMENT.

MANHOLE SHALL CONFORM TO ASTM SPECIFICATION C-478

WATERTIGHT GASKETS ARE REQUIRED AT ALL JOINTS (ASTM C-443 FOR RUBBER TYPE GASKET JOINTS.)

STANDARD  
MANHOLE STEPS  
ASTM D-4101

5' DIA.

CAULK WITH  
EXPANDING  
GROUT (TYP.)

2" HOSE CONNECTOR  
2" PLUG VALVE  
2" NIPPLE  
PLUG VALVES

FORCE MAIN

STRAIGHT COUPLING

FLANGED CROSS -  
RUN TO MATCH  
FORCEMAIN DIAMETER  
BRANCHES TO BE 4"

COMPANION  
FLANGE WITH  
4" PLUG

2'-6"

SLOPE

CLASS "A" CONCRETE

## FORCEMAIN CLEANOUT

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER


STANDARD NUMBER

**S-15**

NOTE: TOP OF CASTING SHALL BE AT FINISHED GRADE AT PAVED LOCATIONS (ROADWAYS AND PARKING LOTS) AND AT DEVELOPED LOTS. IN UNDEVELOPED LOTS, TOP OF CASTING TO BE A MINIMUM OF 12" ABOVE FINISHED GRADE OR AS SHOWN ON PLAN.

MANHOLE SHALL CONFORM TO ASTM SPECIFICATION C-478

MANHOLE COVER & FRAME TO BE NEENAH, E.J. OR APPROVED EQUAL. COVER TO BE LETTERED "SANITARY" OR "SANITARY SEWER". E.J. PART NOS. 00160041B01 SOLID LID R-1776 & R-1767-2001-1 CASTING

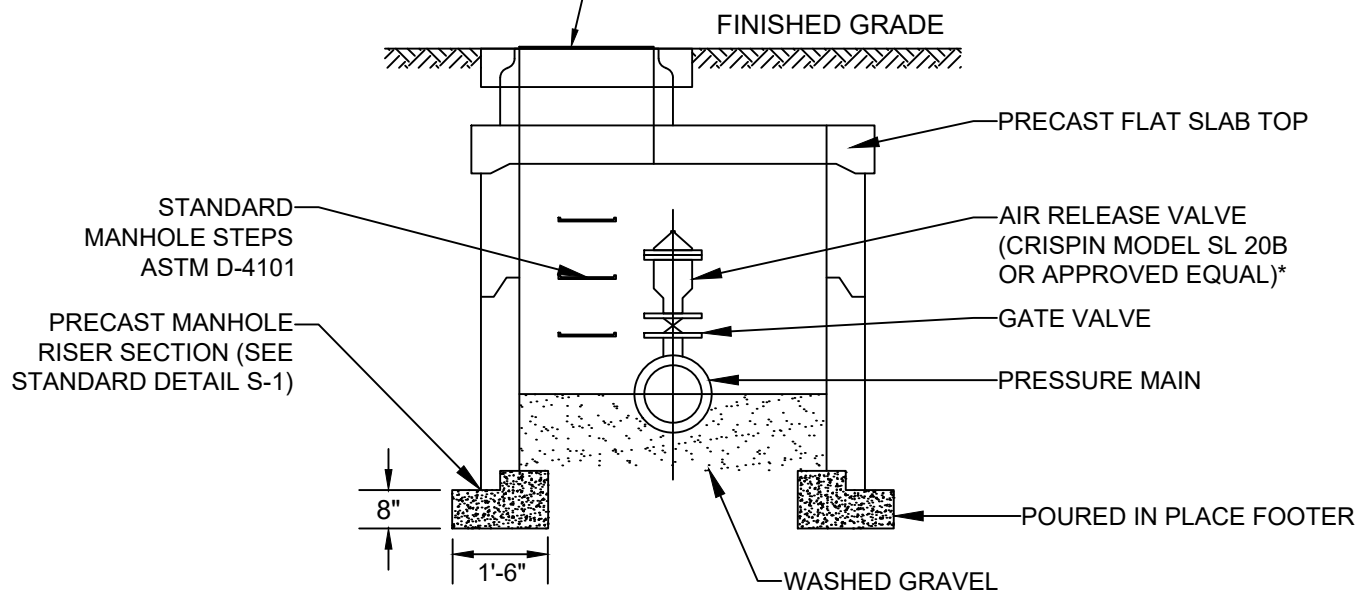

NOTE: IN WET AREAS SEAL BOTTOM WITH POURED CONCRETE BASE OR PRECAST MANHOLE BASE.

ADJUST TO FINISH GRADE WITH PRECAST CONCRETE COLLARS - 12" MAX ADJUSTMENT.

\* MODEL NUMBER MAY VARY DEPENDING ON APPLICATION

WATERTIGHT GASKETS ARE REQUIRED AT ALL JOINTS (ASTM C-443 FOR RUBBER TYPE GASKET JOINTS).

## AIR RELEASE VALVE ASSEMBLY

APPROVED/REVISED


MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-16**

# **PLAN VIEW** NOT TO SCALE

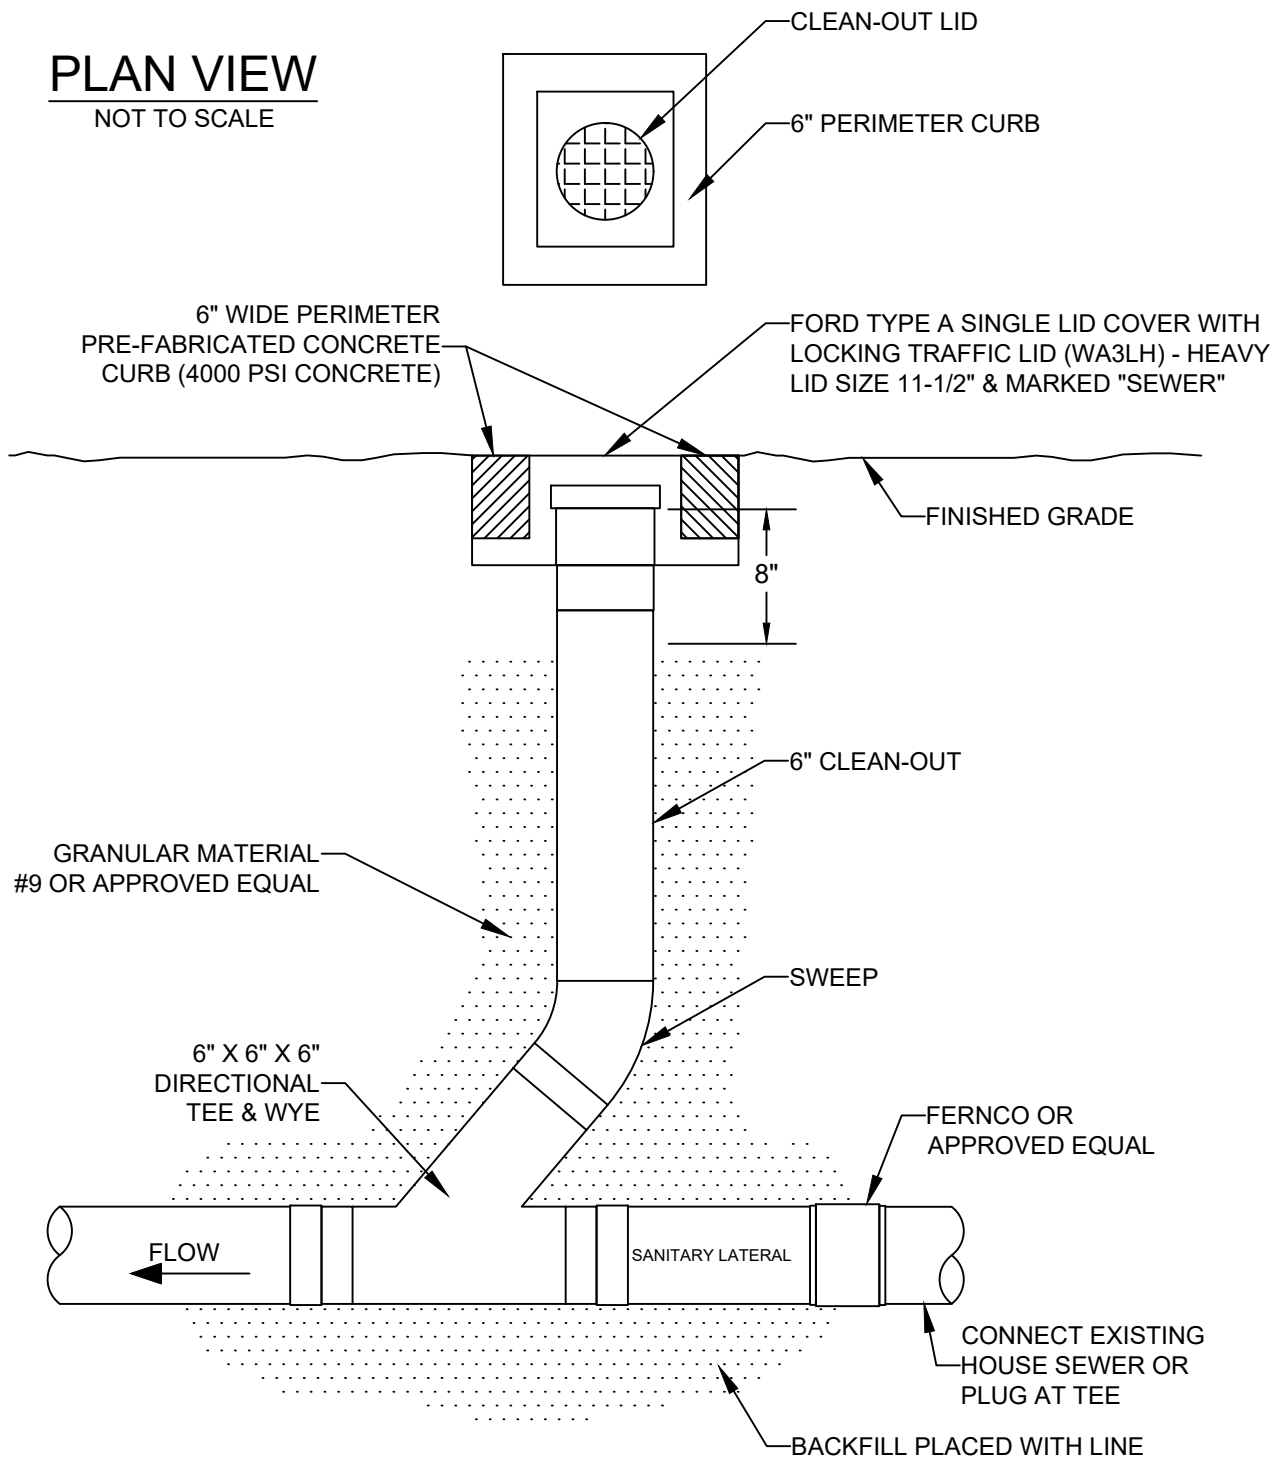

## **NOTES:**

CLEANOUTS SHALL BE INSTALLED AT ALL 45° BENDS.

ALL STRUCTURES MUST HAVE A CLEANOUT THAT IS ACCESSIBLE WITHIN TWO FEET (2') FROM THE POINT OF ENTRY INTO THE STRUCTURES.

## **SANITARY CLEANOUT**


APPROVED/REVISED

MARCH, 2018

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-17**

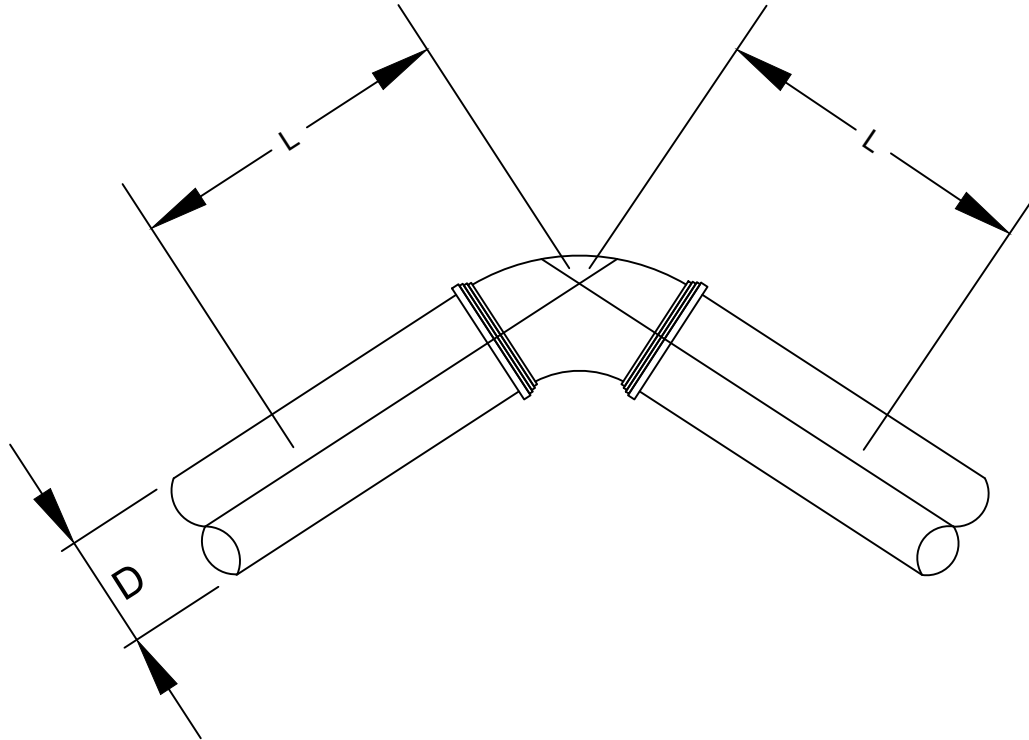

MINIMUM 60' OF RESTRAINED JOINT PIPE (RJP) IS REQUIRED BEFORE AND AFTER ALL HORIZONTAL AND VERTICAL BENDS. REFER TO TABLE BELOW.

RESTRAINT OPTIONS:  
 MECHANICAL JOINT W/MEGALUGS ~ ALL SIZES OF PIPE  
 MJ FIELD LOCKS ~ < 24" PIPE

TABLE  
 REQUIRED LENGTH OF RESTRAINED JOINTS  
 D - DIAMETER OF PIPE  
 L - LENGTH OF PIPE

D	4"	6"	8"	10"	12"	16"	20"	24"
L	60'	60'	60'	60'	66'	98'	125'	145'

**NOTES:**

1. ALL HORIZONTAL AND VERTICAL BENDS SHALL BE LABELED WITH STATIONING.
2. LABEL LIMITS OF REQUIRED RESTRAINED JOINTS WITH STATIONING.

## REQUIRED RESTRAINED JOINTS FOR FORCEMAIN BENDS


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
 DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-18**

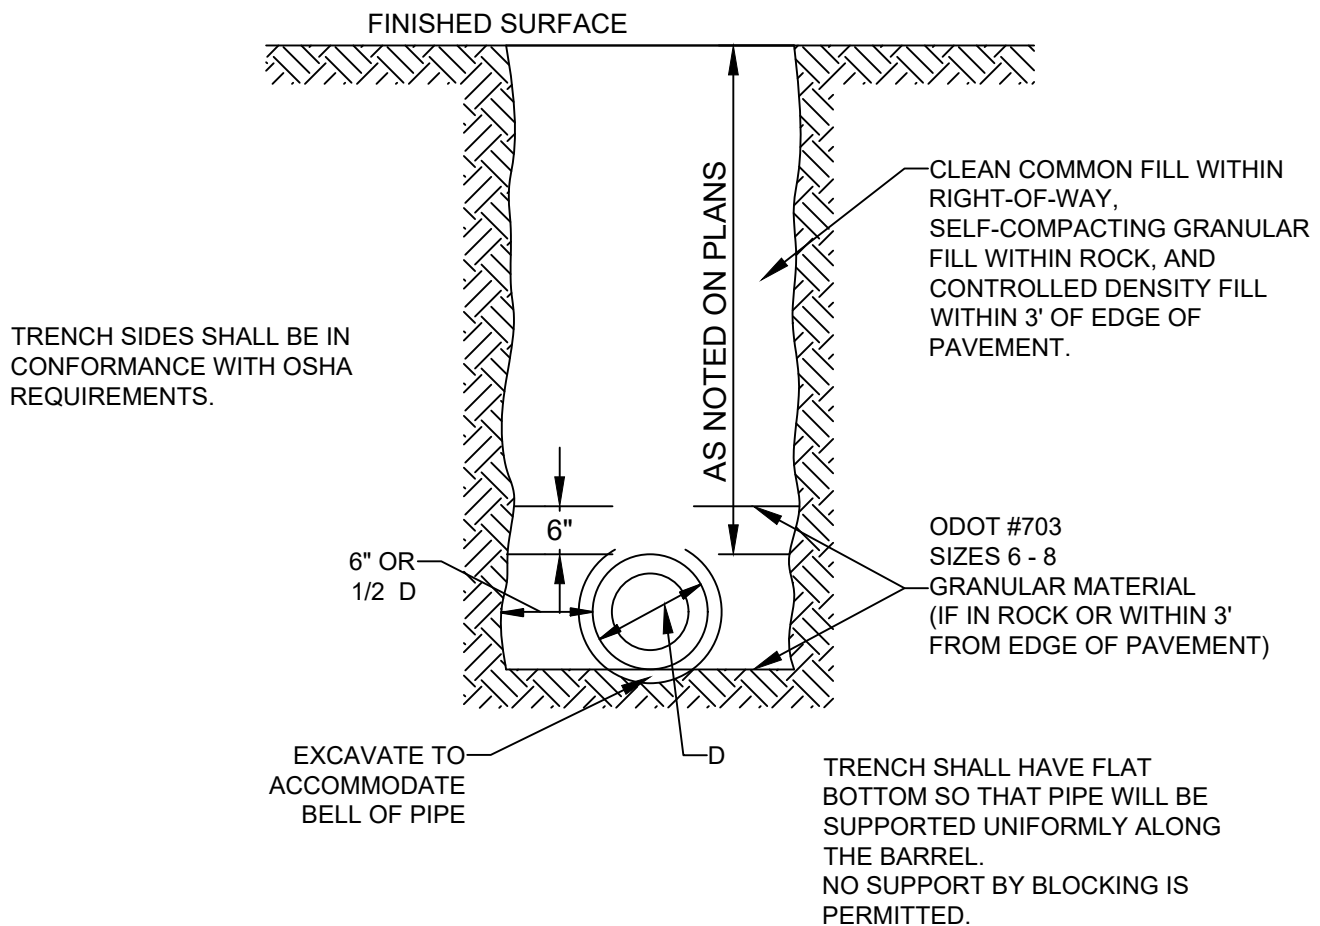

## FORCEMAIN TRENCH DETAIL


APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-19**

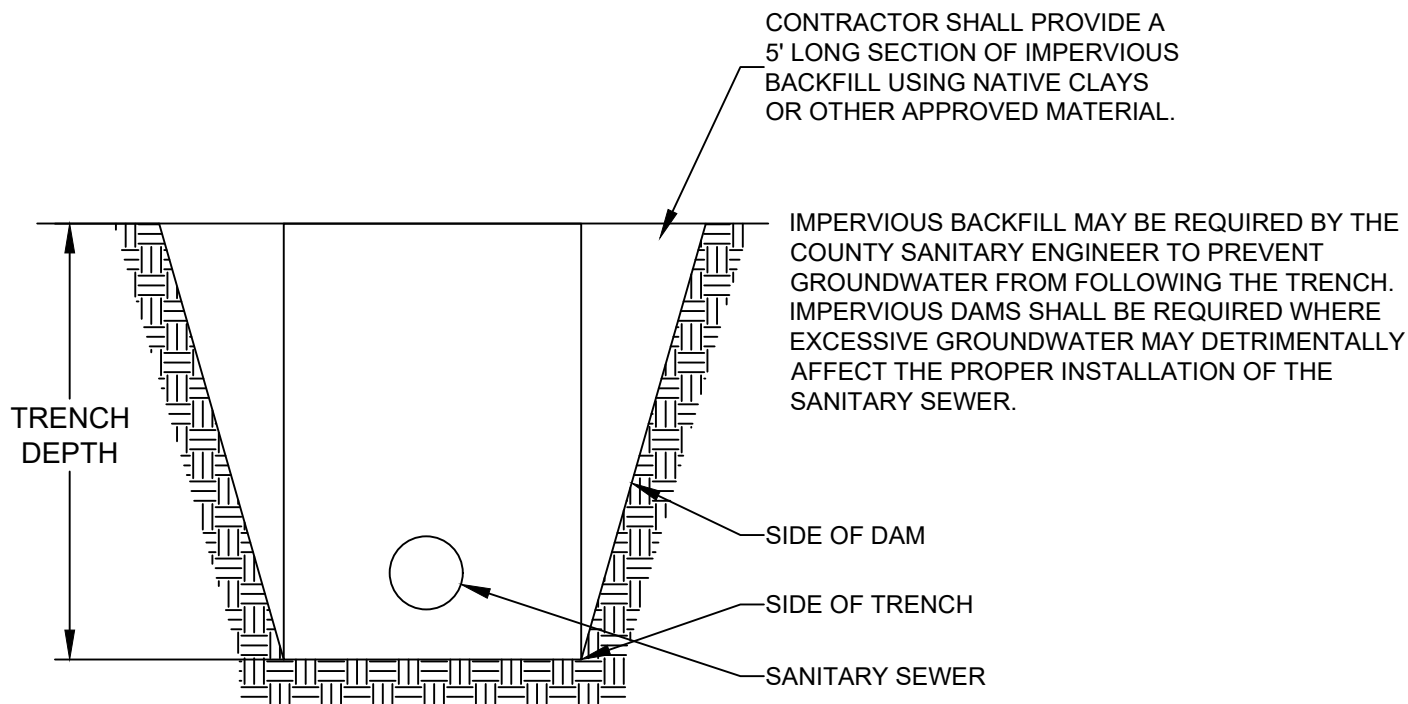

IMPERVIOUS DAM DETAIL ELEVATION

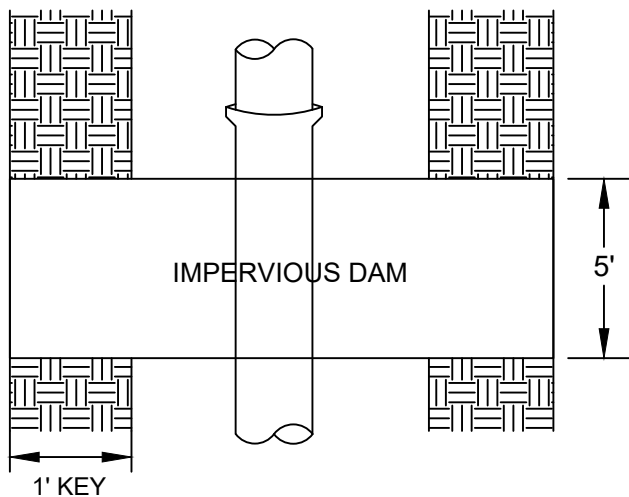

DAM PLAN

THE CONTRACTOR SHALL PLACE CUTOFF TRENCH DAMS OF NATIVE CLAY OR IMPERVIOUS SOIL ACROSS AND ALONG THE TRENCH AS SPECIFIED BY THE COUNTY SANITARY ENGINEER.

THE TRENCH DAMS SHALL BE CAREFULLY COMPACTED AND SHALL BE 5 FEET IN LENGTH (MEASURED ALONG THE TRENCH CENTERLINE) AND SHALL BE BENCHED INTO THE UNDISTURBED TRENCH SIDES.

## IMPERVIOUS DAM DETAIL



APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-20**

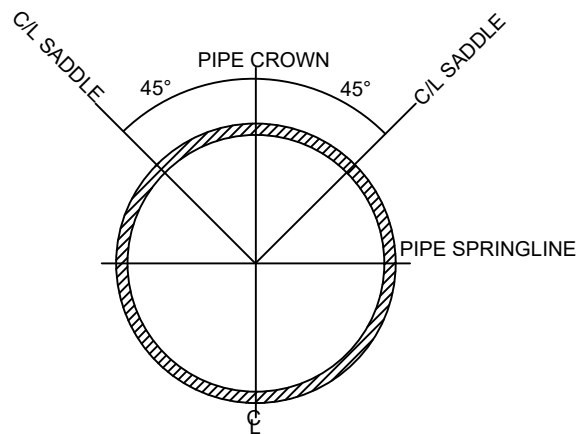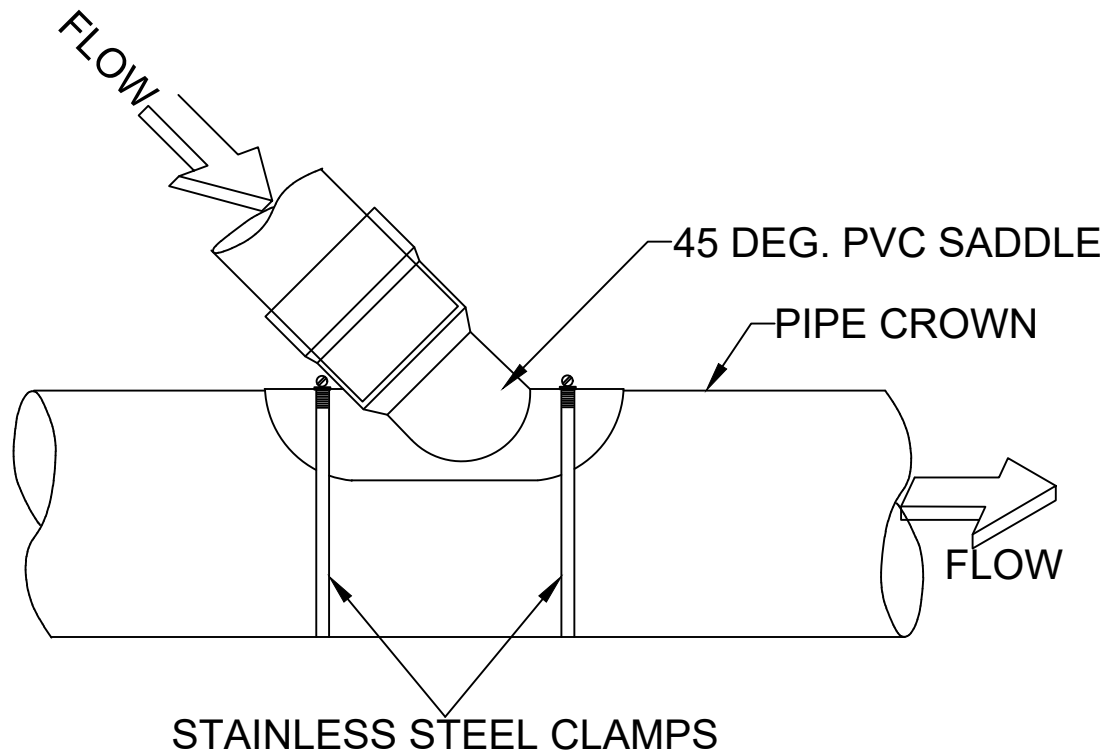

## LATERAL SADDLE INSTALLATION DETAIL FOR PVC PIPE


APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-21**

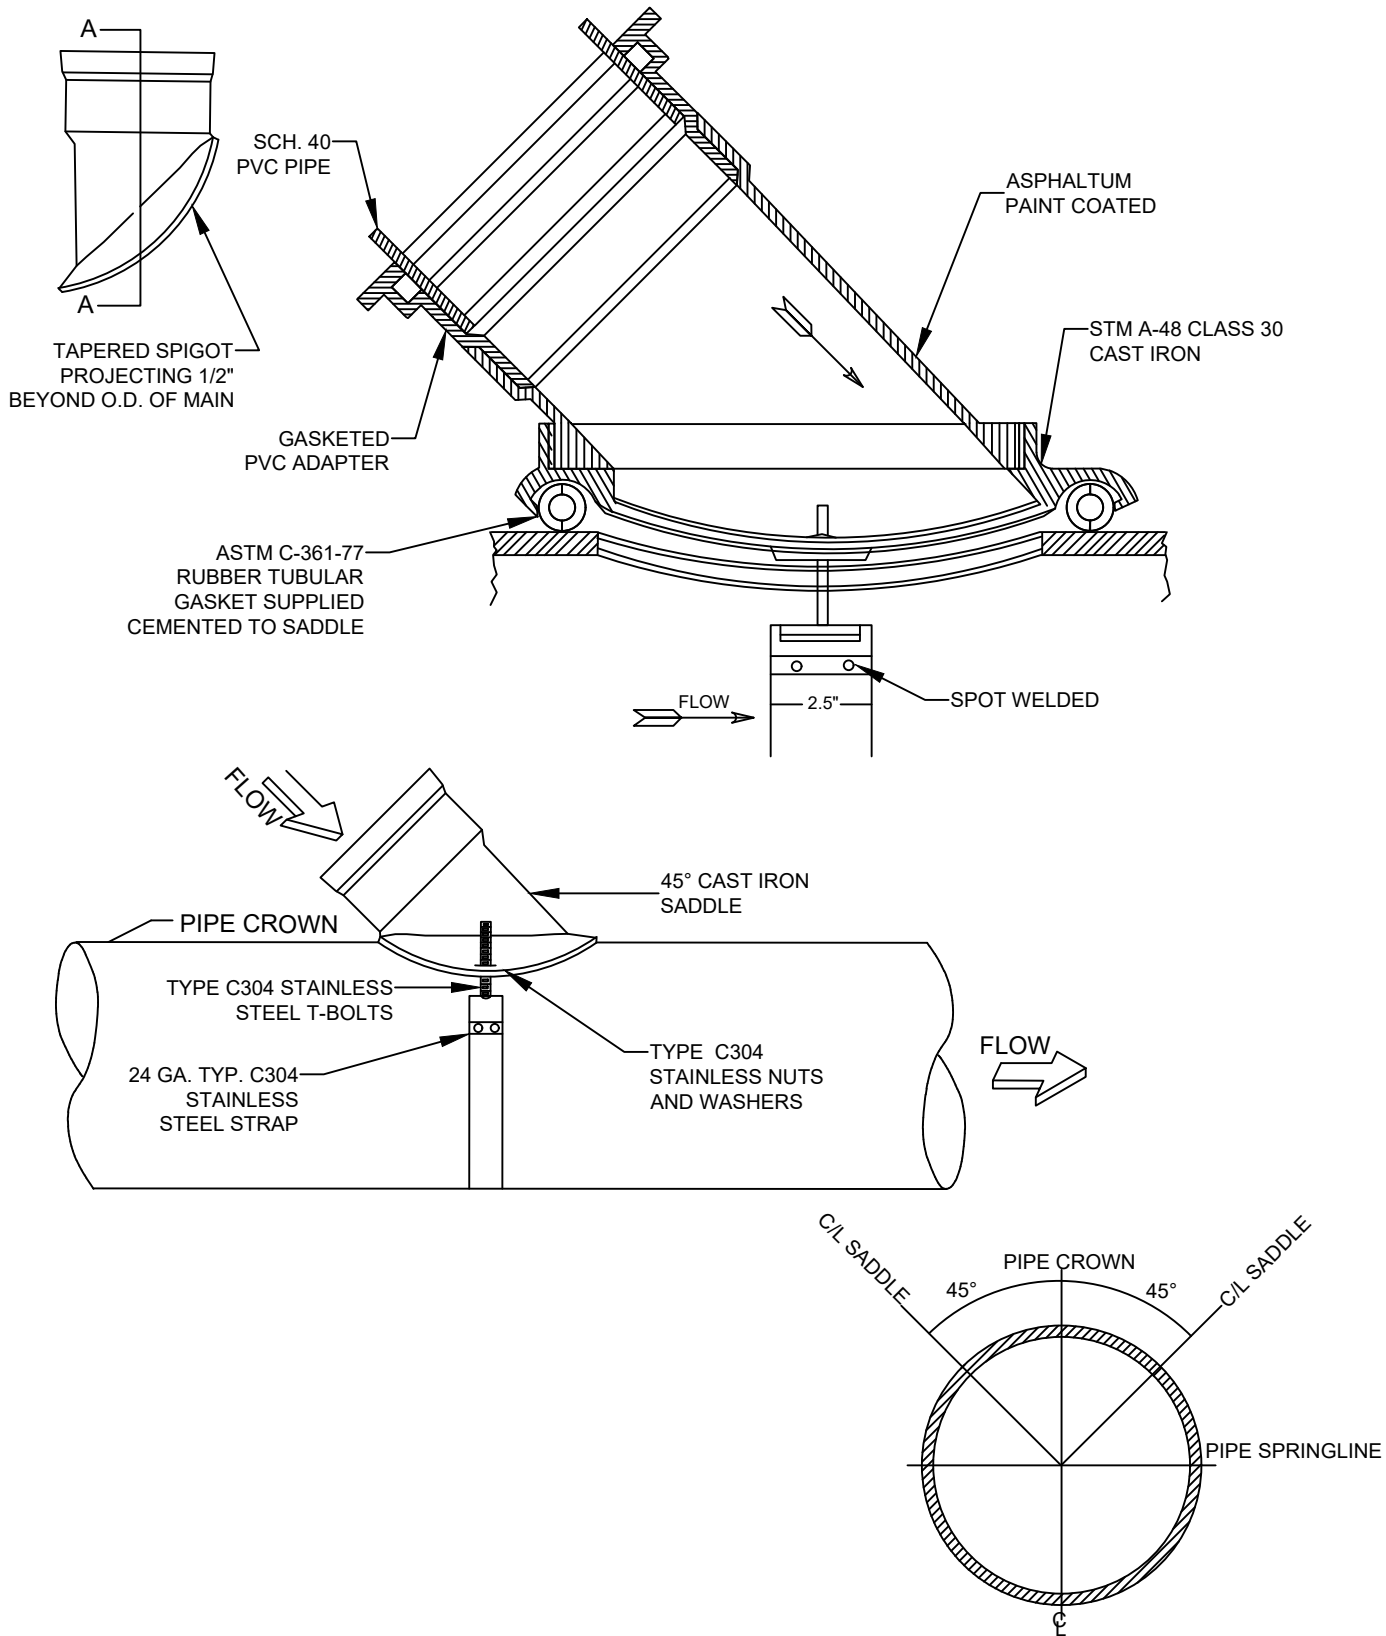

## LATERAL SADDLE INSTALLATION FOR VCP & DUCTILE IRON PIPE

APPROVED/REVISED

MAY, 2023


WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER


**S-22**



## BASE UNIT INSTALLMENT

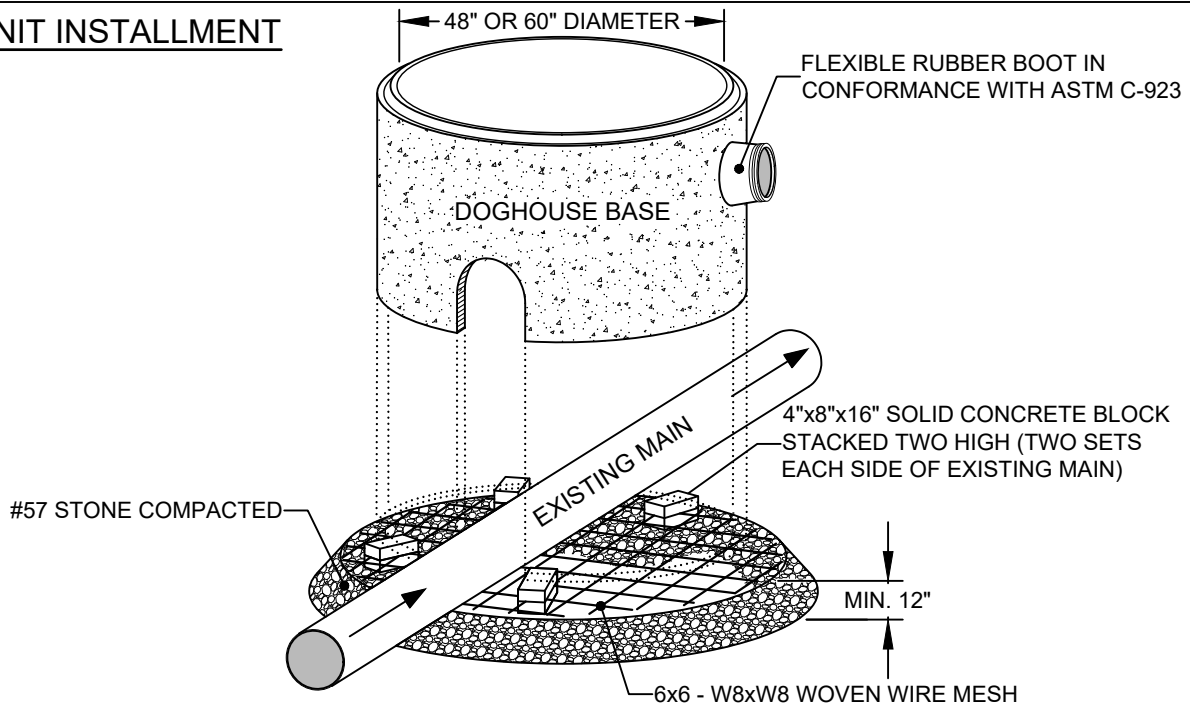

## INVERT INSTALLMENT

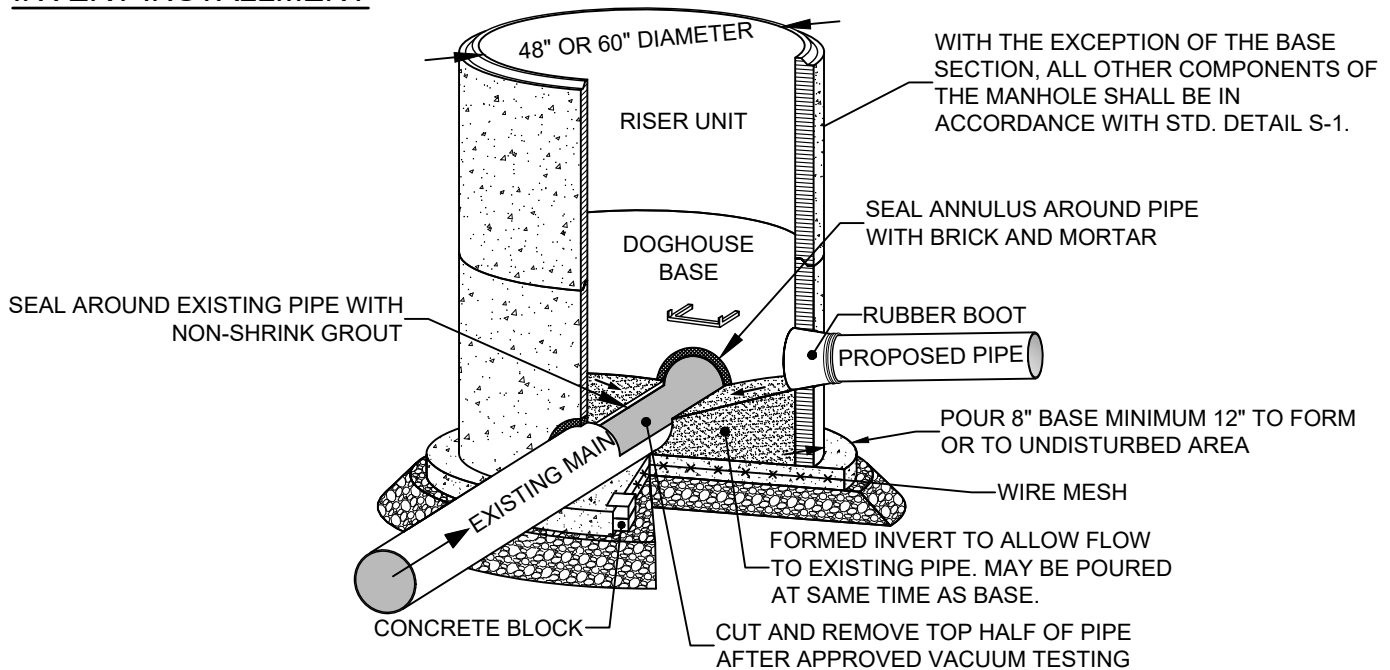

### NOTES:

1. DOGHOUSE OPENINGS IN PRECAST UNITS SHALL HAVE A RADIUS OF 4 TO 8 INCHES LARGER THAN THE EXISTING PIPE DIAMETER.
2. CAST-IN-PLACE CONCRETE SHALL BE 4000 PSI, PER ASTM C-94.
3. ALL PRECAST MANHOLE COMPONENTS SHALL MEET ASTM C-478.
4. BENCH SHALL SLOPE UPWARD FROM THE SPRINGLINE TO THE PROJECTED LEVEL OF THE PIPE CROWN OR 8 INCHES ABOVE THE SPRINGLINE, WHICHEVER IS LESS.

## STANDARD PRECAST CONCRETE DOGHOUSE MANHOLE

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**S-23**

## DETAILED PROCEDURES FOR SANITARY SEWER

### PROCEDURES FOR MAKING SEWER LATERAL CONNECTIONS TO EXISTING SEWER:

- A. IF ABS COMPOSITE
  - 1. EXCAVATE TO POINT OF LATERAL ON MAIN.
  - 2. CLEAN EXISTING PIPE.
  - 3. ALIGN SADDLE TO PROPER POSITION AND MARK AREA TO BE CUT.
  - 4. CUT HOLE IN PIPE AS REQUIRED MAKING SURE THE CUT OUT DOESN'T ENTER THE MAIN.
  - 5. ATTACH AND SEAL SADDLE WITH STAINLESS STEEL STRAPS AND MASTIC SEALER BETWEEN SADDLE AND PIPE. INSERTA TEES ARE NOT PERMITTED.
- B. IF CLAY OR CONCRETE
  - 1. EXCAVATE TO POINT OF LATERAL ON MAIN.
  - 2. PLUG OUTLET PIPE AT UPSTREAM MANHOLE - PUMP TO DOWNSTREAM MANHOLE IF NECESSARY. REMOVE CLOSEST LENGTH OF PIPE AND REPLACE WITH TEE LATERAL SECTION OF PIPE OR CORE EXISTING MAIN.

### PROCEDURE FOR MAKING SEWER EXTENSIONS FROM EXISTING MANHOLES:

- A. CONSTRUCT LINE TO WITHIN ONE JOINT OF EXISTING MANHOLE.
- B. AFTER LINE PASSES LEAKAGE TEST AND WARREN COUNTY SANITARY ENGINEER GIVES GO AHEAD - CONNECTION IS TO BE MADE.
- C. PLUG OUTLET PIPE AT UPSTREAM MANHOLE - PUMP TO DOWNSTREAM MANHOLE IF NECESSARY.
- D. A HOLE IS CUT AT THE PROPOSED INLET POINT AND THE LAST JOINT IS LAID.
- E. EXISTING BENCH AND CHANNEL OF MANHOLE IS REBUILT AND SHAPED AS REQUIRED.
- F. NEW CONNECTION IS TO BE SEALED AS REQUIRED.

### PROCEDURE FOR MAKING NEW MANHOLES ON EXISTING SEWER MAINS:

- A. EXCAVATE AND EXPOSE EXISTING SEWER AT POINT OF NEW MANHOLE.
- B. BUILD MANHOLE OVER EXISTING LINE WILL NOT DISTURBING EXISTING LINE.
- C. BUILD NEW LINE(S) FROM NEW MANHOLE.
- D. AFTER NEW LINE(S) PASS(ES) LEAKAGE TEST AND WARREN COUNTY SANITARY ENGINEER GIVE GO AHEAD - PLUG OUTLET PIPE AT EXISTING UPSTREAM MANHOLE (PUMP TO EXISTING DOWNSTREAM MANHOLE IF NECESSARY).
- E. BREAKOUT TOP OF EXISTING SEWER AS REQUIRED AND FORM A BENCH AND CHANNEL AS REQUIRED.

### STORM WATER AND EXTRANEIOUS FLOWS:

- A. STORM WATER AND EXTRANEIOUS FLOWS ARE PROHIBITED FROM ENTERING THE EXISTING SYSTEM DURING CONSTRUCTION.
- B. NO OPEN CUT TRENCHES WILL BE ALLOWED TO REMAIN OPEN OVERNIGHT.
- C. STORM DRAINS, DIVERSION DITCHES, PUMPS, ETC., SHALL BE USED AS REQUIRED TO MAINTAIN THE INTEGRITY OF THE SYSTEM AT ALL TIMES.

### SANITARY SEWER BEDDING:

- A. ALL SANITARY SEWER PIPE MUST BE BEDDED WITH NUMBER 57 STONE EXTENDING FROM A POINT NOT LESS THAN 6" BELOW THE BOTTOM OF THE PIPE TO THE SPRINGLINE OF THE PIPE.
- B. BACKFILL WITH NUMBER 9 GRITS FROM THE SPRINGLINE TO A POINT NOT LESS THAN 12" ABOVE THE CROWN OF THE PIPE.
- C. BEDDING SHALL PROVIDE A UNIFORM SUPPORT ALONG THE ENTIRE PIPE BARREL, WITHOUT LOAD CONCENTRATION AT JOINT COLLARS OR BELLS.
- D. BEDDING DISTURBED BY PIPE MOVEMENT OR BY REMOVAL OF SHORING OR MOVEMENT OF THE TRENCH SHIELD OR BOXY SHALL BE RECONSOLIDATED PRIOR TO BACKFILL.
- E. BEDDING TO BE COMPACTED TO 95% PROCTOR.

APPROVED/REVISED	WARREN COUNTY STANDARD DETAILS	STANDARD NUMBER
MAY, 2023	DEPARTMENT OF WATER & SEWER	<b>SG-1</b>

## GENERAL NOTES - SANITARY SEWER

1. ALL SANITARY PIPE SHALL CONFORM TO THE FOLLOWING:
  - A. ASTM D-2680 FOR ABS/PVC GASKETED COMPOSITE PIPE (TRUSS)
  - B. ASTM D-3034 FOR SDR 26 GASKETED 4" - 15" DIAMETER
  - C. ASTM F-679 FOR SDR 26 GASKETED 18" - 30" DIAMETER
  - D. PIPE LARGER THAN 15" SHALL CONFORM TO ASTM F-9494 (A2000) OR ASTM F-1803.
2. CERAMIC COATED CLASS 53 DUCTILE IRON PIPE OR EQUAL MUST BE USED WHERE SPECIFIED BY THE COUNTY SANITARY ENGINEER.
3. JOINTS FOR PVC GRAVITY SEWER SHALL BE PUSH-ON TYPES WITH RUBBER GASKETS. PIPE ENDS SHALL NOT BE BEVELED. PIPE ENDS MUST BE SEALED.
4. ROOF DRAINS, FOUNDATION DRAINS, AND OTHER STORM WATER CONNECTIONS TO THE SANITARY SYSTEM ARE PROHIBITED.
5. NO MANHOLE OR ANY PORTION OF THE MANHOLE, SHALL BE LOCATED UNDER A SIDEWALK OR DRIVEWAY.
6. SANITARY SEWER LATERALS SHALL BE CONSTRUCTED OF THE FOLLOWING MATERIALS.
  - A. ABS PIPE - ASTM d-2751 WITH SDR 23.5 (6" GLUE JOINT)
  - B. PVC PIPE - ASTM D-3034 WITH 23.5 (6" GLUE OR GASKET JOINT)  
ASTM D-2665 SCHEDULE 40  
ASTM D-3034 WITH SDR 35 (6" ONLY)
  - C. DUCTILE IRON - CLASS 53 (6")
7. SEWER LATERAL LOCATION :
  - A. SEWER LATERALS MUST BE EXTENDED TO THE HOUSE SIDE OF UTILITY EASEMENTS.
  - B. SEWER LATERALS SHALL BE MARKED BY TWO INCHES BY FOUR INCHES (2" X 4") OR LARGER POSTS. POSTS SHALL BE PAINTED GREEN.
  - C. A SIX FOOT (6') LENGTH OF #6 REINFORCED BAR SHALL BE INSTALLED AGAINST THE POST.
  - D. END OF SEWER LATERAL SHALL NOT EXCEED 4' IN DEPTH UNLESS APPROVED BY THE COUNTY SANITARY ENGINEER.
  - E. SEE DETAILS S-14A , S-14B, AND S-14C.
8. ONLY SANITARY WYES WITH 45° BENDS SHALL BE USED FOR SANITARY LATERAL INSTALLATION. ALL WYES TO BE GLUE JOINTS ON TRUSS AND COMPOSITE PIPE. ALL SANITARY LATERALS MUST BE SIX INCHES (6") IN DIAMETER WITHIN THE RIGHT-OF-WAY. NO CONNECTION SHALL BE MADE TO THE CROWN OF THE SEWER MAIN.
9. ALL LATERALS TO BE NOT LESS THAN SIX INCHES (6") INSIDE DIAMETER.
10. THE LOCATION OF SEWER LATERALS MUST BE STAMPED IN THE CURB AT THE TIME THE CURB IS PLACED TO PERMANENTLY INDICATE THE LOCATION OF SAID LATERALS.
11. THE LOCATION OF ALL SEWER LATERALS MUST BE PROVIDED ON THE AS-BUILT PLANS.
12. MANHOLE LATERALS SHALL HAVE AN INVERT TWO INCHES (2") ABOVE MAIN-LINE INVERTS.
13. EXISTING MANHOLE CASTING ARE TO BE RAISED BY EITHER A MANHOLE ADJUSTING RING OR A BARREL SECTION ADDED. IF THE HEIGHT OF NECESSARY ADJUSTMENT IS OVER ONE FOOT (1') OR THERE IS ALREADY AN EXISTING ADJUSTMENT RING BEING USED, THE CONTRACTOR IS TO USE A NEW BARREL SECTION ONLY. EXTRA CARE IS TO BE TAKEN TO INSURE A PROPER AND TIGHT SEAL AT ALL NEW JOINTS.

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**SG-2A**

## GENERAL NOTES - SANITARY SEWER (CONTINUED)

14. THE CONTRACTOR MUST INSTALL MECHANICAL PLUG(S) AT THE POINT(S) OF CONNECTION TO EXISTING SEWER PRIOR TO INITIATING ANY CONSTRUCTION. THE MECHANICAL PLUG(S) SHALL REMAIN IN PLACE UNTIL THE NEW MAINS HAVE BEEN FLUSHED, CLEANED, TESTED, TELEVISED, AND APPROVED FOR USE BY WARREN COUNTY SANITARY ENGINEER. THE MECHANICAL PLUG(S) CAN ONLY BE REMOVED IN THE PRESENCE OF A WARREN COUNTY SEWER INSPECTOR.
15. TRENCH SAFETY IS THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR MUST INSURE THAT ALL APPLICABLE OSHA OPEN TRENCH SAFETY REQUIREMENTS ARE FOLLOWED. IT IS NOT WARREN COUNTY'S RESPONSIBILITY TO INSPECT EACH SITE FOR COMPLIANCE.
16. HDPE PIPE MAY ONLY BE USED FOR DIRECTIONAL BORING OF FORCE MAINS WITH APPROVAL FROM THE COUNTY SANITARY ENGINEER. ALL DIRECTIONAL BORING SHOULD BE ACCOMPANIED BY DRILLING LOGS AT 25' STATION INCREMENTS, PVC PIPE SHALL BE PERMITTED FOR FORCE MAINS SIX INCHES (6") OR SMALLER IN DIAMETER. FORCE MAINS EIGHT INCHES (8") OR LARGER MUST BE CLASS 53 DUCTILE IRON WITH AN INTERIOR LINING OF EPOXY OR CERAMIC. PVC SHALL CONFORM TO AWWA C900 REQUIREMENTS AND HAVE AN EQUIVALENT OUTSIDE DIAMETER OF DR 14.
17. MINIMUM SLOPE SHALL BE AS FOLLOWS:

<u>PIPE SIZE</u>	<u>MINIMUM SLOPE (%)</u>
6"	2.00
8"	.50
10"	.35
12"	.28
15"	.19
18"	.15

18. ALL MATERIALS USED SHALL BE DOMESTIC, MADE IN THE UNITED STATES OF AMERICA.

APPROVED/REVISED

MAY, 2023

WARREN COUNTY STANDARD DETAILS  
DEPARTMENT OF WATER & SEWER

STANDARD NUMBER

**SG-2B**

## PIPE CONNECTIONS INTO MANHOLES

SEWER PIPE TO MANHOLE CONNECTIONS ON ALL SANITARY SEWERS SHALL BE FLEXIBLE AND WATERTIGHT. SEWER PIPE SHALL BE SEALED IN THE MANHOLE SECTION PIPE OPENINGS WITH A RESILIENT CONNECTOR MEETING THE REQUIREMENTS OF ASTM C923. THE CONNECTION MAY BE ANY OF THE FOLLOWING TYPES:

1. RUBBER SLEEVE WITH STAINLESS STEEL BANDING
  - A. KOR-N-SEAL AS MANUFACTURED BY POLLUTION CONTROL SYSTEMS, INC.
  - B. LOCK JOINT FLEXIBLE MANHOLE SLEEVE AS MANUFACTURED BY INTERSPACE CORPORATION.
  - C. OR EQUAL.
2. RUBBER GASKET COMPRESSION
  - A. PRESS WEDGE II AS MANUFACTURED BY PRESS-SEAL GASKET CORPORATION.
  - B. DURA-SEAL AS MANUFACTURED BY DURA TECH, INC.
  - C. OR EQUAL.

RESILIENT CONNECTOR SHALL BE CAST INTEGRALLY INTO THE WALL OF THE MANHOLE SECTION AT TIME OF MANUFACTURE OR SHALL BE INSTALLED BY MECHANICAL MEANS IN OPENING CUT INTO MAHOLE WALL PER ASTM C923.

ANY CONNECTION TO AN EXISTING MANHOLE MUST BE MADE BY CORING THE MANHOLE. ANY CORE TO A MANHOLE MUST BE CENTERED IN THE BARREL SECTION. NO CORE SHALL BE MADE ALONG THE SEAM OF THE BARREL SECTION(S).

APPROVED/REVISED  MARCH, 2018	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>SG-3</b>

## SEWER TESTING

1. THE CONTRACTOR MUST INSTALL MECHANICAL PLUG(S) AT THE POINT(S) OF CONNECTION TO THE EXISTING SEWER PRIOR TO INITIATING ANY CONSTRUCTION. THE MECHANICAL PLUG(S) SHALL REMAIN IN PLACE UNTIL THE NEW MAINS HAVE BEEN FLUSHED, CLEANED, TESTED, TELEVISED, AND APPROVED FOR USE BY THE WARREN COUNTY SANITARY ENGINEER. THE MECHANICAL PLUG(S) CAN ONLY BE REMOVED IN THE PRESENCE OF A WARREN COUNTY SEWER INSPECTOR.
2. ALL NEW MANHOLES SHALL BE VACUUM TESTED. A VACUUM OF 10" OF MERCURY SHALL BE DRAWN ON THE MANHOLE. FOR A 4' MANHOLE LESS THAN 20' DEEP, MANHOLE SHALL HOLD 9" OF MERCURY FOR AT LEAST ONE (1) MINUTE.
3. ALL SANITARY SEWER MAINS MUST BE AIR TESTED. THE STANDARD TEST IS AN AIR PRESSURE TEST OF 5.0 PSI FOR A FIVE (5) MINUTE PERIOD WITH A MAXIMUM OF 1.0 PSI LOSS.
4. ALL NON-TRUSS PIPE SHALL BE TESTED FOR DEFLECTION AFTER BACKFILLING IS COMPLETED (30 DAY MINIMUM REQUIRED). A DEFLECTION TEST WITH A NINE POINT MANDREL WILL BE REQUIRED. NO MECHANICAL PULLING DEVICE SHALL BE USED. A VERTICAL RING DEFLECTION GREATER THAN FIVE PERCENT (5%) WILL NOT BE ALLOWED. THIS DEFLECTION IS DEFINED AS A FIVE PERCENT REDUCTION IN THE VERTICAL BASE OR AVERAGE INSIDE DIAMETER.
5. AT THE TIME THE SANITARY SEWER IS TESTED, THE SEWER MUST BE CLEANED AND TELEVISED WITH VIDEO DOCUMENTATION PROVIDED TO WARREN COUNTY ON A FLASH DRIVE OR THROUGH A FILE TRANSFER PROTOCOL (FTP) SITE. THE VIDEO MUST INCLUDE AUDIO IDENTIFICATION OF THE PIPE SPANS FROM MANHOLE TO MANHOLE, FLOW DIRECTION, TILT AND PAN OF ALL LATERALS AND CALL OUT ANY SUSPECT PROBLEMS IN THE SYSTEM. ALL PROBLEMS MUST BE IDENTIFIED BY THE CONTRACTOR. THE NECESSARY REPAIRS MUST BE MADE AND THE SEWER MUST THEN BE RE-CLEANED, RE-TESTED, AND RE-TELEVISED.
6. A SECOND VIDEO INSPECTION IS REQUIRED ONE YEAR AFTER INSTALLATION AND/OR PRIOR TO THE RELEASE OF THE MAINTENANCE BOND. IF A DEFICIENCY IS IDENTIFIED DURING THIS TELEVISED INSPECTION, THE FAILED SEWER PIPE MUST BE TESTED AND REPAIRED TO THE SATISFACTION OF THE COUNTY SANITARY ENGINEER.
7. THE DEVELOPER SHALL BE RESPONSIBLE FOR ALL COSTS ASSOCIATED WITH THE TELEVISING, TESTING, AND REPAIRS OF THE SANITARY SEWER.

APPROVED/REVISED  MAY, 2023	WARREN COUNTY STANDARD DETAILS DEPARTMENT OF WATER & SEWER	STANDARD NUMBER  <b>SG-4</b>