

WARREN COUNTY, OHIO

BUILDING DEPARTMENT, 406 JUSTICE DRIVE, LEBANON OH 45036

INSPECTIONS:

- 1. Electric trench & bonding before backfilling.**
 - 2. Final electric inspection.**
- Call 513-695-1290 the day before the inspection.**


*CONTACT YOUR ZONING DEPARTMENT
FOR FENCE REQUIREMENTS*

If you plan any lighting in or within 16' of the pool you will need to talk to the plans examiner. 513-695-1290 NEC 680.22 (C)

Pump conductor (wire) must reach the outlet without an extension cord. If plug in wire is used the maximum length is 3'. NEC 680.7 (A)


Hard wired pump requires a switch within sight of the motor. Twist lock receptacle mounted on Weather Proof Box with cover on a 4" x 4" post must be between 6' to 10' of pool. NEC 680.22 (A)(1) & 430.102 (B)(1)

No outlets within 6' of the pool.
NEC 680.22 (A)(2)

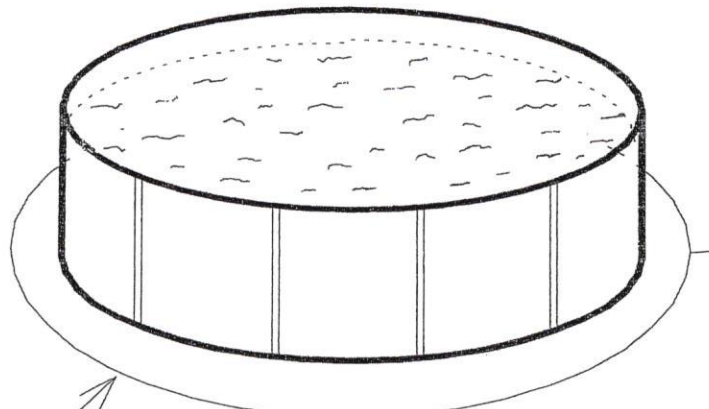

Required; #8 copper bonding conductor 4" to 6" deep 18" to 24" from the pool edge to circle the entire pool and connected to the motor ground.

NEC 680.26 (B)(2)(4)

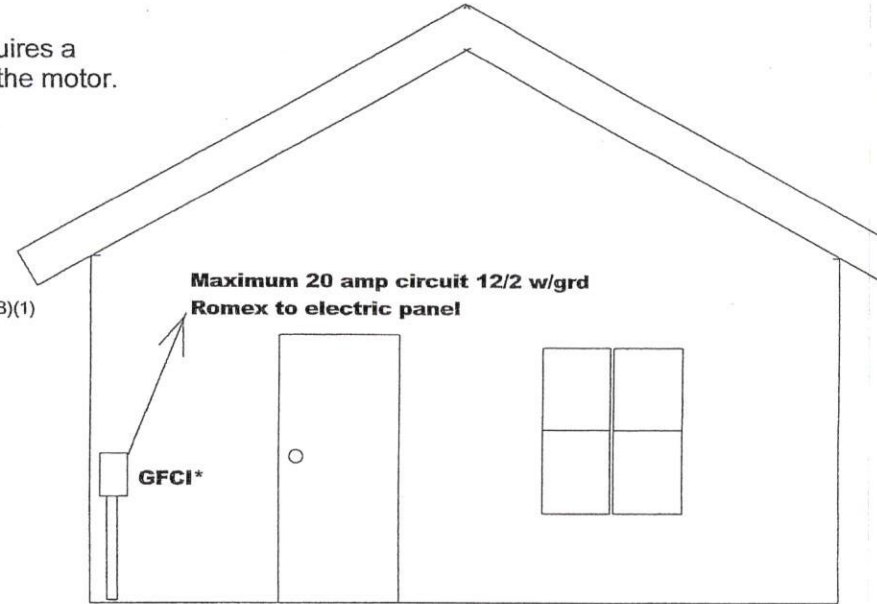

*** = GFI outlet mounted in a weather proof box with cover, within 20' from edge of pool.**

NEC 680.22 (A)(4)

18" deep

1/2" conduit 18" deep with 3 #12 THWN wire insulated.

NEC 680.25 (A)

THIS IS ONLY A PARTIAL LIST OF CODE REQUIREMENTS, REFERENCE THE OBC AND NEC FOR DETAILS